improve your life

Split Type Floor-standing Air Conditioner

Service Manual

INVERTER

INDOOR UNIT	OUTDOOR UNIT
AFSI ECO 120HL1	AFSI ECO 120SH
AFSI ECO 120 HL NEW	AFSI ECO 120SH3

Thank you for choosing an Argoclima air conditioner. Please read this manual carefully before using the unit and retain it for future reference

V 02/24

Table of Contents

Part I : Technical Information 1
1. Summary 1
2. Specifications 3
2.1 Specification Sheet 3
2.2 Capacity Variation Ratio According to Temperature 7
2.3 Cooling and Heating Data Sheet in Rated Frequency 8
3. Outline Dimension Diagram 9
3.1 Indoor Unit 9
3.2 Outdoor Unit 11
4. Refrigerant System Diagram 13
5. Electrical Part 14
5.1 Wiring Diagram 14
5.2 PCB Printed Diagram 18
6. Function and Control 23
6.1 Function Buttons of Air Conditioner 23
6.2 Remote Controller Introduction of YAP1F4(WiFi) 25
6.3 Remote Controller Introduction of YAP1F11 29
6.4 Remote Controller Introduction of YBE1FB8 33
6.5 GREE+ App Operation Manual 38
6.6 Ewpe Smart App Operation Manual 39
6.7 Description of Each Control Operation 40
Part II : Installation and Maintenance 43
7. Notes for Installation and Maintenance 43
8. Installation 49
8.1 Installation Dimension Diagram 49
8.2 Installation Parts-checking 52

8.3 Selection of Installation Location....52
8.4 Electric Connection Requirement....52
8.5 Installation of Indoor Unit....53
8.6 Installation of Outdoor Unit....54
8.7 Vacuum Pumping and Leak Detection....56
8.8 Check after Installation and Test Operation....56
9. Maintenance....57
9.1 Error Code List....57
9.2 Procedure of Troubleshooting....62
9.4 Troubleshooting for Normal Malfunction....74
10. Exploded View and Parts List....76
10.1 Indoor Unit....76
10.2 Outdoor Unit....82
11. Removal Procedure....88
11.1 Removal Procedure of Indoor Unit....88
11.2 Removal Procedure of Outdoor Unit....103
Appendix:....116
Appendix 1: Reference Sheet of Celsius and Fahrenheit....116
Appendix 2: Configuration of Connection Pipe....116
Appendix 3: Pipe Expanding Method....117
Appendix 4: List of Resistance for Temperature Sensor....118

1. Summary

Indoor Unit:

AFSI ECO 120HL1




AFSI ECO 120HL NEW




Outdoor Unit:

AFSI ECO 120SH3 NEW

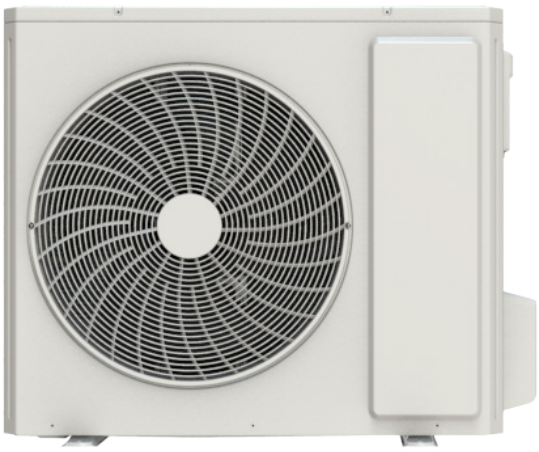

AFSI ECO 120SH

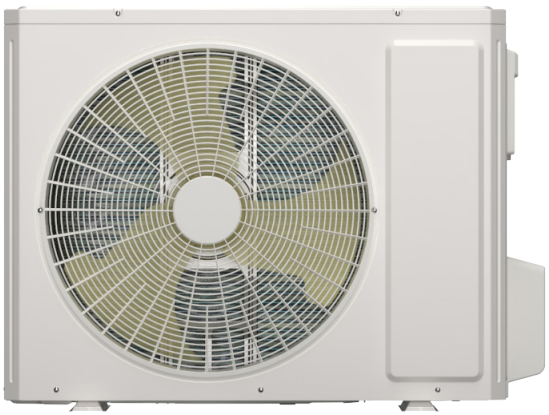

Remote Controller:

1PH



3PH



2. Specifications

2.1 Specification Sheet

Model			GVH48ALXK-M6DNC7A
Product Code			CH156006500
Power Supply	Rated Voltage	V~	380-415
	Rated Frequency	Hz	50
	Phases		3
Power Supply Mode			Outdoor
Cooling Capacity		W	12500
Heating Capacity		W	14500
Cooling Power Input		W	3790
Heating Power Input		W	3860
Cooling Power Current		A	5.6
Heating Power Current		A	5.7
Rated Input		W	5700
Rated Cooling Current		A	9.8
Rated Heating Current		A	8.1
Air Flow Volume		m^3/h	2400/2200/2000/1800
Dehumidifying Volume		L/h	5
EER		W/W	3.3
COP		W/W	3.76
SEER			6.1
SCOP(Average/Warmer)			4/5.1
Application Area		m^2	55-85
Indoor Unit	Model of indoor unit		GVH48ALXK-M6DNC7A/I
	Indoor Unit Product Code		CH156N06500
	Fan Type		Centrifugal
	Fan Diameter Length(DXL)	mm	Φ379X180.5
	Cooling Speed	r/min	600/560/530/500
	Heating Speed	r/min	600/560/530/500
	Fan Motor Power Output	W	220
	Fan Motor RLA	A	/
	Fan Motor Capacitor	μF	/
	Evaporator Form		Aluminum Fin-copper Tube
	Evaporator Pipe Diameter	mm	Φ7.94
	Evaporator Row-fin Gap	mm	3-1.5
	Evaporator Coil Length (LXDXW)	mm	836X62X472
	Swing Motor Model		MP35AB/MP24TA
	Swing Motor Power Output	W	2.5/1.5
	Fuse Current	A	5
	Sound Pressure Level	dB (A)	Cooling: 56/54/53/51 Heating: 56/54/53/51
	Sound Power Level	dB (A)	Cooling: 66/64/63/61 Heating: 66/64/63/61
	Dimension (WXHXD)	mm	587X1882X394
	Dimension of Carton Box (LXWXH)	mm	2125X715X470
	Dimension of Package (LXWXH)	mm	2128X718X485
	Net Weight	kg	57
	Gross Weight	kg	69


Outdoor Unit	Outdoor Unit Model		GVH48ALXK-M6DNC7A/O
	Outdoor Unit Product Code		CH156W06500
	Compressor Manufacturer		ZHUHAI LANDA COMPRESSOR CO., LTD.
	Compressor Model		QXFS-D280zX070
	Compressor Oil		FW68DA(FW68L)
	Compressor Type		Rotary
	Compressor LRA.	A	40
	Compressor RLA	A	4.9
	Compressor Power Input	W	3200
	Compressor Overload Protector		/
	Throttling Method		Electron expansion valve
	Set Temperature Range	ºC	16~30
	Cooling Operation Ambient Temperature Range	ºC	-15~50
	Heating Operation Ambient Temperature Range	ºC	-15~30
	Condenser Form		Aluminum Fin-copper Tube
	Condenser Pipe Diameter	mm	Φ7.94
	Condenser Rows-fin Gap	mm	3-1.6
	Condenser Coil Length (LXDXW)	mm	1000X792X57
	Fan Motor Speed	rpm	820
	Fan Motor Power Output	W	130
	Fan Motor RLA	A	0.42
	Fan Motor Capacitor	μF	/
	Outdoor Unit Air Flow Volume	m^3/h	5200
	Fan Type		Axial-flow
	Fan Diameter	mm	Φ550
	Defrosting Method		Automatic Defrosting
	Climate Type		T1
	Isolation		I
	Moisture Protection		IPX4
	Permissible Excessive Operating Pressure for the Discharge Side	MPa	4.3
	Permissible Excessive Operating Pressure for the Suction Side	MPa	2.5
	Sound Pressure Level	dB (A)	63
	Sound Power Level	dB (A)	74
	Dimension(WXHXD)	mm	1020X820X427
	Dimension of Carton Box (LXWXH)	mm	1090X494X850
	Dimension of Package(LXWXH)	mm	1093X497X955
	Net Weight	kg	81
	Gross Weight	kg	94
	Refrigerant		R32
	Refrigerant Charge	kg	2.8
Connection Pipe	Connection Pipe Length	m	5
	Connection Pipe Gas Additional Charge	g/m	40
	Outer Diameter Liquid Pipe	inch	3/8"
	Outer Diameter Gas Pipe	inch	5/8"
	Max Distance Height	m	20
	Max Distance Length	m	30
	Note: The connection pipe applies metric diameter.		

The above data is subject to change without notice; please refer to the nameplate of the unit.


2.2 Capacity Variation Ratio According to Temperature

24K

Cooling:

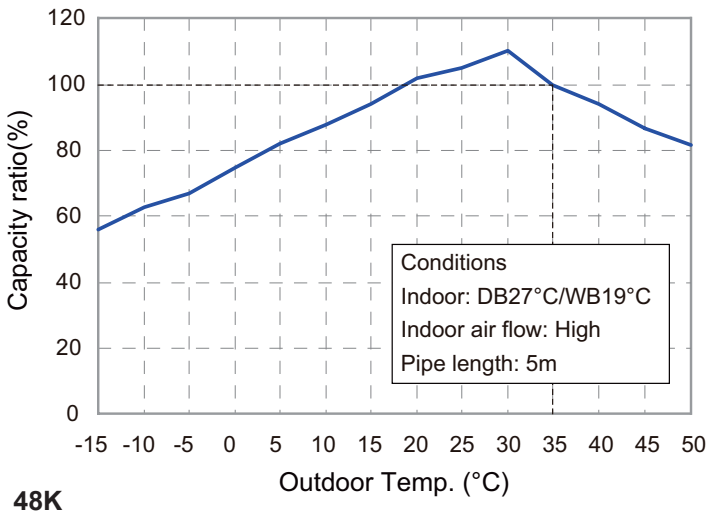


Heating:

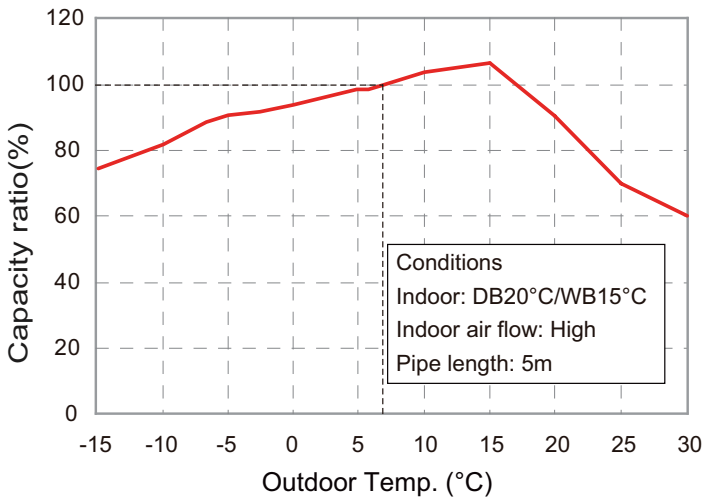


48K

Cooling:

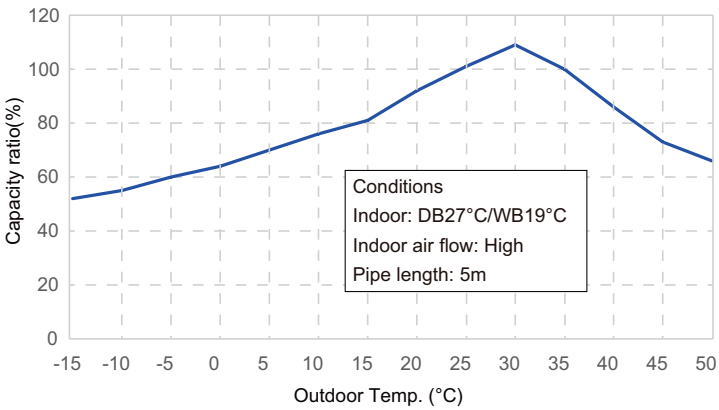

Heating:

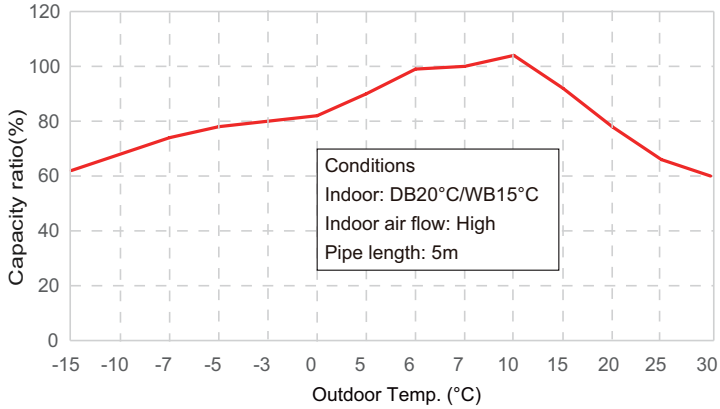

2.3 Cooling and Heating Data Sheet in Rated Frequency

Cooling:

Rated cooling condition(°C) (DB/WB)		Model	Pressure of gas pipe connecting indoor and outdoor unit	Inlet and outlet pipe temperature of heat exchanger		Fan speed of indoor unit	Fan speed of outdoor unit
Indoor	Outdoor		P (MPa)	T1 (°C)	T2 (°C)		
27/19	35/24	24K	0.9 ~ 1.1	in: 8~11 out: 11~14	in:65~75 out:37~43	Super High	High
27/19	35/24	48K	0.9 ~ 1.1	in: 8~11 out: 11~14	in:75~85 out:37~43	Super High	High


Heating:

Rated heating condition(°C) (DB/WB)		Model	Pressure of gas pipe connecting indoor and outdoor unit	Inlet and outlet pipe temperature of heat exchanger		Fan speed of indoor unit	Fan speed of outdoor unit
Indoor	Outdoor		P (MPa)	T1 (°C)	T2 (°C)		
20/-	7/6	24K	2.0 ~ 2.3	in: 1~3 out: 4~8	in:75~85 out:33~48	Super High	High
20/-	7/6	48K	2.5 ~ 3.0	in:75~85 out:37~43	in:1~3 out:3~5	Super High	High

Instruction:
T1: Inlet and outlet pipe temperature of evaporator
T2: Inlet and outlet pipe temperature of condenser
P: Pressure at the side of big valve
Connection pipe length: 5m.


3. Outline Dimension Diagram

3.1 Indoor Unit

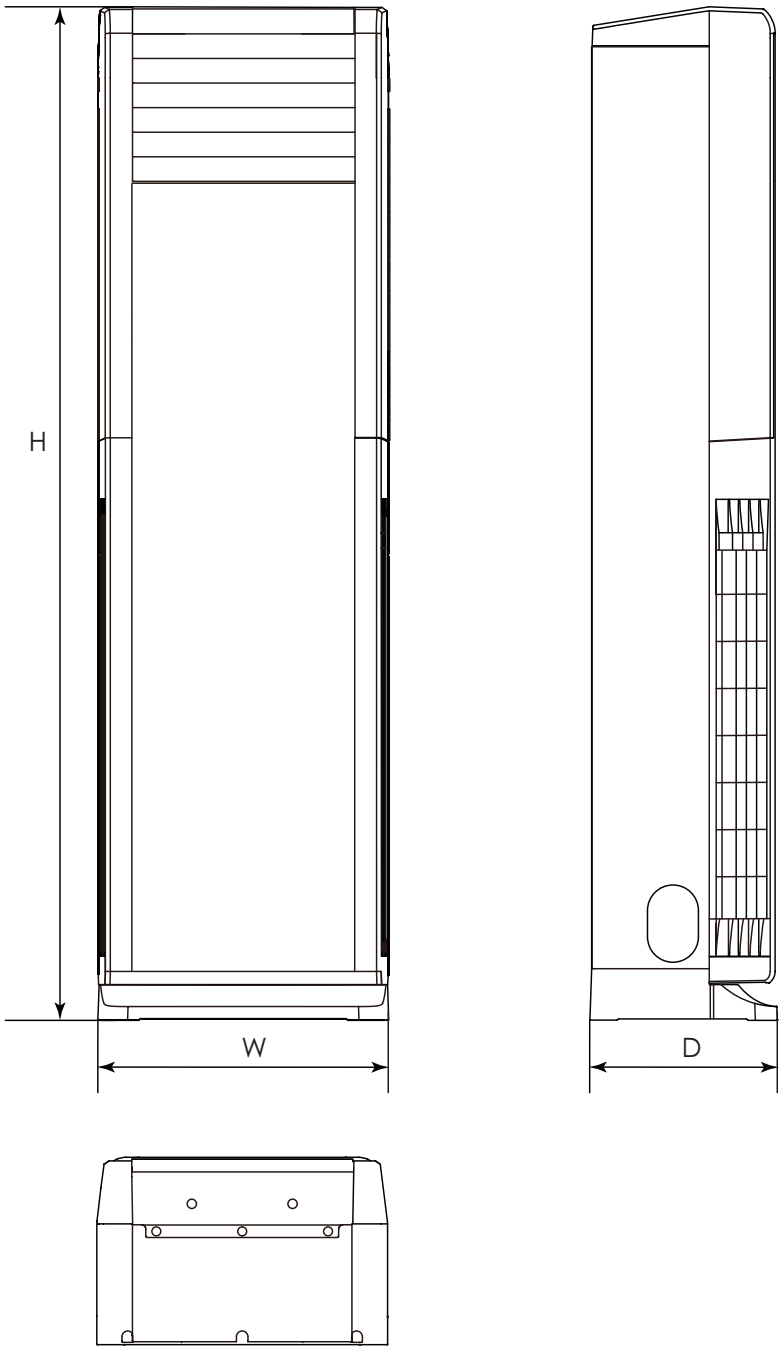

Unit:mm

Model	W	H	D
24K	507	1770	320
48K(XH)	587	1882	394

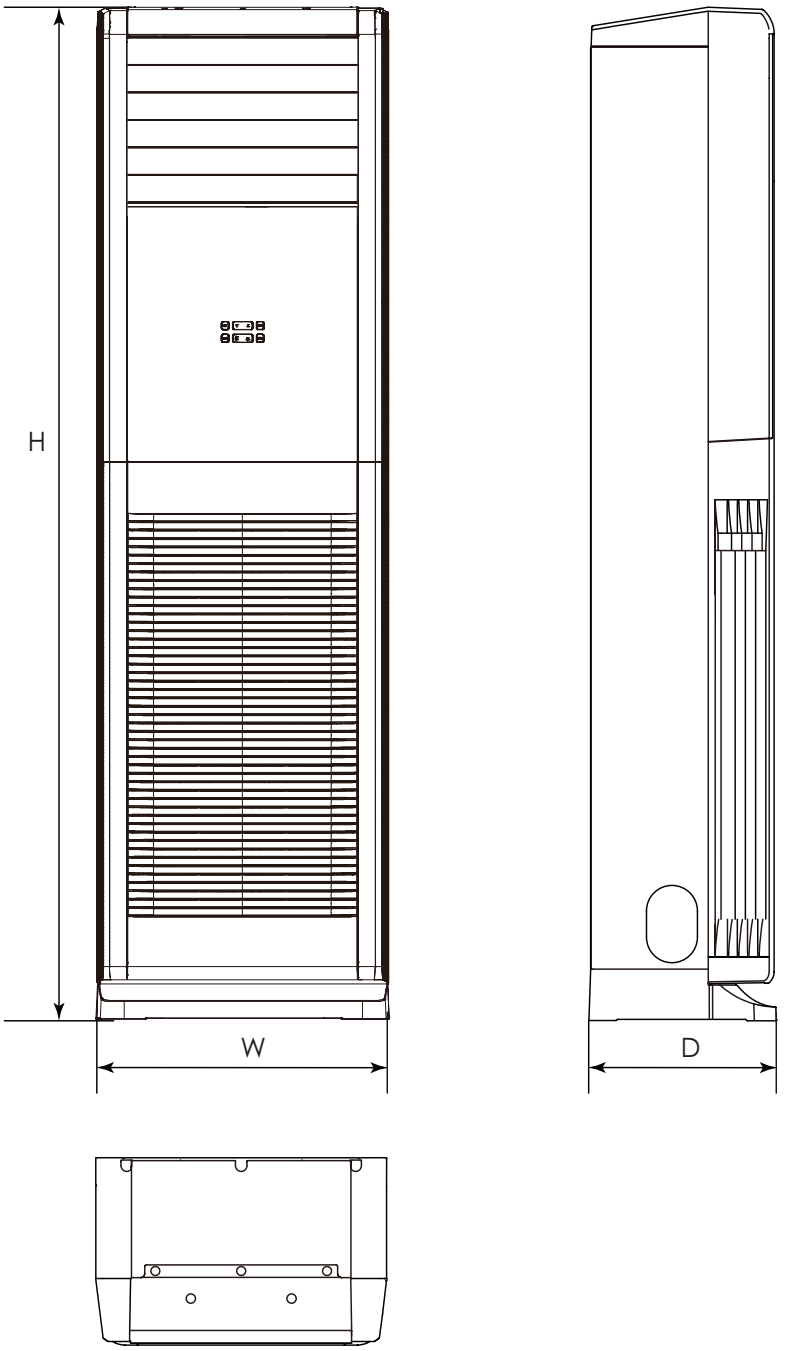


Unit:mm

Model	W	H	D
48K(XK)	587	1882	394


3.2 Outdoor Unit

GVH24AMXF-K6DNC7A/O

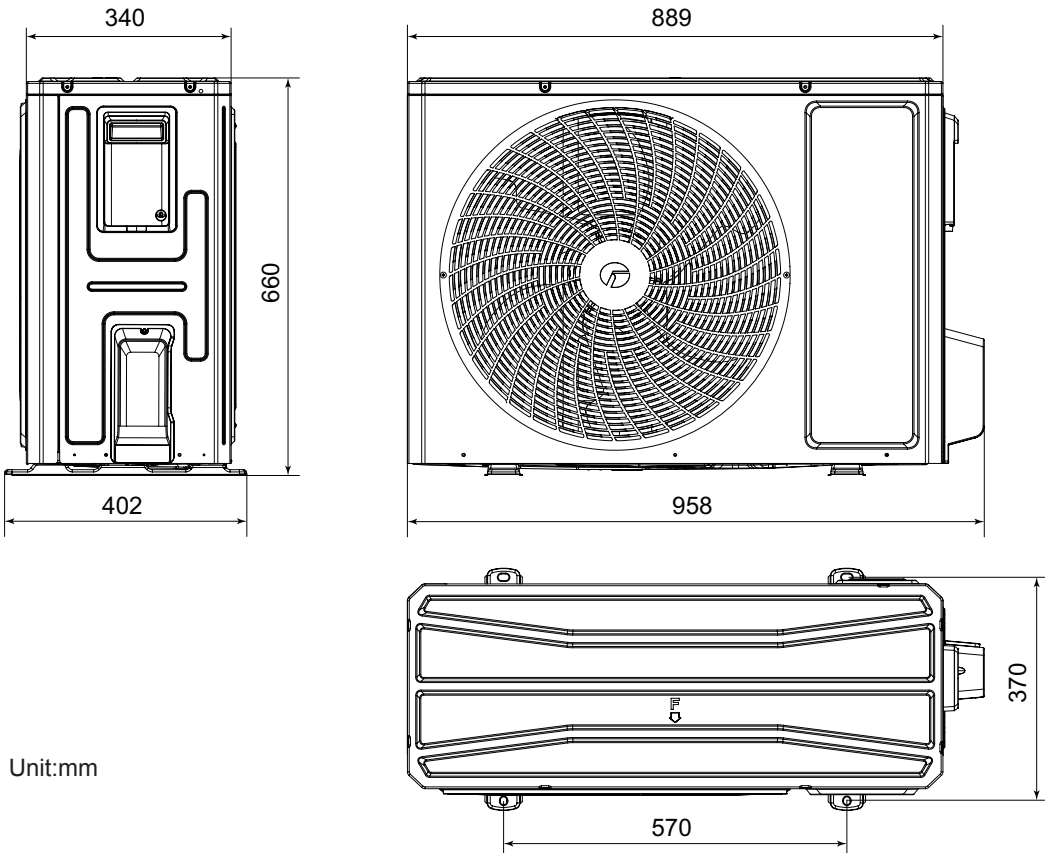


Unit:mm

GVH48ALXH-K6DNC7A/O

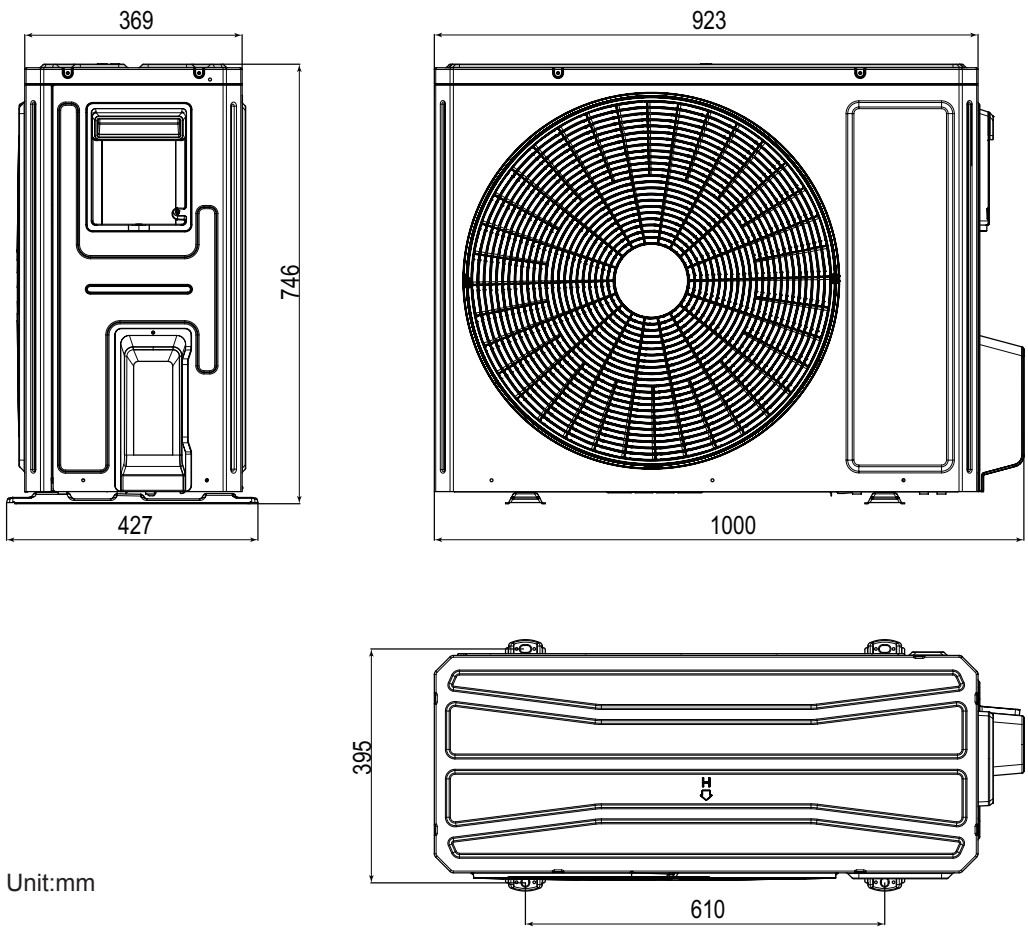

Unit:mm


GVH48ALXK-M6DNC7A/O

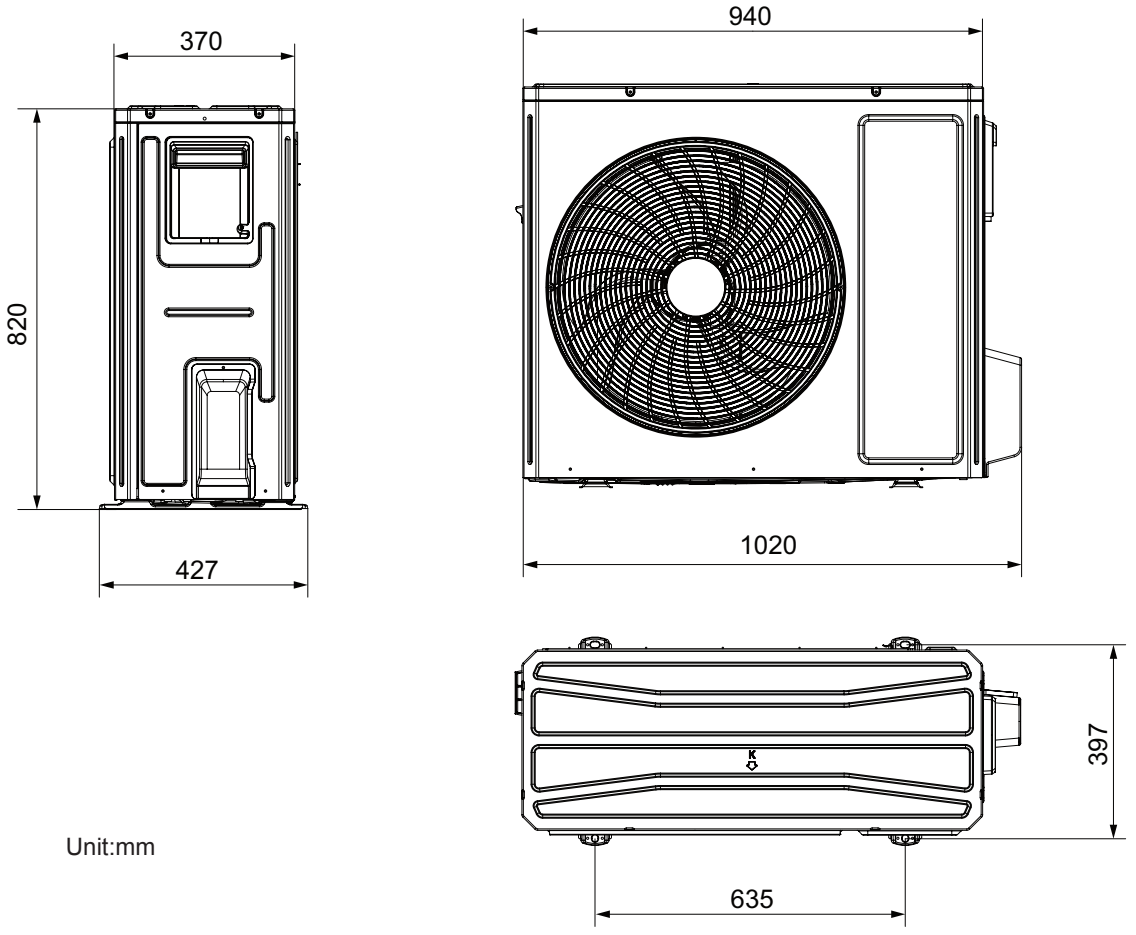

Unit:mm

4. Refrigerant System Diagram

Heat pump model

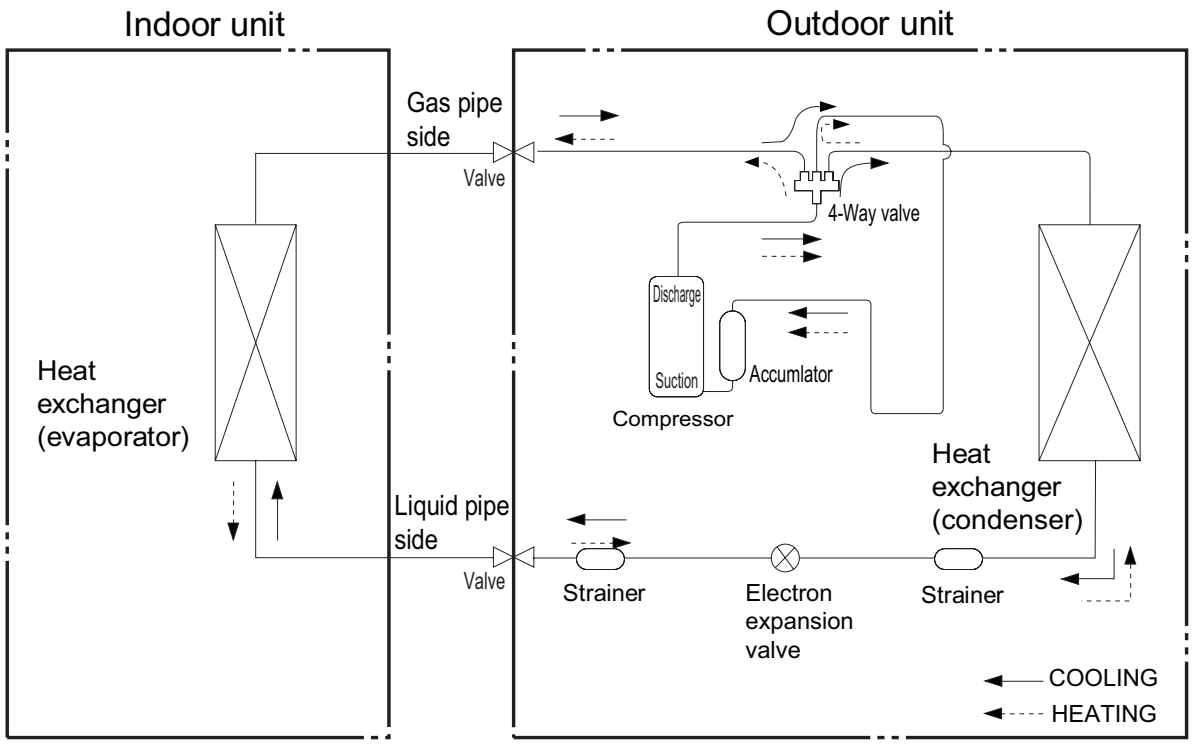

Connection pipe specification:
Liquid pipe:1/4" 24K/48K(XH)
Liquid pipe:3/8" 48K(XK)
Gas pipe: 5/8"

5. Electrical Part

5.1 Wiring Diagram

● Instruction

Symbol	Symbol Color
YE	Yellow
RD	Red
YEGN	Yellow/Green


Symbol	Symbol Color
BN	Brown
BU	Blue
BK	Black

Symbol	Name
COMP	Compressor
⏚	Grounding wire
/	/


Note: Jumper cap is used to determine fan speed and the swing angle of horizontal lover for this model.

● Indoor Unit


GVH24AMXF-K6DNC7A/I

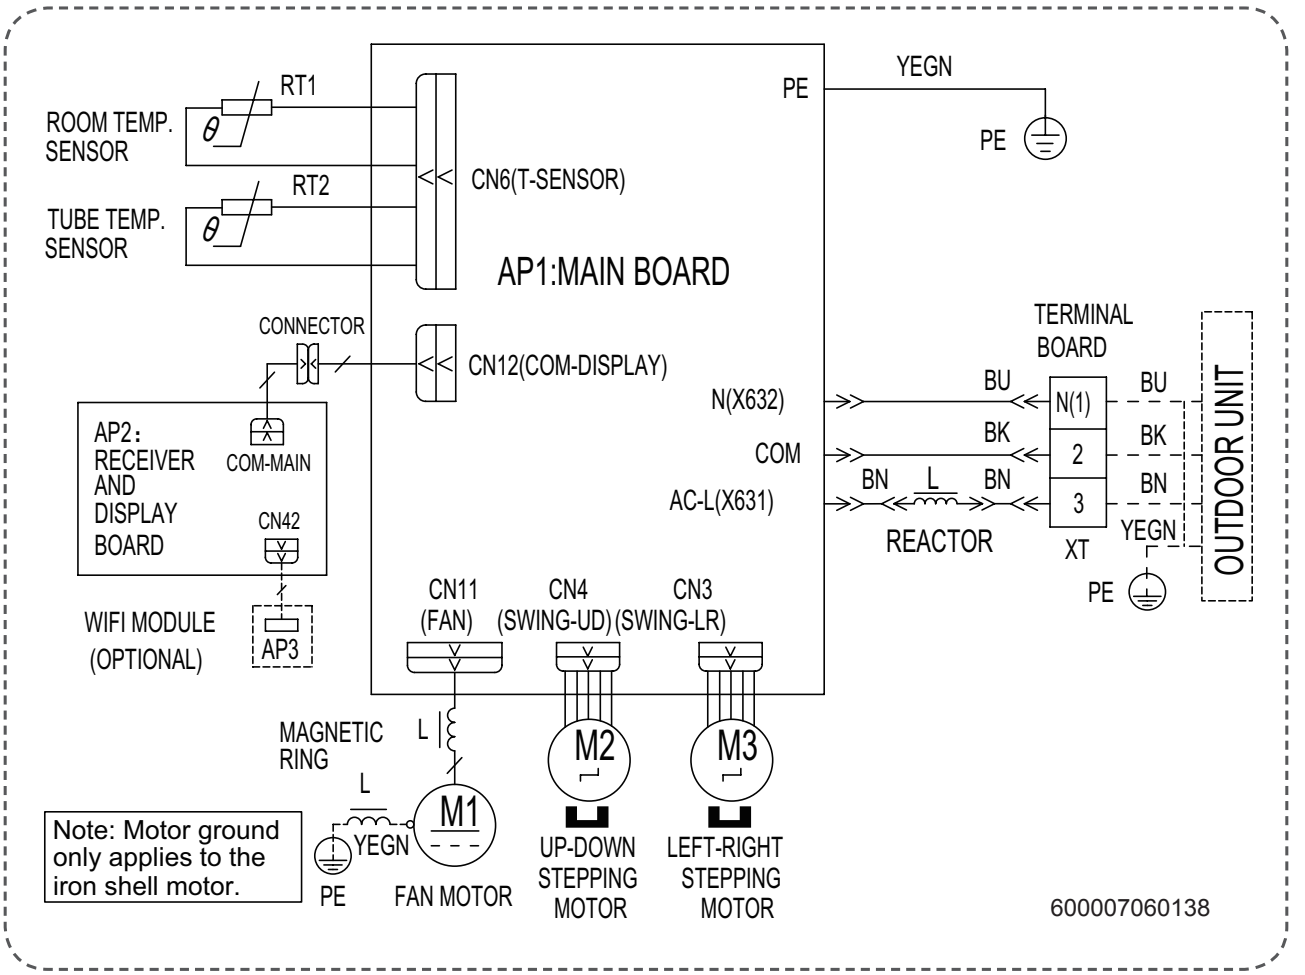

GVH48ALXH-K6DNC7A/I

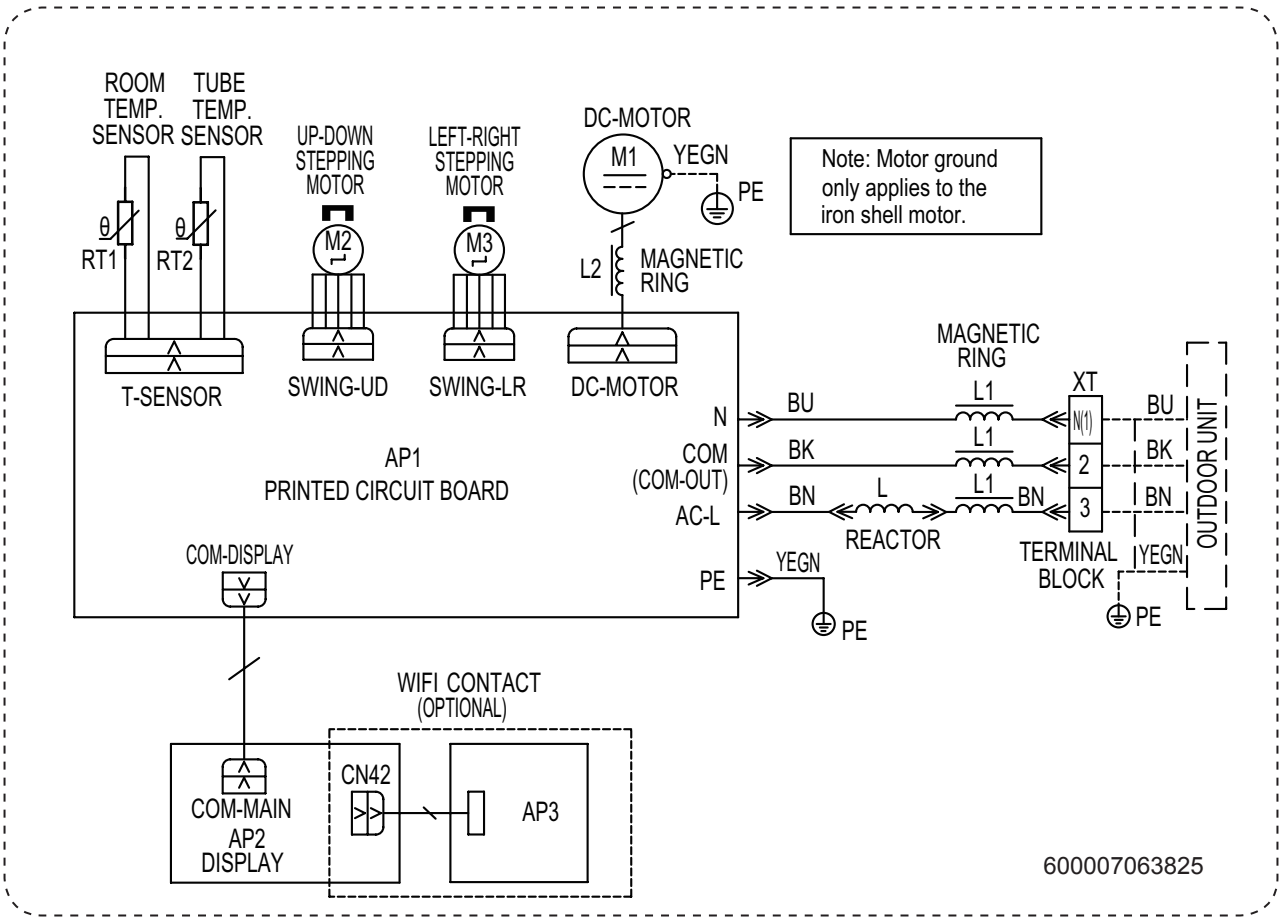


GVH48ALXK-M6DNC7A/I

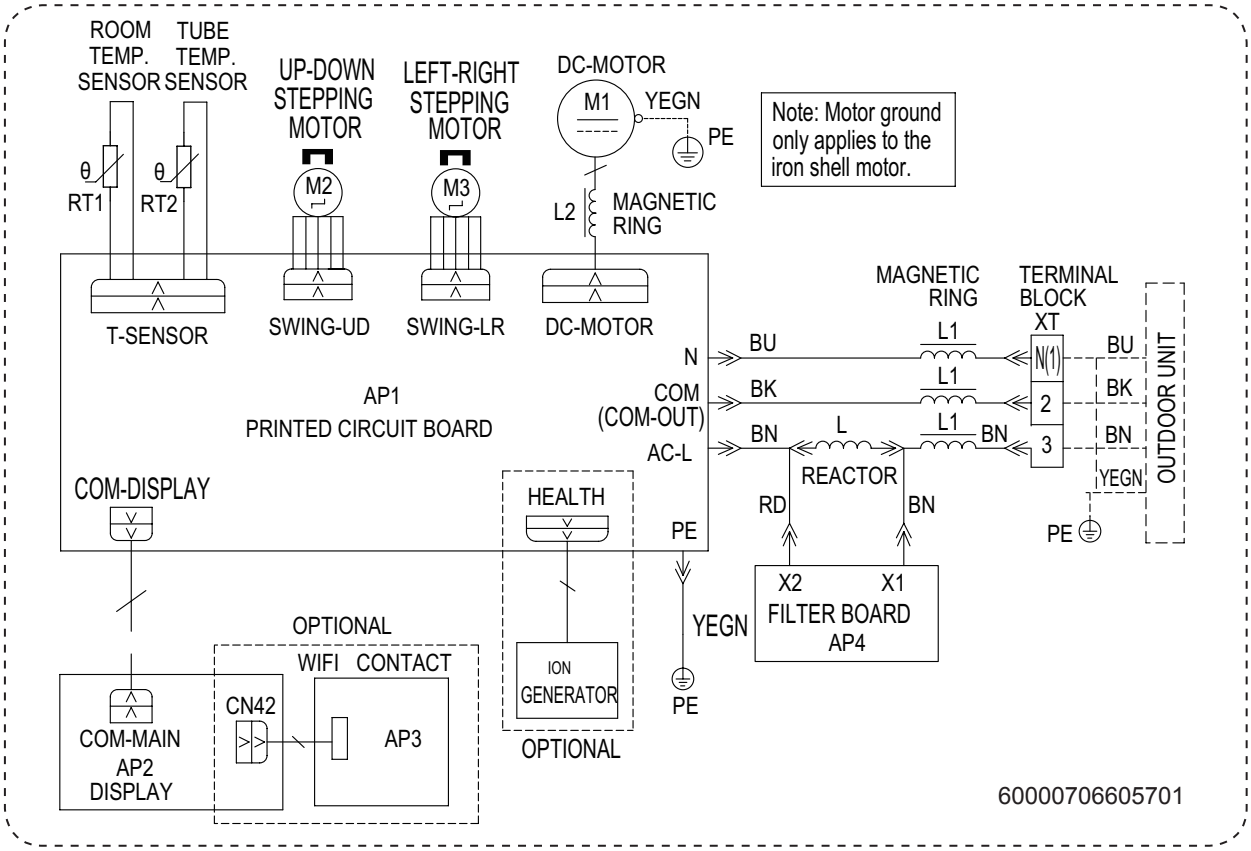


● Outdoor Unit


GVH24AMXF-K6DNC7A/O

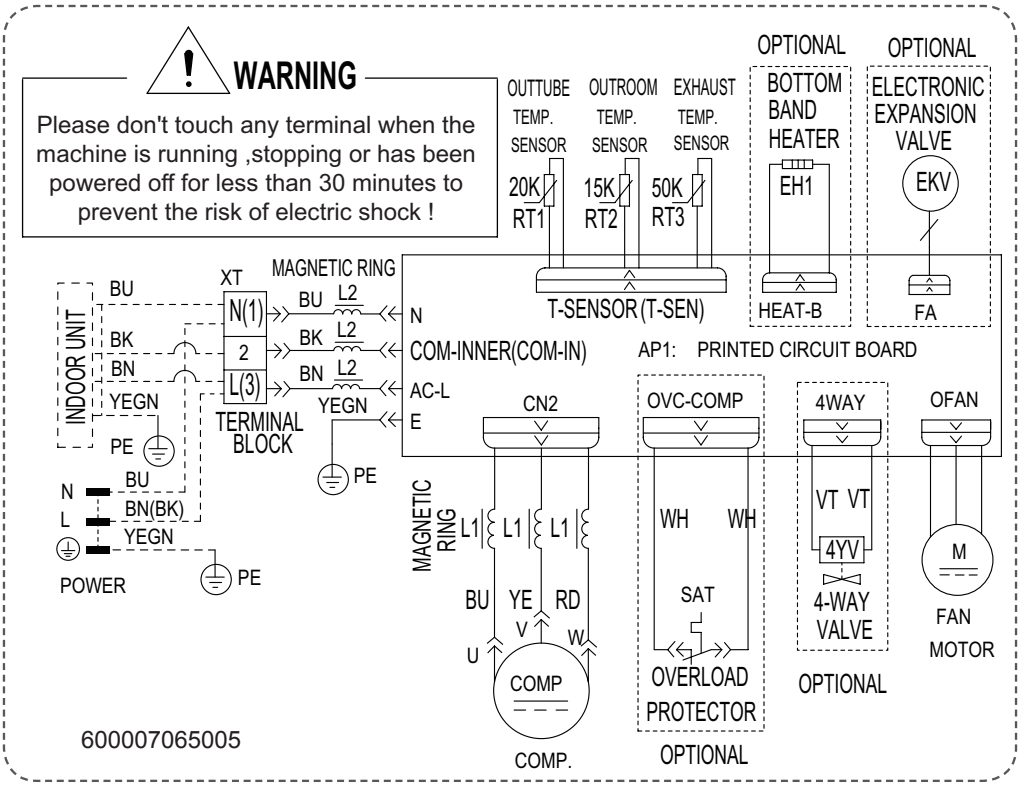

GVH48ALXH-K6DNC7A/O

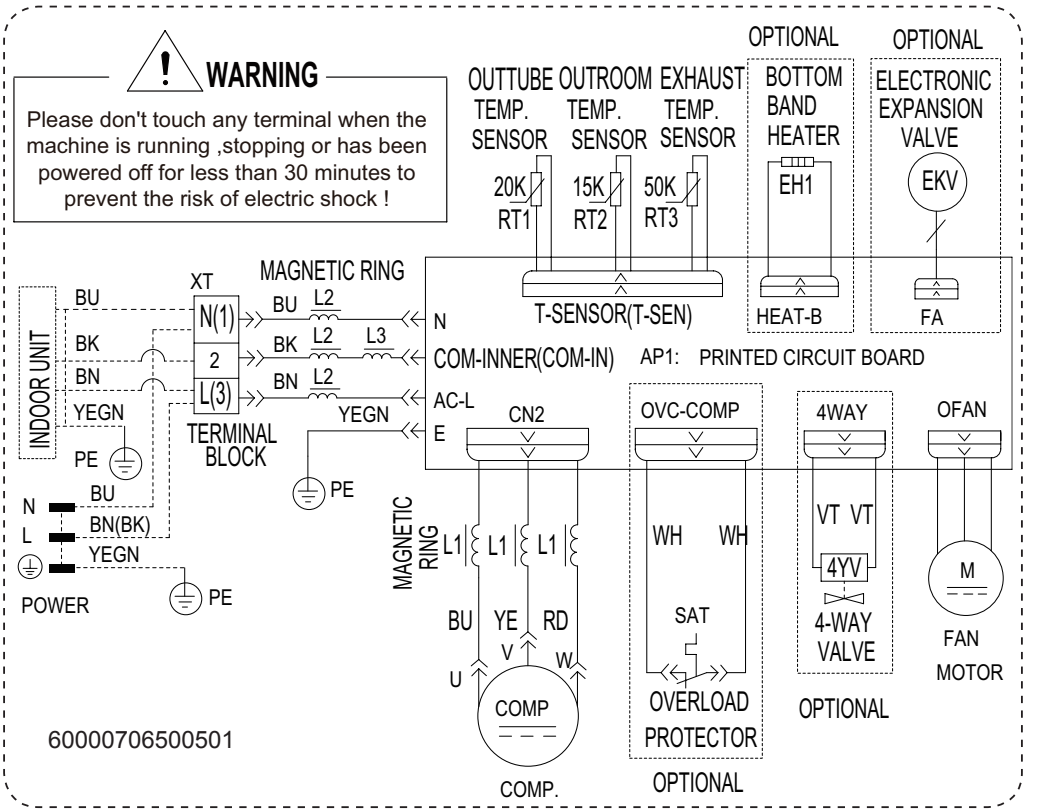

GVH48ALXK-M6DNC7A/O

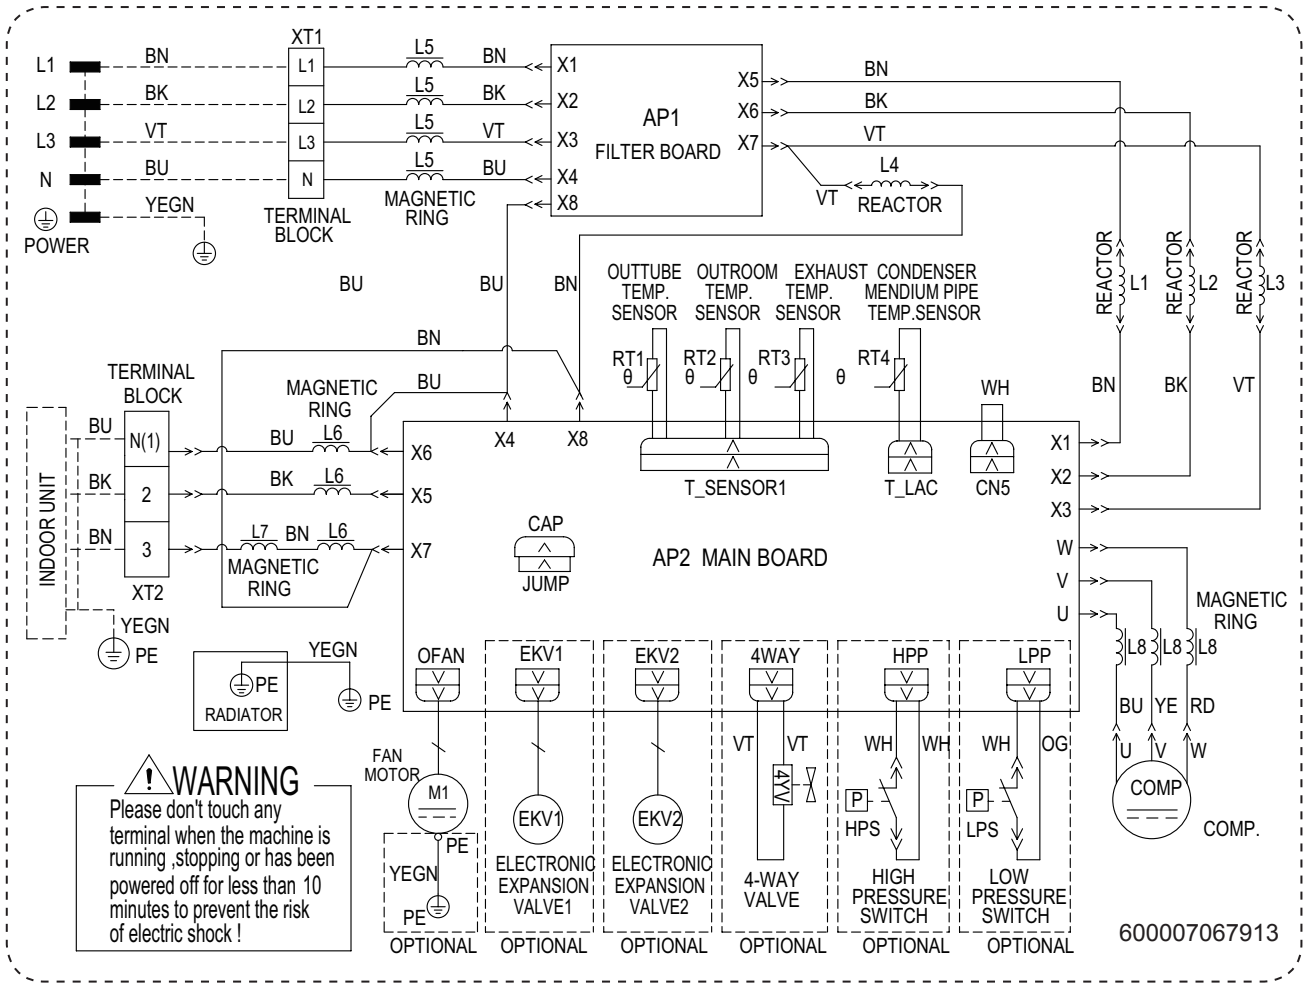


These wiring diagrams are subject to change without notice; please refer to the one supplied with the unit.

5.2 PCB Printed Diagram


● Indoor Unit

GVH24AMXF-K6DNC7A/I

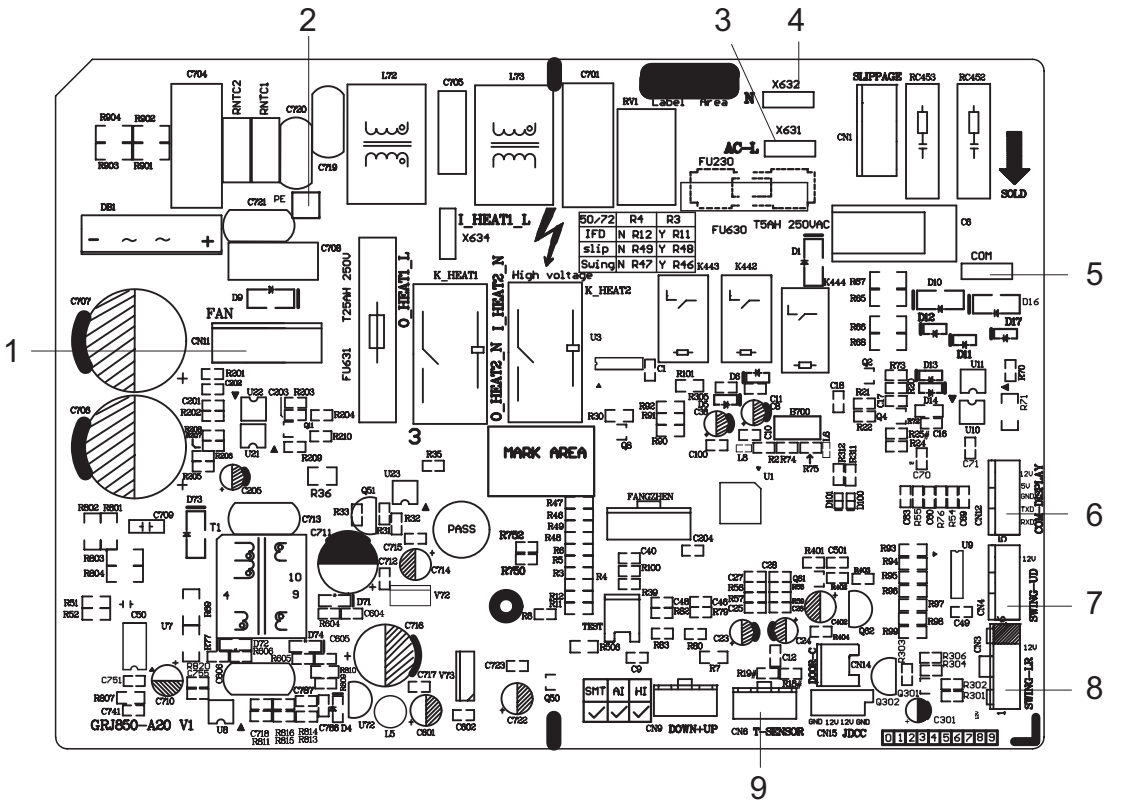

No.	Name	No.	Name
1	Needle stand of DC fan	6	Needle stand of display board communication
2	Earthing wire terminal	7	Needle stand of up&down swing
3	Copper pin terminal of live wire	8	Needle stand of left&right swing
4	Copper pin terminal of neutral wire	9	Needle stand of temperature sensor
5	Copper pin terminal of communication wire		

GVH48ALXH-K6DNC7A/I
GVH48ALXK-M6DNC7A/I

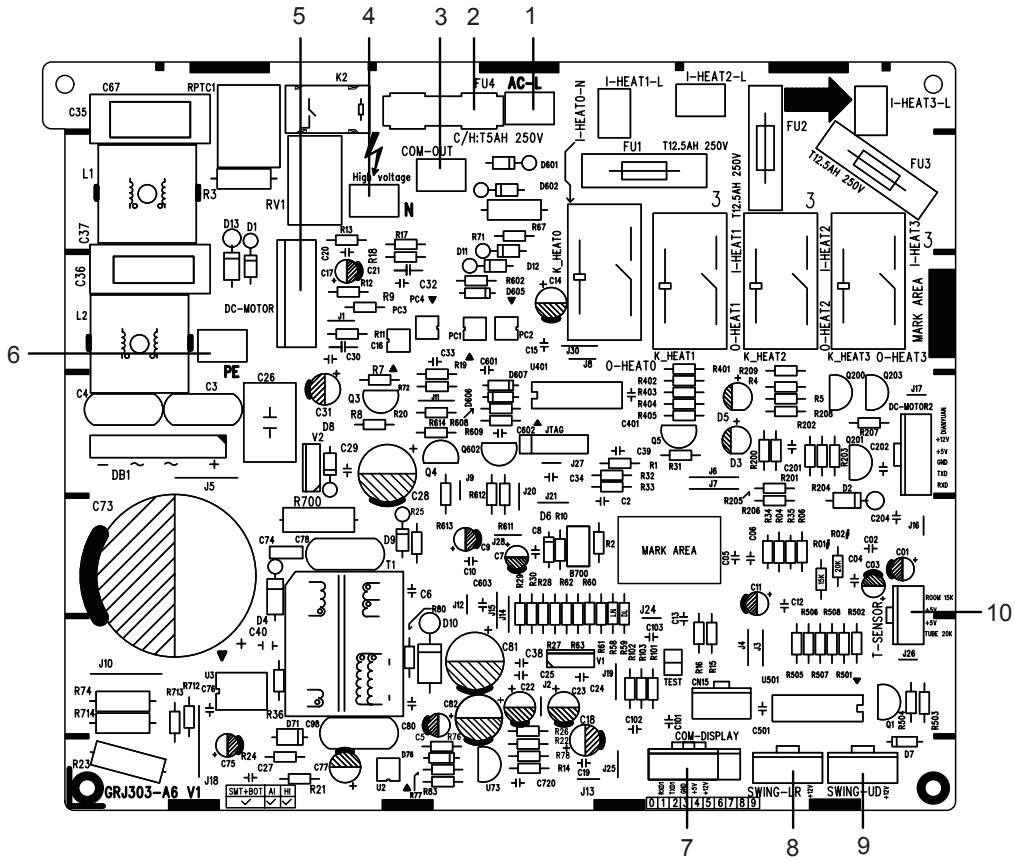


No.	Name
1	Interface of live wire
2	Fuse
3	Interface of communication wire for outdoor unit
4	Interface of netural wire
5	Motor interface of indoor unit

No.	Name
6	Interface of earthing wire
7	Connection needle stand of display board
8	Left & right swing interface
9	Up & down swing interface
10	Needle stand of temperature sensor


● Outdoor Unit

GVH24AMXF-K6DNC7A/O

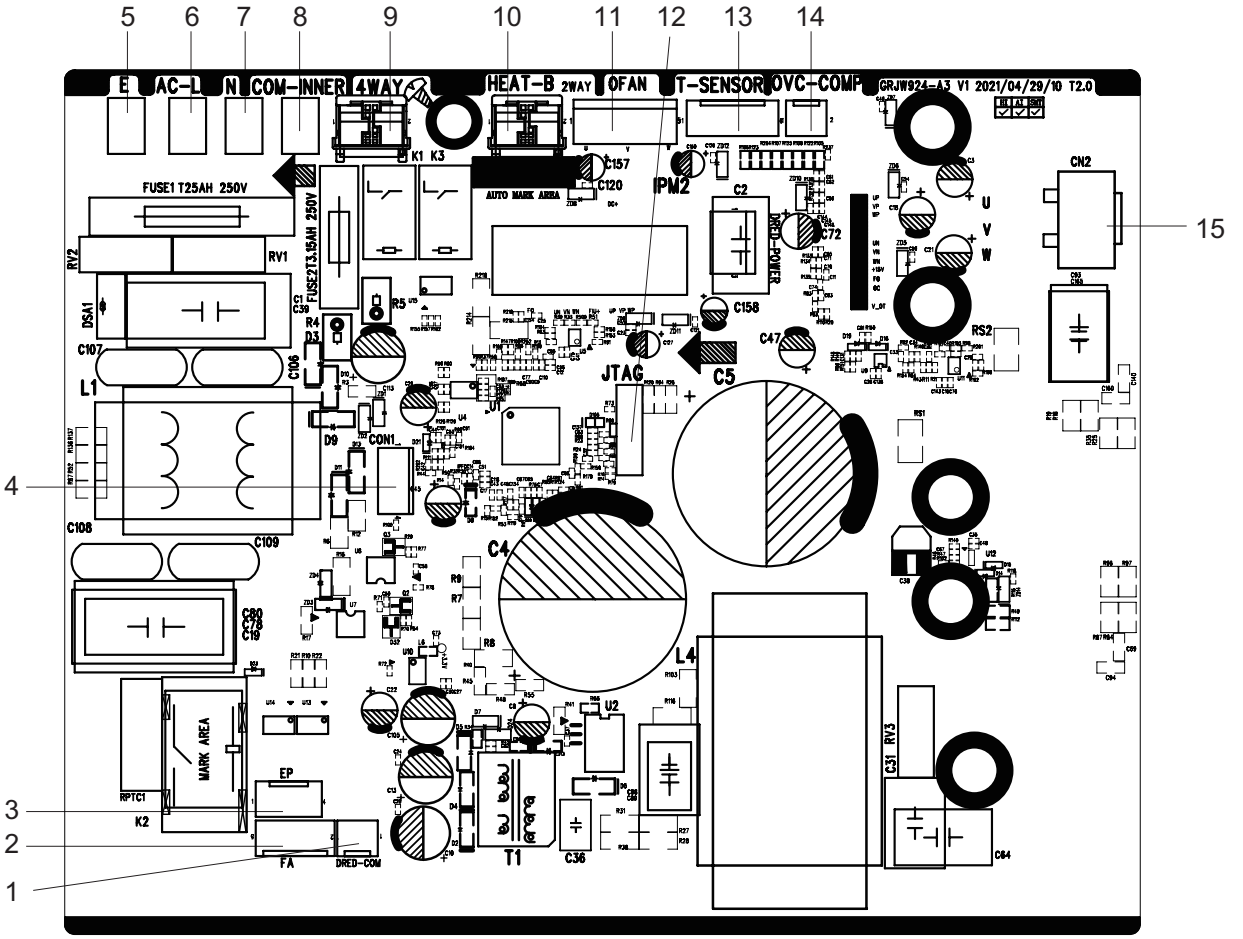


No.	Name	No.	Name
1	Interface of DRED	9	4-way valve
2	Terminal of electronic expansion valve	10	Electric heating belt of chassis
3	E disk(Reserved)	11	DC motor
4	Computer monitoring interface	12	Interface of program debugs
5	Grounding wire	13	Temperature sensor
6	Live wire	14	Overload interface of compressor
7	Neutral wire	15	Terminal of compressor
8	Communication wire		

GVH48ALXH-K6DNC7A/O

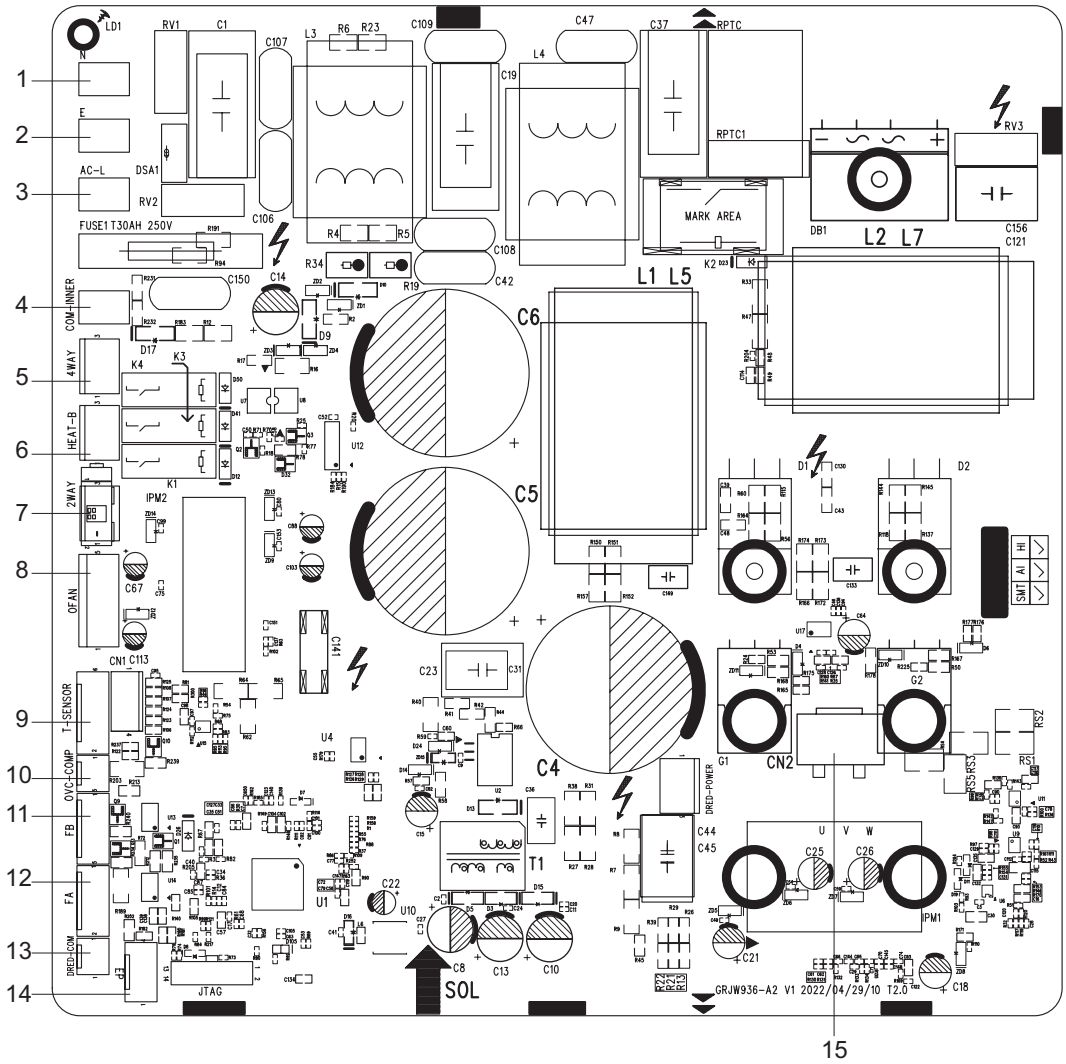

No.	Name	No.	Name
1	Neutral Wire Insertion	9	Temperature Sensor Needle Stand
2	Earthing Wire Insertion	10	Compressor Overload Needle Stand
3	Live Wire Insertion	11	Electronic Expansion Valve Needle Stand
4	Communication Wire Insertion	12	Electronic Expansion Valve Needle Stand
5	Four-way Valve Needle Stand	13	DRED Communication Needle Stand
6	Chassis Electric Heating Belt Needle Stand	14	EEP Flash Drive Needle Stand
7	Two-way Valve Needle Stand	15	Compressor Needle Stand
8	Outdoor Fan Needle Stand		

GVH48ALXK-M6DNC7A/O

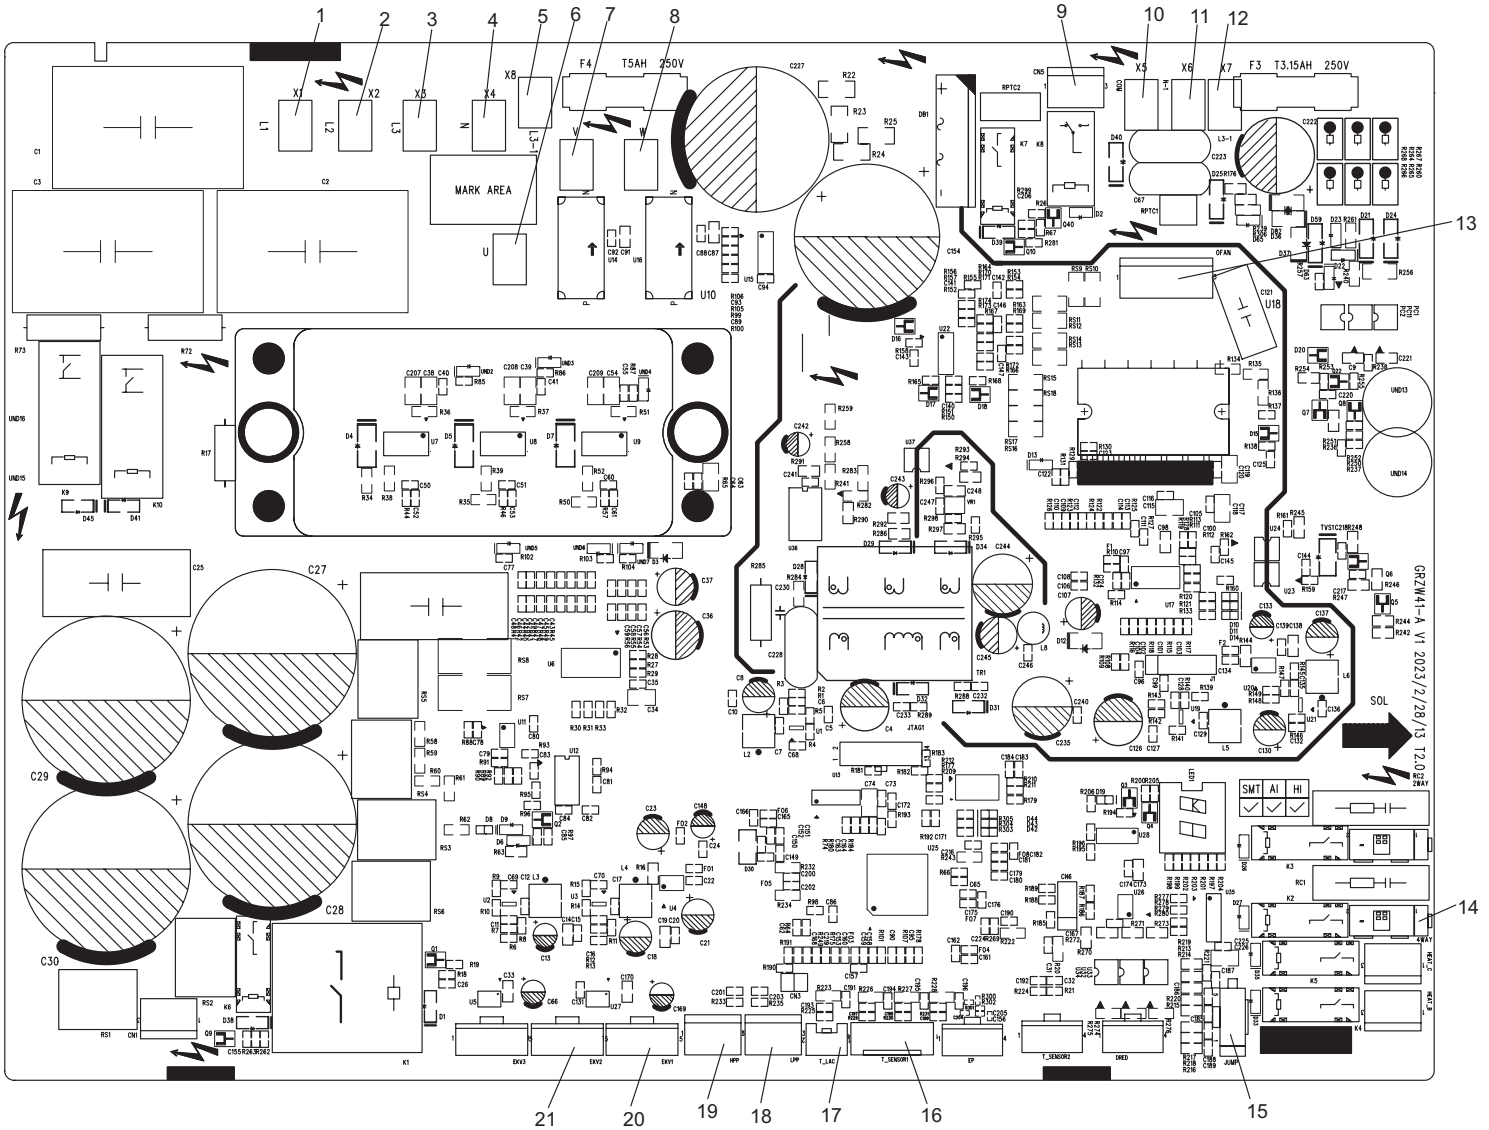

No.	Name
1	Live wire L1
2	Live wire L2
3	Live wire L3
4	Neutral wire (N)
5	Live wire L3-1
6	Compressor (U)
7	Compressor (V)
8	Compressor (W)
9	Terminal of Jumper
10	Communication wire COM


No.	Name
11	Neutral wire of communication
12	Live wire of communication
13	Wiring terminal of fan
14	4-way valve
15	Jumper
16	Temperature Sensor
17	Tube temperature sensor of condenser
18	Low pressure switch
19	High pressure switch
20	Electric Expand Valve 1

No.	Name
21	Electric Expand Valve 2

6. Function and Control


6.1 Function Buttons of Air Conditioner

Buttons Name and Function

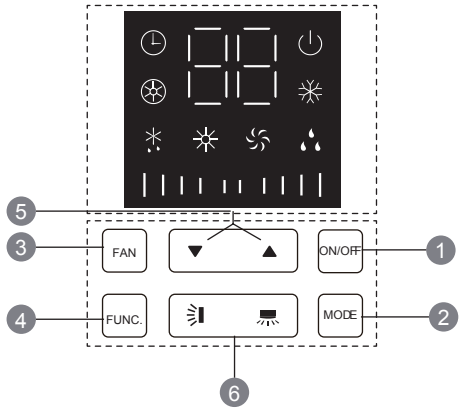

1. ON/OFF button
2. MODE button
3. FAN button
4. FUNCTION button
5. ▼/▲ button
6. / button

Introduction for icons on display screen of air conditioner

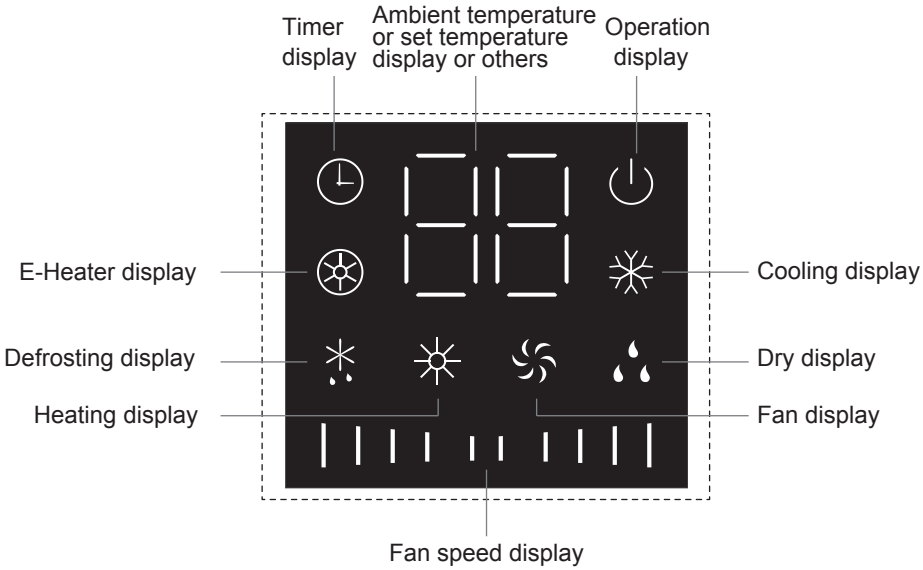

NOTE:

This series unit adopts touch buttons. You only need to touch the buttons slightly.

1. ON/OFF button

● Press this button to turn on or turn off the unit. (Note: Under X-FAN mode, press this button to turn on the unit directly.)

2. MODE button

● Every time press this button, the mode will switchover in cycle among.

COOLING → DRY
HEATING ← FAN

(Note: Cooling only unit won't accept heating operation signal. For cooling only unit, pressing MODE button under FAN mode will skip heating mode and enter cooling mode.)

3. FAN button

Press this button and then fan speed can be selected and displayed in the sequence as below:

(low) → (medium) → (high) → (turbo)

(Note:Only low fan speed is available for dry mode. Fan speed can't be adjusted under dry mode. Turbo cannot be set in FAN mode.)

4. FUNCTION button

Under on status, press Function button to switch between timer and auxiliary heating function setting (auxiliary heating can be

set only in heating mode). When timer or auxiliary heating icon is blinking, it means this function can be set. Press "▲" or "▼" button to set function. If there's no operation change within 5s after setting is finished, the function setting will be confirmed. Or press Function button again to exit or confirm the function. When the function is selected through Function button, if the unit is not turned off and no remote control signal is received within 2min, pressing FUNCTION button again to circulate from the previous set function. After 2min or the unit is turned off or remote control signal is received, pressing FUNCTION button again to circulate from timer icon. (Note: Only when the unit is under heating mode and with auxiliary heating function, auxiliary heating function can be turned on or off through FUNCTION button.)

● Under off status, if the unit is in X-FAN status, press Function button to turn off the unit directly; if the unit is not in X-FAN status, press FUNCTION button to set timer ON.

5. ▲ / ▼ button

● After each pressing of "▲" or "▼" button, set temperature will increase or decrease 1°C. Temperature adjustment range is 16°C~30°C. This button is invalid under auto mode. Timer setting can be set in 1h increment among 0~24h. When it is adjusted to auxiliary heating function setting through Function button, press this button to turn on or turn off auxiliary heating. (Note: auxiliary heating is valid only for the model with this function.)

● Hold "▲" and "▼" buttons for 3s and the air conditioner will display "LC", which indicates buttons are locked. Any button under on status or ON/OFF button and function buttons under off status are all invalid. Hold these two button for 3s again to release the lock.

6. / button

● Left and right swing: this button controls the left and right swing motor, single press it to switchover between ON and OFF.

● Up and down swing: this button controls the up and down swing motor, single press it to switchover between ON and OFF.

Set upper and lower limit of temperature

● Under off status, hold "▲" button for 5s to set the upper limit of temperature and then the set upper limit temperature will flash; hold "▲" or " ▼ "button to adjust the upper limit of temperature and then the set upper limit temperature will be displayed for 3s.

● Under off status, hold "▼"button for 5s to set the lower limit of temperature and the set lower limit temperature will flash; hold "▲" or "▼ "button to adjust the lower limit of temperature, and then the set lower.

Note:

1.After setting upper/lower limit temperature, it's valid under cooling, heating, dry and fan modes.

2.The set lower limit temperature should be lower than the set upper limit temperature.

3.Upper temperature limit can be set only after the lower temperature limit has been set; lower temperature limit can be set only after the upper temperature limit has been set.

4.Note:If it needs to enter compulsive defrosting, freon recovery or adjustable memory function, resume the set upper/lower limit temperature to 16ºC-30ºC manually.

This function is only available for some models.

Icon function introduction



Operation display

It indicates the air conditioner is put through the power. Under on status, this indicator is on; under off status, this indicator is off.



Timer display

When this indicator is on, it indicates the timer function is turned on.



Heating display

When this indicator is on, it indicates the heating mode is turned on.



Defrosting display

When this indicator is on, it indicates the defrosting function is turned on.



Dry display

When this indicator is on, it indicates the dry mode is turned on.



E-Heater display

When this indicator is on, it indicates the E-heater function is turned on. (Only available for some heat pump unit)



Cooling display

When this indicator is on, it indicates the cooling mode is turned on.



Fan display

When this indicator is on, it indicates the fan mode is turned on.



Fan speed display

Displays the fan speed. The fan speed is displayed as below:
(low) → (medium) → (high) → (turbo)

6.2 Remote Controller Introduction of YAP1F4(WiFi)


Notice:

1. This is a general use remote controller. It could be used for the air conditioner with multifunction. For the functions which the model doesn't have, if press the corresponding button on the remote controller, the unit will keep the original running status.

2. After putting through the power, the air conditioner will give out a sound. Operation indicator " ⏻ " is ON (red indicator, the colour is different for different models). After that, you can operate the air conditioner by using remote controller.


3. Under on status, pressing the button on the remote controller, the signal icon " ((•)) " on the display of remote controller will blink once and the air conditioner will give out a " di " sound, which means the signal has been sent to the air conditioner.

Buttons on remote controller

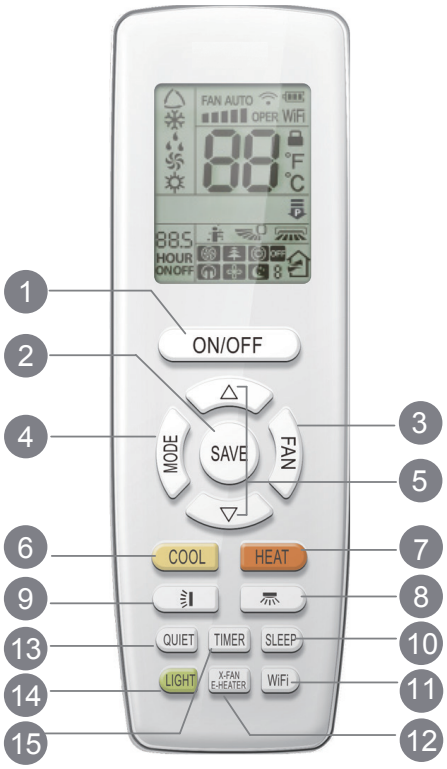

1. ON/OFF button
2. SAVE button
3. FAN button
4. MODE button
5. ▲/ ▼ button
6. COOL button
7. HEAT button
8. button
9. button
10. SLEEP button
11. WiFi button
12. X-FAN/E-HEATER button
13. QUIET button
14. LIGHT button
15. TIMER button

Introduction for icons on display screen

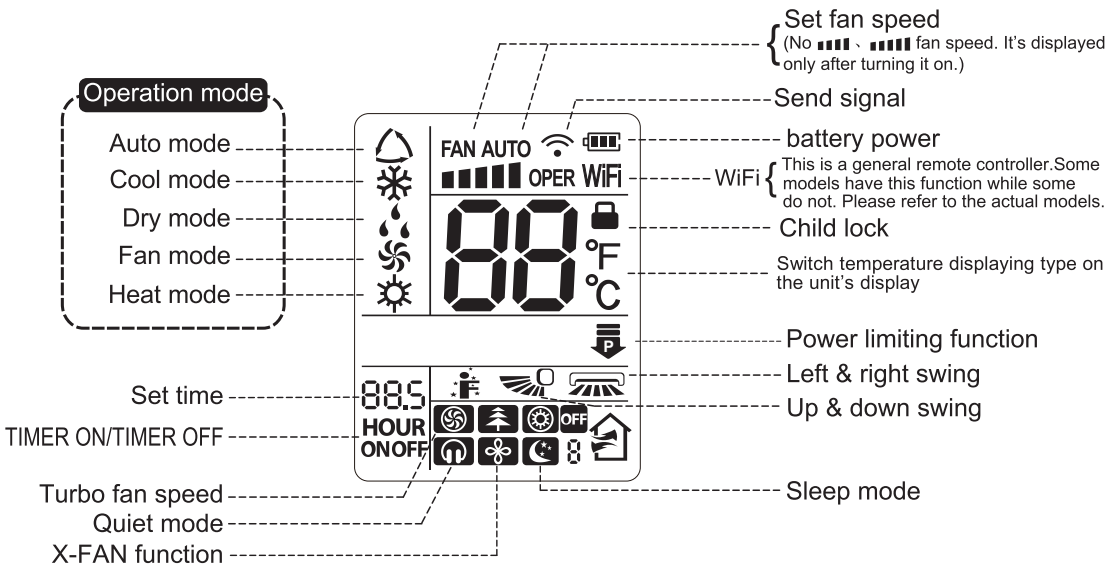

1. ON/OFF button

Press this button to turn on the unit ,Press this bntton again to turn off the unit.

2. SAVE button

Under cooling mode, press this button to start up or turn off energy-saving function. When energy-saving function is started up, "SE" will be shown on remote controller, and air conditioner will adjust the set temperature automatically according to ex-factory setting to reach to the best energy-saving effect. Press this button again to exit energy-saving function.

3. FAN button

Pressing this button can set fan speed circularly as: auto (AUTO), low( ), medium( ), high( ), turbo( ).



Note:


● Under AUTO speed, air conditioner will select proper fan speed automatically according to ex-factory setting.

● It's Low fan speed under Dry mode.

● Turbo cannot be set in FAN mode.

4. MODE button

Press this button to select your required operation mode.



● When selecting auto mode, air conditioner will operate automatically according to the sensed temperature. Set temperature can't be adjusted and will not be displayed as well. Press "FAN" button can adjust fan speed. Press " " / " " button can adjust fan blowing angle.

● After selecting cool mode, air conditioner will operate under cool mode. Cool indicator " " on indoor unit is ON. Press "▲" or " ▼ " button to adjust set temperature. Press "FAN" button to adjust fan speed. Press " " / " " button to adjust fan blowing angle.

● When selecting dry mode, the air conditioner operates at low speed under dry mode. Dry indicator " " on indoor unit is ON. Under dry mode, fan speed can't be adjusted. Press " " / " " button to adjust fan blowing angle.

● When selecting fan mode, the air conditioner will only blow fan, no cooling and no heating. Fan indicator " " on indoor unit is ON.

Press "FAN" button to adjust fan speed. Press " " / " " button to adjust fan blowing angle.

● When selecting heating mode, the air conditioner operates under heat mode. Heat indicator " " on indoor unit is ON. Press "▲" or " ▼ " button to adjust set temperature. Press "FAN" button to adjust fan speed. Press " " / " " button to adjust fan blowing angle. (Cooling only unit won't receive heating mode signal. If setting heat mode with remote controller, press ON/OFF button can't start up the unit).

Note:

● For preventing cold air, after starting up heating mode, indoor unit will delay 1~5 minutes to blow air (actual delay time is depend on indoorambient temperature).

● Set temperature range from remote controller: 16~30°C (61~86°F); Fan speed: auto, low speed, medium speed, high speed, turbo speed.

5. ▲/ ▼ button

● Press "▲" or " ▼ " button once increase or decrease set temperature 1°C (°F). Holding "▲" or " ▼ " button, 2s later, set temperature on remote controller will change quickly. On releasing button after setting is finished, temperature indicator on indoor unit will change accordingly. (Temperature can't be adjusted under auto mode.)

● When setting TIMER ON, TIMER OFF, press "▲" or " ▼ " button to adjust time. (Refer to TIMER button for details.)

6. Heat button

● Press this button, unit will operate in heat mode.

7. Cool button


● Press this button, unit will operate in cool mode.

8. button

● Under simple swing mode, press this button can turn on (" " icon is displayed) or turn off (" " icon is not displayed) the left & right swing function.

● When the unit is turned off by remote controller, press "▲" button and " " button can switch between single swing mode and fixed-angle swing mode. " " on the remote controller will flash twice.

Under fixed-angle swing mode, press this button and then left & right swing status will circulate as shown in the right figure:




● This remote controller is the general type remote controller. When remote controller receives the signal of " " , swing status is same as " " ; when remote controller receives " ", swing status is same as left&right swing OFF.

9. button

● Under simple swing mode, press this button can turn on (" " icon is displayed) or turn off (" " icon is not displayed)

the up&down swing function.

● When the unit is turned off by remote controller, press "▲" button and " " button can switch between single swing mode and fixed-angle swing mode. " " on the remote controller will flash twice. Under fixed-angle swing mode, press this button and the up & down swing status will circulate as shown in the right figure:



10. SLEEP button

Under COOL, or HEAT mode, press this button to start up sleep function." " icon is displayed on remote controller. Press this button again to cancel sleep function and " " icon will disappear.After powered on, Sleep Off is defaulted. After the unit is turned off, the Sleep function is canceled.

In this mode, the time of time can be adjusted. Under Fan, DRY and Auto models, this function is not available.

11. WiFi button

Press " WiFi " button to turn on WiFi function, "WiFi " icon will be displayed on the remote controller;

Hold " WiFi " button for 5s to turn off WiFi function and " WiFi " icon will disappear.

Under off status, press "MODE" and " WiFi " buttons simultaneously for 1s, WiFi module will restore factory settings.

● This function is only available for some models.

12. X-FAN/E-HEATER button (only for the mode with this function)


Pressing this button in COOL or DRY mode, the icon " " is displayed and the indoor fan will continue operation for a few minutes in order to dry the indoor unit even though you have turned off the unit. After energization, X-FAN OFF is defaulted. X-FAN is not available in AUTO, FAN or HEAT mode. This function indicates that moisture on evaporator of indoor unit will be blowed after the unit is stopped to avoid mould.

● Having set X-FAN function on: After turning off the unit by pressing ON/OFF button indoor fan will continue running for about a few minutes at low speed. In this period, press X-FAN button to stop indoor fan directly.

● Having set X-FAN function off: After turning off the unit by pressing ON/OFF button, the complete unit will be off directly.

● Only under cooling mode and dry mode, press this button can turn on (characters of “X-FAN” are displayed) or turn off (characters of “X-FAN” are not displayed) X-FAN function.

● Under heating mode, press this button and the E-HEATER status will changed circularly as below:



13. QUIET button

Press this button can turn on or turn off QUIET function.

● This function is not available for this unit.

14. LIGHT button

Press this button to turn off display light on indoor unit. Press this button again to turn on display light.

15. TIMER button

At ON status, press this button once can set TIMER OFF. The character of HOUR and OFF will flash. Press "▲" or " ▼ " botton within 5s can adjust the time of TIMER ON. After each pressing of "▲" or " ▼ " button, time will increase or decrease half an hour. When holding "▲" or " ▼ " button, 2s later, the time will change quickly until to reach to your required time. After that, press "TIMER" button to confirm it. The character of HOUR and OFF won't flash again.

Cancel TIMER OFF: Press "TIMER" button again under TIMER OFF status.

● At OFF status, press this button once can set TIMER ON. Please refer to TIMER off for detailed operation. Cancel TIMER ON: Press "TIMER" button again under TIMER ON status.

Note:

● Time setting range: 0.5-24 hours.

● Time interval between two operations can’t exceed 5s. Otherwise, remote controller will exit the setting status automatically.

Function introduction for combination buttons

Child lock function

Press "▲" or " ▼ " simultaneously to turn on or turn off child lock function. When child lock function is on, " " icon is displayed on remote controller. If you operate the remote controller, the " " icon will blink three times without sending signal to the unit.

Temperature display switchover function

Under OFF status, press " ▼ " and "MODE" buttons simultaneously to switch temperature display between °C and °F.

If “H1” is displayed on the remote controller while it’s not operated by the professional person/after-sales person,

it belongs to the misoperation. Please operate it as below to cancel it.Under the OFF status of remote controller,

hold the “MODE” button and “X-FAN” buttons simultaneously for 5s to cancel “H1” display.

Note:

● If remote controller displays “H1”, it belongs to the normal

function reminder. If the unit is defrosting under heating mode,

it operates according to H1 defrosting mode. “H1” won’t be displayed on the panel of indoor unit;

● Once you set H1 mode, if you turn off unit by remote controller, H1 will display 3 times on the remote controller and then disappear;

● Also, when you set H1 mode, when you change to heating mode, H1 will display 3 times on the remote controller and then disappear.

Auto clean function

Under unit off status, hold "MODE" and "FAN" buttons simultaneously for 5s to turn on or turn off the auto clean function. When the auto clean function is turned on, indoor unit displays "CL" . During the auto clean process of evaporator, the unit will perform fast cooling or fast heating. There may be some noise, which is the sound of flowing liquid or thermal expansion or cold shrinkage. The air conditioner may blow cool or warm air, which is a normal phenomenon. During cleaning process, please make sure the room is well ventilated to avoid affecting the comfort.

Note:

● The auto clean function can only work under normal ambient temperature. If the room is dusty, clean it once a month; if not, clean it once every three months. After the auto clean function is turned on, you can leave the room. When auto clean is finished,the air conditioner will enter standby status.

● This function is only available for some models.

Replacement of batteries in remote controller

1. Lift the cover along the direction of arrow (as shown in Fig 1①).

2. Take out the original batteries (as shown in Fig 1②).

3. Place two 7# (AAA 1.5V) dry batteries, and make sure the position of “+” polar and “-” polar is correct (as shown in Fig 2③).

4. Reinstall the cover (as shown in Fig 2④).




Fig 1




Fig 2

NOTICE

● During operation, point the remote control signal sender at the receiving window on indoor unit.

● The distance between signal sender and receiving window should be no more than 8m, and there should be no obstacles between them.

● Signal may be interfered easily in the room where there is fluorescent lamp or wireless telephone; remote controller should be close to indoor unit during operation.


● Replace new batteries of the same model when replacement is required.

● When you don’t use remote controller for a long time, please take out the batteries.

● If the display on remote controller is fuzzy or there’s no display, please replace batteries.


6.3 Remote Controller Introduction of YAP1F11

Buttons on remote controller

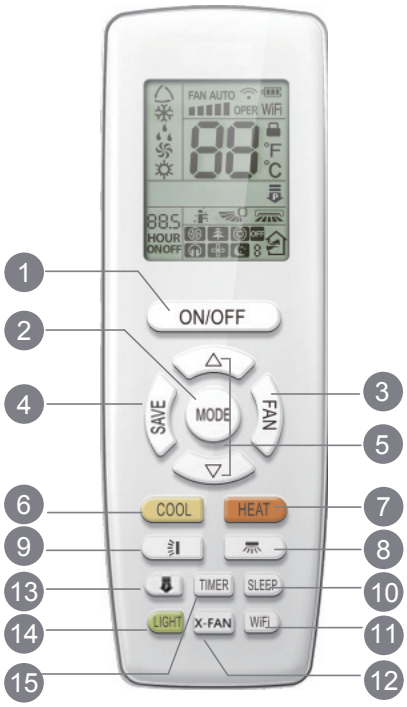

1. ON/OFF button
2. MODE button
3. FAN button
4. SAVE button
5. ▲/ ▼ button
6. COOL button
7. HEAT button
8. button
9. button
10. SLEEP button
11. WiFi button
12. X-FAN button
13. button
14. LIGHT button
15. TIMER button

Introduction for icons on display screen

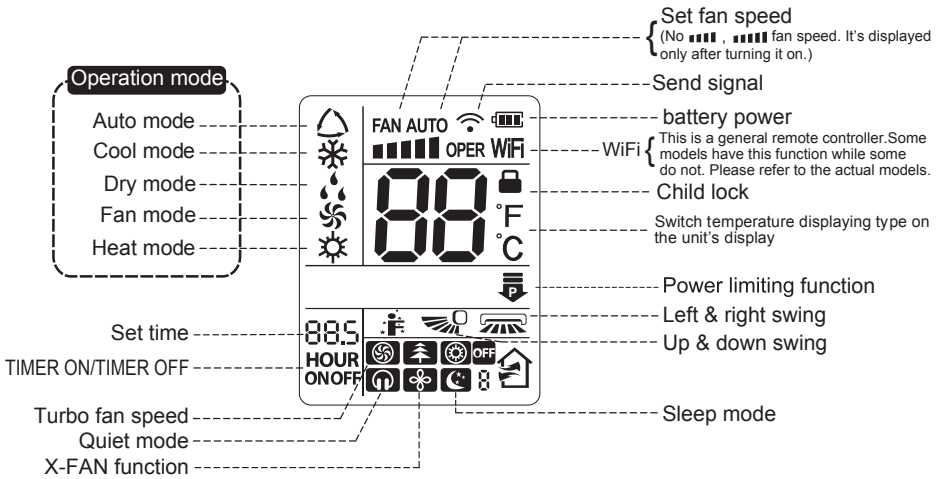

Introduction for buttons on remote controller

NOTE:

● This is a general use remote controller, it could be used for the air conditioners with multifunction; For some function, which the model doesn't have, if press the corresponding button on the remote controller that the unit will keep the original running status.

● After putting through the power, the air conditioner will give out a sound. Operation indicator " ⏻ " is ON . After that, you can operate the air conditioner by using remote controller.

● Under on status, pressing the button on the remote controller, the signal icon " " on the display of remote controller will blink once and the air conditioner will give out a “di” sound, which means the signal has been sent to the air conditioner.

1. ON/OFF button

Press this button can turn on or turn off the air conditioner. After turning on the air conditioner, indoor unit will give out a sound.

2. MODE button

Press this button to select your required operation mode.



When selecting auto mode, air conditioner will operate automatically according to the sensed temperature. Set temperature can't be adjusted and will not be displayed as well. Press "FAN" button can adjust fan speed. Press " " / " " button can adjust fan blowing angle.

● After selecting cool mode, air conditioner will operate under cool mode. Cool indicator " " on indoor unit is ON (This indicator is not available for some models). Press "▲" or "▼" button to adjust set temperature. Press "FAN" button to adjust fan speed. Press " " / " " button to adjust fan blowing angle.

● When selecting dry mode, the air conditioner operates at low speed under dry mode. Dry indicator " " on indoor unit is ON(This indicator is not available for some models). Under dry mode, fan speed can't be adjusted. Press " " / " " button to adjust fan blowing angle.

● When selecting fan mode, the air conditioner will only blow fan, no cooling and no heating. Fan indicator " " on indoor unit is ON. Press "FAN" button to adjust fan speed. Press " " / " " button to adjust fan blowing angle.

● When selecting heating mode, the air conditioner operates under heat mode. Heat indicator " " on indoor unit is ON(This indicator is not available for some models). Press "▲" or "▼" button to adjust set temperature. Press "FAN" button to adjust fan speed. Press " " / " " button to adjust fan blowing angle. (Cooling only unit won't receive heating mode signal. If setting heat mode with remote controller, press ON/OFF button can't start up the unit).

NOTE:

● For preventing cold air, after starting up heating mode, indoor unit will delay 1~5 minutes to blow air (actual delay time is depend on indoor ambient temperature).

● Set temperature range from remote controller: 16~30°C (61~86°F); Fan speed: auto, quiet speed, low speed, medium speed, high speed, turbo speed.

3. FAN button

Pressing this button can set fan speed circularly as: auto (AUTO), QUIET( ), low( ), medium( ), high( ), turbo( ).



● Under AUTO speed, air conditioner will select proper fan speed automatically according to ex-factory setting.

● It's Low fan speed under Dry mode.

● Turbo cannot be set in FAN mode.

4. SAVE button

Under cooling mode, press this button to start up or turn off energy-saving function. When energy-saving function is started up, "SE" will be shown on remote controller, and air conditioner will adjust the set temperature automatically according to ex-factory setting to reach to the best energy-saving effect. Press this button again to exit energy-saving function.

5. ▲ / ▼ button

● Press "▲" or "▼" button once increase or decrease set temperature 1°C (°F). Holding "▲" or "▼" button, 2s later, set temperature on remote controller will change quickly. On releasing button after setting is finished, temperature indicator on indoor unit will change accordingly. (Temperature can't be adjusted under auto mode)

● When setting TIMER ON, TIMER OFF, press "▲" or "▼" button to adjust time. (Refer to TIMER button for details)

6. COOL button

● Press this button, unit will operate in cool mode.


7. HEAT button

● Press this button, unit will operate in heat mode.

8. button

● Under simple swing mode, press this button can turn on (" " icon is displayed) or turn off (" " icon is not displayed) the left & right swing function.

● When the unit is turned off by remote controller, press "▲" button and " " button can switch between single swing mode and fixed-angle swing mode. " " on the remote controller will flash twice. Under fixed-angle swing mode, press this button and then left&right swing status will circulate as shown in the right figure:




● This remote controller is the general type remote controller. When remote controller receives the signal of " " , swing status is same as " " ; when remote controller receives " ", swing status is same as left & right swing OFF.

9. button

● Under simple swing mode, press this button can turn on (" " icon is displayed) or turn off (" " icon is not displayed) the up & down swing function.

● When the unit is turned off by remote controller, press "▲" button and " " button can switch between single swing mode and fixed-angle swing mode. " " on the remote controller will flash twice. Under fixed-angle swing mode, press this button and the up & down swing status will circulate as shown in the right figure:



10. SLEEP button

Under COOL or HEAT mode, press this button to start up sleep function. " " icon is displayed on remote controller. Press this button again to cancel sleep function and " " icon will disappear. After powered on, Sleep Off is defaulted. After the unit is turned off, the Sleep function is canceled. In this mode, set temperature will be adjusted with the change of time. Under Fan, DRY and Auto modes, this function is not available.

11. WiFi button

Press "WiFi" button to turn on WiFi function, "WiFi" icon will be displayed on the remote controller; Hold "WiFi" button for 5s to turn off WiFi function and "WiFi" icon will disappear. Under off status, press "MODE" and "WiFi" buttons simultaneously for 1s, WiFi module will restore factory settings.

● This function is only available for some models.

12. X-FAN button

Pressing this button in COOL or DRY mode, the icon " " is displayed and the indoor fan will continue operation for a few minutes in order to dry the indoor unit even though you have turned off the unit. After energization, X-FAN OFF is defaulted. X-FAN is not available in AUTO, FAN or HEAT mode. This function indicates that moisture on evaporator of indoor unit will be blowed after the unit is stopped to avoid mould.

● Having set X-FAN function on: After turning off the unit by pressing ON/OFF button indoor fan will continue running for about a few minutes. at low speed. In this period, press X-FAN button to stop indoor fan directly.

● Having set X-FAN function off: After turning off the unit by pressing ON/OFF button, the complete unit will be off directly.

● Only under cooling mode and dry mode, press this button can turn on (characters of “X-FAN” are displayed) or turn off (characters of “X-FAN” are not displayed) X-FAN function.

13. button

function is for limiting power of the whole unit. Press this button, the controller will cercularly display as the following:



● Maximum power limited under the mode is lower than that of mode.

● If you want to cancel the power limiting function, press the button till the icon in remote controller is not displayed.

● When the remote controller is turned off, power limiting function is cancelled. If you want to activate the function, please repress this button.

● If the current power is lower than the maximum power of mode, then the power will not be limited after entering into such mode.

● For the model with one outdoor unit and two indoor units, if any one of indoor units enters into power limiting function, the outdoor unit will enter into the set limiting power mode of indoor unit; when two indoor units enter into power limiting mode, then the power of outdoor unit will be limited according to the lower power of the two indoor units.

NOTE:

● This function is only available for some models.

14. LIGHT button

Press this button to turn off display light on indoor unit. Press this button again to turn on display light.

15. TIMER button

● At ON status, press this button once can set TIMER OFF. The character of HOUR and OFF will flash. Press "▲" or "▼" button within 5s can adjust the time of TIMER ON. After each pressing of "▲" or "▼" button time will increase or decrease half an hour. When holding "▲" or "▼" button, 2s later, the time will change quickly until to reach to your required time. After that, press "TIMER" button to confirm it. The character of HOUR and OFF won't flash again. Cancel TIMER OFF: Press "TIMER" button again under TIMER OFF status.

● At OFF status, press this button once can set TIMER ON. Please refer to TIMER off for detailed operation.

Cancel TIMER ON: Press "TIMER" button again under TIMER ON status.

NOTE:

● Time setting range: 0.5-24 hours.

● Time interval between two operations can’t exceed 5s. Otherwise, remote controller will exit the setting status automatically.

Function introduction for combination buttons

Child lock function

Press "▲" and "▼" simultaneously to turn on or turn off child lock function. When child lock function is on, " " icon is displayed on remote controller. If you operate the remote controller, the " " icon will blink three times without sending signal to the unit.

Temperature display switchover function

Under OFF status, press "▼" and "MODE" buttons simultaneously to switch temperature display between °C and °F.

Auto clean function

Under unit off status, hold "MODE" and "FAN" buttons simultaneously for 5s to turn on or turn off the auto clean function. When the auto clean function is turned on, indoor unit displays "CL" . During the auto clean process of evaporator, the unit will perform fast cooling or fast heating. There may be some noise, which is the sound of flowing liquid or thermal expansion or cold shrinkage. The air conditioner may blow cool or warm air, which is a normal phenomenon. During cleaning process, please make sure the room is well ventilated to avoid affecting the comfort.

Note:

● The auto clean function can only work under normal ambient temperature. If the room is dusty, clean it once a month; if not, clean it once every three months. After the auto clean function is turned on, you can leave the room. When auto clean is finished,the air conditioner will enter standby status.

● This function is only available for some models.

Replacement of batteries in remote controller

1. Lift the cover along the direction of arrow (as shown in Fig 1①).

2. Take out the original batteries (as shown in Fig 1 ②).

3. Place two 7# (AAA 1.5V) dry batteries, and make sure the position of " + " polar and " - " polar is correct (as shown in Fig 2 ③).

4. Reinstall the cover (as shown in Fig 2 ④).




Fig.1




Fig.2

NOTICE:

● During operation, point the remote control signal sender at the receiving window on indoor unit.

● The distance between signal sender and receiving window should be no more than 8m, and there should be no obstacles between them.

● Signal may be interfered easily in the room where there is fluorescent lamp or wireless telephone; remote controller should be close to indoor unit during operation.

● Replace new batteries of the same model when replacement is required.

● When you don't use remote controller for a long time, please take out the batteries.

● If the display on remote controller is fuzzy or there's no display, please replace batteries.

6.4 Remote Controller Introduction of YBE1FB8

Buttons on remote controller



	Quiet
FAN AUTO	Set fan speed
	Turbo mode
	Send signal
Operation mode	Auto mode
	Cool mode
	Dry mode
	Fan mode
	Heat mode
	Set temperature
	Indoor ambient temp.
	Power limiting operation
ONOFF	TIMER ON / TIMER OFF
	Set time
	Left & right swing
	Up & down swing
	Child lock
	Air function
	X-FAN function
	Health function
WIFI	WiFi function
	LED
	I feel
	Sleep mode
	Fast cool

Introduction for buttons on remote controller

NOTE:

●This is a general use remote controller. It could be used for the air conditioner with multifunction. For the functions which the model doesn't have, if press the corresponding button on the remote controller, the unit will keep the original running status.

● After putting through the power, the air conditioner will give out a sound. Operation indicator " ⏻ " is ON . After that, you can operate the air conditioner by using remote controller.

● Under on status, pressing the button on the remote controller, the signal icon " " on the display of remote controller will blink once and the air conditioner will give out a “di” sound, which means the signal has been sent to the air conditioner.

ON/OFF button

Press this button to turn on the unit. Press this button again to turn off the unit.

MODE button

Press this button to select your required operation mode.

AUTO → COOL → DRY → FAN → HEAT

● When selecting auto mode, air conditioner will operate automatically according to the sensed temperature. Set temperature can't be adjusted and will not be displayed as well. Press "Fan" button can adjust fan speed. Press " / " button can adjust fan blowing angle.

● After selecting cool mode, air conditioner will operate under cool mode. Press " + " or " - " button to adjust set temperature. Press "Fan" button to adjust fan speed. Press " / " button to adjust fan blowing angle.

● When selecting dry mode, the air conditioner operates at low speed under dry mode. Under dry mode, fan speed can't be adjusted. Press " / " button to adjust fan blowing angle.

When selecting fan mode, the air conditioner will only blow fan, no cooling and no heating. Press "Fan" button to adjust fan speed. Press " / " button to adjust fan blowing angle.

NOTE:

● For preventing cold air, after starting up heat mode,indoor unit will delay 1~5 minutes to blow air (Actual delay time depends on indoor ambient temperature).

● Set temperature range from remote controller:16~30°C(61-86°F).

● This mode indicator is not available for some models.

● Cooling only unit won't receive heat mode signal. If setting heat mode with remote controller, press " On/Off " button can't start up the unit.

Fan button

This button is used for setting Fan Speed in the sequence that goes from AUTO , , , , to ,then back to Auto.



Quiet speed Low speed Medium speed
High speed Turbo speed

NOTE:

● It's low fan speed under dry mode.

● X-FAN function Hold fan speed button for 2s in cool or dry mode, the icon " " is displayed and the indoor fan will continue operation for a few minutes in order to dry the indoor unit even though you have turned off the unit. After energization, X-FAN OFF is defaulted. X-FAN is not available in auto, fan or heat mode.

This function indicates that moisture on evaporator of indoor unit will be blowed after the unit is stopped to avoid mould.

● Having set X-FAN function on: After turning off the unit by pressing " On/Off " button indoor fan will continue running for a few minutes. at low speed. In this period, Hold fan speed button for 2s to stop indoor fan directly.

● Having set X-FAN function off: After turning off the unit by pressing " On/Off " button, the complete unit will be off directly.

+ / - button

Press " + " or " - " button once increase or decrease set temperature 1°C(°F). Holding " + " or " - " button, 2s later, set temperature on remote controller will change quickly. On releasing button after setting is finished, temperature indicator on indoor unit will change accordingly.

Wifi button

Press "Wifi" button to turn on WiFi function, "Wifi"icon will be displayed on the remote controller; Hold "Wifi" button for 5s to turn off WiFi function and "Wifi" icon will disappear.

Under off status, press "Mode" and "Wifi" buttons simultaneously for 1s, WiFi module will restore factory settings.

NOTE

● This function is only available for some models.

Health button

Press this button to turn on or turn off the health and air functions in operation status. Press this button for the first time to start air function; LCD displays " ". Press the button for the second time to start health and air functions simultaneously; LCD displays " " and " ". Press this button for the third time to quit health and air functions simultaneously. Press the button for the fourth time to start health function; LCD display " ". Press this button again to repeat the operation above.


NOTE

● This function is only available for some models.

UD-swing button

Press this button can select up & down swing angle.

Fan blow angle can be selected circularly as below:



● When selecting " ", air conditioner is blowing fan automatically. Horizontal louver will automatically swing up & down at maximum angle.

● When selecting " " , a ir conditioner is blowing fan at fixed position. Horizontal louver will stop at the fixed position.

● Hold " " button above 2s to set your required swing angle. When reaching your required angle, release the button.

NOTE

Press this button continuously more than 2s, the main unit will swing back and forth from up to down, and then loosen the button, the unit will stop swinging and present position of guide louver will be kept immediately.

Under swing up and down mode, when the status is switched from off to , if press this button again 2s later, status will switch to off status directly; if press this button again within 2s, the change of swing status will also depend on the circulation sequence stated above.

Button

function is for limiting power of the whole unit.

Press this button, the remote controller will circularlym display as the following:



● Maximum power limited under the mode is lower than that of mode.

● If you want to cancel the power limiting function, press "Mode" and "Sleep" buttons simultaneously till the icon in remote controller is not displayed.

● When the remote controller is turned off, power limiting function is cancelled. If you want to activate the function, please repress "Mode" and "Sleep" buttons simultaneously.

● If the current power is lower than the maximum power of mode, then the power will not be limited after entering into such mode.

● For the model with one outdoor unit and two indoor units, if any one of indoor units enters into power limiting function, the outdoor unit will enter into the set limiting power mode of indoor unit; when two indoor units enter into power limiting mode, then the power of outdoor unit will be limited according to the lower power of the two indoor units.


NOTE

● This button is only available for the model with such function.

LR-swing button:

Press this button can select left & right swing angle.

Fan blow angle can be selected circularly as below:



NOTE

● Press this button continuously more than 2s, the main unit will swing back and forth from left to right, and then loosen the button, the unit will stop swinging and present position of guide louver will be kept immediately.

● Under swing left and right mode, when the status is switched from off to , if press this button again 2s later, status will switch to off status directly; if press this button again within 2s, the change of swing status will also depend on the circulation sequence stated above.

● This function only applicable for some models.

Timer button

● At ON status, press this button once can set TIMER OFF. The character of HOUR and OFF will flash. Press "+" or "-" button within 5s can adjust the time of TIMER OFF. After each pressing of "+" or "-" button, time will increase or decrease half an hour. When holding "+" or "-" button, 2s later, the time will change quickly until to reach to your required time. After that, press "Timer" button to confirm it. The character of HOUR and OFF won't flash again.

Cancel TIMER OFF: Press "Timer" button again under TIMER OFF status.

● At OFF status, press this button once can set TIMER ON. Please refer to TIMER off for detailed operation.

Cancel TIMER ON: Press "Timer" button again under TIMER ON status.

NOTE

● Time setting range: 0.5-24 hours.

● Time interval between two operations can't exceed 5s.


Otherwise, remote controller will exit the setting status automatically.

Sleep button

Under Cool or Heat mode, press this button to turn on Sleep function. Press this button again to cancel Sleep function. Under Fan, Auto and Dry modes, this function is unavailable.

Light button

Press this button to control the LED status on the displayer, the circulation change is as follow:



Function introduction for combination buttons

Energy-saving function

Under cooling mode, press "Mode" and "Timer" buttons simultaneously to start up or turn off energy-saving function. When energy-saving function is started up, "SE" will be shown on remote controller, and air conditioner will adjust the set temperature automatically according to ex-factory setting to reach to the best energy-saving effect.

Press "Mode" and "Timer" buttons simultaneously again to exit energy-saving function.

NOTE

Under energy-saving function, fan speed is defaulted at auto speed and it can't be adjusted.

Under energy-saving function, set temperature can't be adjusted.

Sleep function and energy-saving function can't operate at the same time. If energy-saving function has been set under cool mode, press "Sleep" button will cancel energy-saving function. If sleep function has been set under cool mode, start up the energy-saving function will cancel sleep function.

8°C heating function

Under heat mode, press "Mode" and "Timer" buttons simultaneously to start up or turn off 8°C heating function. When this function is started up, " " and "8°C" will be shown on remote controller, and the air conditioner keep the heating status at 8°C.

Press "Mode" and "Timer" buttons simultaneously again to exit 8°C heating function.

NOTE

● Under 8°C heating function, fan speed is defaulted at auto speed and it can't be adjusted.

● Under 8°C heating function, set temperature can't be adjusted.

● Sleep function and 8°C heating function can't operate at the same time. If 8°C heating function has been set under heat mode, press " " button will cancel 8°C heating function. If sleep function has been set under heat mode, start up the 8°C heating function will cancel sleep function.

● Under °F temperature display, the remote controller will display 46°F heating.

Child lock function


Hold " On/Off " and " - " buttons simultaneously for 3s to turn on or turn off child lock function. When child lock function is on, " " icon is displayed on remote controller. If you operate the remote controller, the " " icon will blink three times without sending signal to the unit.

Temperature display switchover function

Under OFF status, hold "Mode" and " - " buttons simultaneously for 3s to switch temperature displaybetween °C and °F.

Indoor ambient temperature

By holding " On/Off " and " " buttons simultaneously , you can see indoor ambient temperature on indoor unit's display. The setting on remote controller is selected circularly as below:



● When selecting " " with remote controller, temperature indicator on indoor unit displays indoor ambient temperature.

Clean reminder function of filter

The reminder function is defaulted to be OFF. Hold " On/Off " and " " buttons simultaneously for 5s to turn it on. The buzzer will give out sound for 0.5s and the dual-8 nixie tube on the display will be on for 3s; Once the reminder function is turned on, when the air conditioner has reached to the set time, the dual-8 nixie tube will flash about 30s when the unit is turned on each time to remind the

user to clean the filter; you can turn off this cycle reminder by holding " On/Off " and " " buttons simultaneously for 5s and then the air conditioner will count time again.

NOTE

● Once the reminder function is turned on, only this cycle reminder can be cleared.

● This function is only available for some models.

Auto clean function

Under unit off status, hold "Mode" and " "buttons simultaneously for 5s to turn on or turn off the auto clean function. When the auto clean function is turned on, indoor unit displays "CL" . During the auto clean process of evaporator, the unit will perform fast cooling or fast heating.There may be some noise, which is the sound of flowing liquid or thermal expansion or cold shrinkage. The air conditioner may blow cool or warm air, which is a normal phenomenon. During cleaning process, please make sure the room is well ventilated to avoid affecting the comfort.

NOTE

● The auto clean function can only work under normal ambient temperature. If the room is dusty, clean it once a month; if not, clean it once every three months. After the auto clean function is turned on, you can leave the room. When auto clean is finished, the air conditioner will enter standby status.

● This function is only available for some models.

Night mode

Under cooling or heating mode, when turning on sleep mode and turn to low speed or quiet notch, the outdoor unit would enter into night mode.

NOTE

● When you feel that the cooling and heating effect is poor, please press "Fan" button to other fan speed or press "Sleep" button to exit the night mode.

● The night mode can only work under normal ambient temperature.

● This function is only available for some models.


I FEEL function

Press "Health" and " + " buttons simultaneously to start I FEEL function and " " will be displayed on the remote controller. After this function is set, the remote controller will send the detected ambient

temperature to the controller and the unit will automatically adjust the indoor temperature according to the detected temperature. Press "Health" and " + " buttons simultaneously again to turn off I FEEL function and " " will disappear.

● Please put the remote controller near user when this function is set. Do not put the remote controller near the object of high temperature or low temperature in order to avoid detecting inaccurate ambient temperature.When I FEEL function is turned on, the remote controller should be put within the area where indoor unit can receive the signal sent by the remote controller.

Replacement of batteries in remote controller

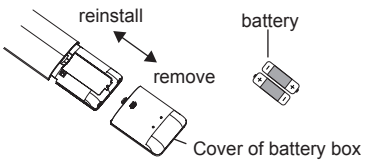

1. Press the back side of remote controller marked with " ", as shown in the fig, and then push out the cover of battery box along the arrow direction.

2. Replace two 7# (AAA 1.5V) dry batteries, and make sure the position of "+" polar and "-" polar are correct.

3. Reinstall the cover of battery box.

NOTICE

● During operation, point the remote control signal sender at the receiving window on indoor unit.

● The distance between signal sender and receiving window should be no more than 8m, and there should be no obstacles

between them.

● Signal may be interfered easily in the room where there is fluorescent lamp or wireless telephone; remote controller should be close to indoor unit during operation.


● Replace new batteries of the same model when replacement is required.

● When you don't use remote controller for a long time, please take out the batteries.

● If the display on remote controller is fuzzy or there's no display, please replace batteries.

6.5 GREE+ App Operation Manual

Control Flow Chart

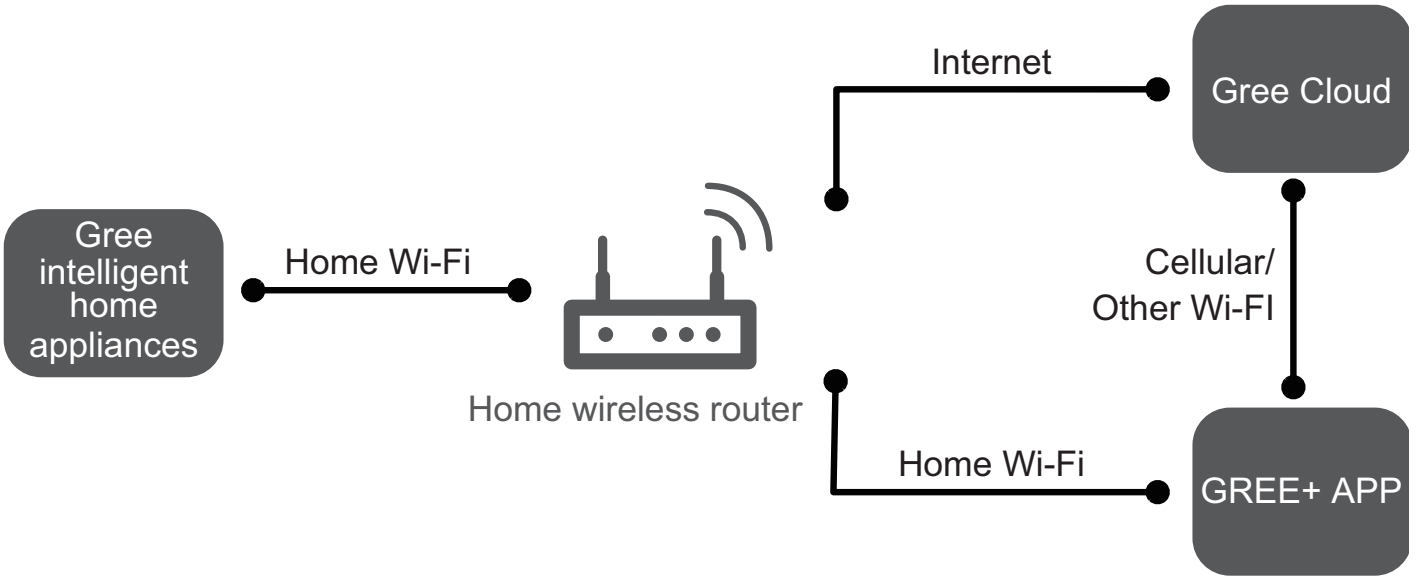

Operating Systems

Requirement for User's smart phone:

iOS system
Support iOS7.0 and above version

Android system
Support Android 4.4 and above version


Download and installation

GREE+ App Download Linkage

Scan the QR code or search "GREE+" in the application market to download and install it. When "GREE+" App is installed, register the account and add the device to achieve long-distance control and LAN control of Gree smart home appliances.
For more information, please refer to "Help" in App.

6.6 Ewpe Smart App Operation Manual

Control Flow Chart

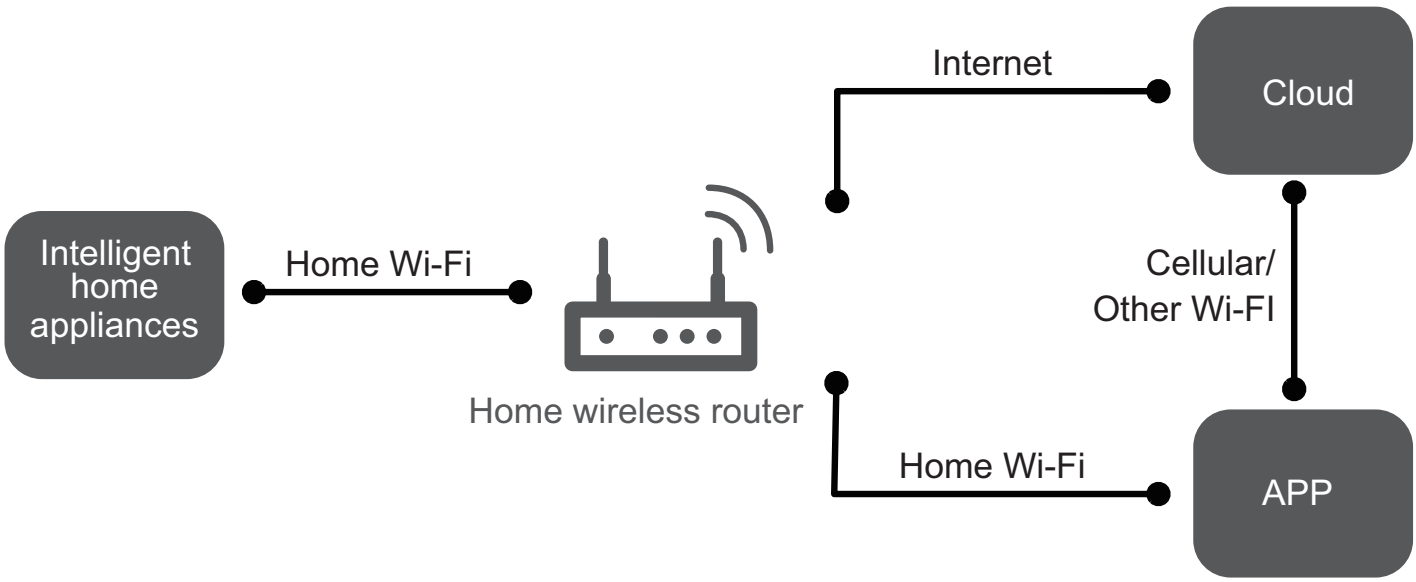

Operating Systems

Requirement for User's smart phone:

iOS system
Support iOS7.0 and above version

Android system
Support Android 4.4 and above version

Download and installation

App Download Linkage

Scan the QR code or search "Ewpe Smart" in the application market to download and install it. When "Ewpe Smart" App is installed, register the account and add the device to achieve long-distance control and LAN control of smart home appliances.
For more information, please refer to "Help" in App.

6.7 Description of Each Control Operation

● Indoor Unit

1.Basic function of system

(1)Cooling mode

(1) Under this mode, fan and swing operates at setting status. Temperature setting range is 16~30^{O}C.

(2) During malfunction of outdoor unit or the unit is stopped because of protection, indoor unit keeps original operation status.

(2)Drying mode

(1) Under this mode, fan operates at low speed and swing operates at setting status. Temperature setting range is 16~30^{O}C.

(2) During malfunction of outdoor unit or the unit is stopped because of protection, indoor unit keeps original operation status.

(3) Protection status is same as that under cooling mode.

(4) Sleep function is not available for drying mode.

(3)Heating mode

(1) Under this mode, Temperature setting range is 16~30^{O}C.

(2) Working condition and process for heating mode:

When turn on the unit under heating mode, indoor unit enters into cold air prevention status. When the unit is stopped or at OFF status, and indoor unit has been started up just now, the unit enters into residual heat-blowing status.

(4)Working method for AUTO mode:

1.Working condition and process for AUTO mode:

a.Under AUTO mode, standard heating Tpreset=20^{O}C and standard cooling Tpreset=25^{O}C. The unit will switch mode automatically according to ambient temperature.

2.Protection function

a. During cooling operation, protection function is same as that under cooling mode.

b. During heating operation, protection function is same as that under heating mode.

3. Display: Set temperature is the set value under each condition. Ambient temperature is (Tamb.-Tcompensation) for heat pump unit and Tamb. for cooling only unit.

4. If theres I feel function, Tcompensation is 0. Others are same as above.

(5)Fan mode

Under this mode, indoor fan operates at set fan speed. Compressor, outdoor fan, 4-way valve and electric heating tube stop operation. Indoor fan can select to operate at high, medium, low or auto fan speed. Temperature setting range is 16~30^{O}C.

2. Other control

(1) Buzzer

Upon energization or availably operating the unit or remote controller, the buzzer will give out a beep.

(2) Auto button

If press this auto button when turning off the unit, the complete unit will operate at auto mode. Indoor fan operates at auto fan speed and swing function is turned on. Press this auto button at ON status to turn off the unit.

(3) Auto fan

Heating mode: During auto heating mode or normal heating ode, auto fan speed will adjust the fan speed automatically according to ambient temperature and set temperature.

(4) Sleep

After setting sleep function for a period of time, system will adjust set temperature automatically.

(5) Timer function:

General timer and clock timer functions are compatible by equipping remote controller with different functions.

(6) Memory function

memorize compensation temperature, off-peak energization value.

Memory content: mode, up&down swing, light, set temperature, set fan speed, general timer (clock timer can't be memorized).

After power recovery, the unit will be turned on automatically according to memory content.

(7) Health function

During operation of indoor fan, set health function by remote controller. Turn off the unit will also turn off health function.

Turn on the unit by pressing auto button, and the health is defaulted ON.

Once compressor is started, it won't stop within 6 mins according to the change of room temp.

(1) Auto mode

① Operation condition and process for auto mode

Under auto mode, the system will automatically select operation mode (cooling, heating, and fan) according to indoor ambient temperature. There swill be 30s delayed for protection between mode switchover.

◆ When Tamb. ≥26℃ , unit will be in cooling mode℃ Ex-factory set temperature is 25℃

◆ Cooling and heating unit: When Tamb≤(19℃ +Tcompensation), unit will be in heating mode Tpreset=20℃ .

◆ Cooling only unit: When Tamb≤22℃ (or 72 ℉), unit will be in

fan mode Tpreset=25℃ .

◆ For cooling and heating unit under condition that (19 ℃ +Tcompensation) ＜ Tamb ＜ 26 ℃ (For cooling only unit under condition that 22℃＜ Tamb ＜ 26℃), when unit is initially turned on in auto mode, it will operate according to auto fan mode. When unit is changed to auto mode from other modes, it will maintain its previous working status (If auto mode is turned on from drying mode, unit will operate according to auto fan mode).

② Protection function is same as that under each mode.

(2) Cooling mode

① Operation condition and process for cooling mode

◆ When Tamb. ≥Tset+1 ℃ , the system operates under cooling mode. In this case, the compressor, the ODU fan motor and the IDU fan motor operates at set speed.

◆ When Tamb. ≤Tset-1 ℃ , the compressor and the ODU fan motor stop, while the IDU fan motor operates at set speed.

◆ When Tset-1℃ <Tamb. <Tset+1℃ , the system will maintain its previous operation status.

In cooling mode, the 4-way valve is de-energized (4-way valve is not available for cooling only unit). Temperature setting range is 16~30℃ .

(8)I feel control mode

After controller received I feel control signal and ambient temperature sent by remote controller, controller will work according to the ambient temperature sent by remote controller.

(9)Entry condition for compulsory defrosting function

When turn on the unit under heating ode and set temperature is 16^{O}C (or 16.5^{O}C by remote controller), press "△, ▽, △, ▽, △, ▽ " button successively within 5s and then indoor unit will enter into compulsory defrosting setting status:

(1) If theres only indoor units controller, it enters into indoor normal defrosting mode.

(2) If theres indoor units controller and outdoor units controller, indoor unit will send compulsory defrosting mode signal to outdoor unit and then outdoor unit will operate under normal defrosting mode. After indoor unit received the signal that outdoor unit has entered into defrosting status, indoor unit will cancel to send compulsory mode to outdoor unit. If outdoor unit hasn't received feedback signal from outdoor unit after 3min, indoor unit will also cancel to send compulsory defrosting signal.

(10)Refrigerant recovery function:

Enter into Freon recovery mode actively: Within 5min after energization, turn on the unit at 16^{O}C under cooling mode, and press light button for 3 times within 3s to enter into Freon recovery mode. Fo is displayed and Freon recovery mode will be sent to outdoor unit.

(11)Ambient temperature display control mode

1. When user set the remote controller to display set temperature (corresponding remote control code: 01), current set temperature will be displayed.

2. Only when remote control signal is switched to indoor ambient temperature display status (corresponding remote control code: 10) from other display status (corresponding remote control code: 00, 01,11),controller will display indoor ambient temperature for 3s and then turn back to display set temperature.

Under this mode, indoor fan operates at set fan speed. Compressor, outdoor fan, 4-way valve and electric heating tube stop operation. Indoor fan can select to operate at high, medium, low or auto fan speed. Temperature setting range is 16~30^{O}C.

(12)Off-peak energization function:

Adjust compressors minimum stop time. The original minimum stop time is 180s and then we change to:

The time interval between two start-ups of compressor can't be less than 180+Ts(0≤T≤15). T is the variable of controller. Thats to say the minimum stop time of compressor is 180s~195s. Read-in T into memory chip when refurbish the memory chip each time. After power recovery, compressor can only be started up after 180+T s at least.

(13) SE control mode

The unit operates at SE status.

(14) X-fan mode

When X-fan function is turned on, after turn off the unit, indoor fan will still operate at low speed for 2min and then the complete unit will be turned off. When x-fan function is turned off, after turn off the unit, the complete unit will be turned off directly.

(15) 8^{O}C heating function

Under heating mode, you can set 8^{O}C heating function by remote controller. The system will operate at 8^{O}C set temperature.

(16)Turbo function

Turbo function can be set under cooling and heating modes. Press Fan Speed button to cancel turbo setting. Turbo function is not available under auto, drying and fan modes.

● Outdoor Unit

1. Cooling mode:

Working condition and process of cooling mode:

① When Tindoor ambient temperature≥Tpreset, unit enters into cooling mode. Indoor fan, outdoor fan and compressor start operation. Indoor fan operates according to set fan speed.

② When Tindoor ambient temperature≤Tpreset-2℃ , compressor stops operation and outdoor fan will stop 30s later. Indoor fan operates according to set fan speed.

③ When Tpreset-2℃＜ Tindoor ambient temperature ＜ Tpreset, unit operates according to the previous status.

Under cooling mode, 4-way valve is not energized. Temperature setting range is 16~30 ℃ . If compressor stops because of malfunction in cooling mode, indoor fan and swing motor will work according to the original status.

2. Drying mode

(1) Working condition and process of drying mode

① When Tindoor ambient temperature ＞ Tpreset, unit will be in drying mode. Outdoor fan and compressor start operation while indoor fan will operate at low fan speed.

② When Tpreset-2℃ ≤Tindoor ambient temperature≤Tpreset, unit operates according to the previous status.

③ When Tindoor ambient temperature ＜ Tpreset-2 ℃ , compressor stops operation and outdoor fan will stop 30s later.

(2) Under drying mode, 4-way valve is not energized. Temperature setting range is 16~30℃ .

(3) Protection function: same as in cooling mode.

3. Fan mode

(1) Under this mode, indoor fan can select different fan speed (except Turbo) or auto fan speed. Compressor, outdoor fan and 4-way valve all stop operation.

(2) In fan mode, temperature setting range is 16~30℃ .

4. Heating mode

Working condition and process of heating mode:

① When Tpreset-(Tindoor ambient temperature-Tcompensation)≥1℃ , unit enters into heating mode. Compressor, outdoor fan and 4-way valve start operation.

② When -2 ℃ ＜ Tpreset-(Tindoor ambient temperature-Tcompensation) ＜1℃ , unit operates according to the previous status.

③ When Tpreset-(Tindoor ambient temperature-Tcompensation)≤-2 ℃ , compressor stops operation and outdoor fan will stop 30s later. Indoor fan will be in residual-heat blowing status.

④ When unit is turned off under heating mode or changed to other modes from heating mode, 4-way valve will be power-off 2min after compressor stops working (compressor is in operation status under heating mode).

⑤ When Toutdoor ambient temperature ＞ 30 ℃ , compressor stops operation immediately. Outdoor fan will stop 30s later.

⑥ Under the condition that compressor is turned on, when unit is changed to heating mode from cooling or drying mode, 4-way valve will be energized in 2~3mins delay.

Note: Tcompensation is determined by IDU and ODU. If IDU controls the compensation temperature, then Tcompensation is determined according to the value sent by IDU to ODU; If IDU does not control the compensation temperature, then Tcompensation will default to 3℃ by the ODU.

5. Freon recovery mode

After the Freon recovery signal from IDU is received, cooling at rated frequency will be forcibly turned on to recover Freon.

Indoor unit will display Fo. If any signal from remote controller is received, unit will exit from Freon recovery mode and indoor unit stops displaying Fo.

6. Compulsory defrosting

If unit is turned on under heating mode and set temperature is 16 ℃ (by remote controller), press "△, ▽, △, ▽, △, ▽" within 5s, unit will enter into compulsory defrosting mode and send the signal to ODU. When the compulsory defrosting signal from ODU is received, IDU will exit from the compulsory defrosting mode and stop sending the signal to ODU.

After ODU receives the compulsory defrosting code, it will start compulsory defrosting. Defrosting frequency and opening angle will be the same as in normal defrosting mode. When compulsory defrosting is finished, the complete unit resumes original status.

7. Auto mode

Auto mode is determined by controller of IDU. See IDU logic for details.

8. 8^{O}C heating

Set temperature is 8^{O}C. Display board of IDU displays 8^{O}C. Under this mode, "Cold air prevention" function is shielded.

If compressor is operating under this mode, fan speed will adjust according to auto fan speed; if compressor stops operation under this mode, indoor fan will be in residual-heat blowing status.

When power on, communication light will be blinking in a normal way (after receiving a group of correct signals, blinking stops for 0.2s~0.3s). If theres no communication, communication light will be always on. If other ODU has malfunction, communication light will be on for 1s and off for 1s in a circular way.

7. Notes for Installation and Maintenance

Safety Precautions: Important!

Please read the safety precautions carefully before installation and maintenance.

The following contents are very important for installation and maintenance.

Please follow the instructions below.

●The installation or maintenance must accord with the instructions.

●Comply with all national electrical codes and local electrical codes.

●Pay attention to the warnings and cautions in this manual.

●All installation and maintenance shall be performed by distributor or qualified person.

●All electric work must be performed by a licensed technician according to local regulations and the instructions given in this manual.

●Be caution during installation and maintenance. Prohibit incorrect operation to prevent electric shock, casualty and other accidents.

⚠ WARNINGS

Electrical Safety Precautions:

1. Cut off the power supply of air conditioner before checking and maintenance.

2. The air condition must apply specialized circuit and prohibit share the same circuit with other appliances.

3. The air conditioner should be installed in suitable location and ensure the power plug is touchable.

4. Make sure each wiring terminal is connected firmly during installation and maintenance.

5. Have the unit adequately grounded. The grounding wire can't be used for other purposes.

6. Must apply protective accessories such as protective boards, cable-cross loop and wire clip.

7. The live wire, neutral wire and grounding wire of power supply must be corresponding to the live wire, neutral wire and grounding wire of the air conditioner.

8. The power cord and power connection wires can't be pressed by hard objects.

9. If power cord or connection wire is broken, it must be replaced by a qualified person.

10. If the power cord or connection wire is not long enough, please get the specialized power cord or connection wire from the manufacture or distributor. Prohibit prolong the wire by yourself.

11. For the air conditioner without plug, an air switch must be installed in the circuit. The air switch should be all-pole parting and the contact parting distance should be more than 3mm.

12. Make sure all wires and pipes are connected properly and the valves are opened before energizing.

13. Check if there is electric leakage on the unit body. If yes, please eliminate the electric leakage.

14. Replace the fuse with a new one of the same specification if it is burnt down; Don't replace it with a cooper wire or conducting wire.

15. If the unit is to be installed in a humid place, the circuit breaker must be installed.

Installation Safety Precautions:

1. Select the installation location according to the requirement of this manual.(See the requirements in installation part)

2. Handle unit transportation with care; the unit should not be carried by only one person if it is more than 20kg.

3. When installing the indoor unit and outdoor unit, a sufficient fixing bolt must be installed; make sure the installation support is firm.

4. Ware safety belt if the height of working is above 2m.

5. Use equipped components or appointed components during installation.

6. Make sure no foreign objects are left in the unit after finishing installation.

Refrigerant Safety Precautions:

1. When refrigerant leaks or requires discharge during installation, maintenance, or disassembly, it should be handled by certified professionals or otherwise in compliance with local laws and regulations.

2.Avoid contact between refrigerant and fire as it generates poisonous gas; Prohibit prolong the connection pipe by welding.

3. Apply specified refrigerant only. Never have it mixed with any other refrigerant. Never have air remain in the refrigerant line as it may lead to rupture or other hazards.

4. Make sure no refrigerant gas is leaking out when installation is completed.

5. If there is refrigerant leakage, please take sufficient measure to minimize the density of refrigerant.

6. Never touch the refrigerant piping or compressor without wearing glove to avoid scald or frostbite.

Improper installation may lead to fire hazard, explosion, electric shock or injury.

Safety Precautions for Installing and Relocating the Unit:

To ensure safety, please be mindful of the following precautions.

⚠ WARNINGS

1. When installing or relocating the unit, be sure to keep the refrigerant circuit free from air or substances other than the specified refrigerant.

Any presence of air or other foreign substance in the refrigerant circuit will cause system pressure rise or compressor rupture, resulting in injury.

2.When installing or moving this unit, do not charge the refrigerant which is not comply with that on the nameplate or unqualified refrigerant.

Otherwise, it may cause abnormal operation, wrong action, mechanical malfunction or even series safety accident.

3.When refrigerant needs to be recovered during relocating or repairing the unit, be sure that the unit is running in cooling mode.Then, fully close the valve at high pressure side (liquid valve).About 30-40 seconds later, fully close the valve at low pressure side (gas valve), immediately stop the unit and disconnect power. Please note that the time for refrigerant recovery should not exceed 1 minute.

If refrigerant recovery takes too much time, air may be sucked in and cause pressure rise or compressor rupture, resulting in injury.

4.During refrigerant recovery, make sure that liquid valve and gas valve are fully closed and power is disconnected before detaching the connection pipe.

If compressor starts running when stop valve is open and connection pipe is not yet connected, air will be sucked in and cause pressure rise or compressor rupture, resulting in injury.

5.When installing the unit, make sure that connection pipe is securely connected before the compressor starts running.

If compressor starts running when stop valve is open and connection pipe is not yet connected, air will be sucked in and cause pressure rise or compressor rupture, resulting in injury.

6.Prohibit installing the unit at the place where there may be leaked corrosive gas or flammable gas.

If there leaked gas around the unit, it may cause explosion and other accidents.

7.Do not use extension cords for electrical connections. If the electric wire is not long enough, please contact a local service center authorized and ask for a proper electric wire.

Poor connections may lead to electric shock or fire.

8.Use the specified types of wires for electrical connections between the indoor and outdoor units. Firmly clamp the wires so that their terminals receive no external stresses.

Electric wires with insufficient capacity, wrong wire connections and insecure wire terminals may cause electric shock or fire.

Safety Precautions for Refrigerant

●To realize the function of the air conditioner unit, a special refrigerant circulates in the system. The used refrigerant is the fluoride R32,which is specially cleaned. The refrigerant is flammable and inodorous. Furthermore, it can leads to explosion under certain conditions. But the flammability of the refrigerant is very low. It can be ignited only by fire.
●Compared to common refrigerants, R32 is a nonpolluting refrigerant with no harm to the ozonosphere. The influence upon the greenhouse effect is also lower. R32 has got very good thermodynamic features which lead to a really high energy efficiency. The units therefore need a less filling.

WARNING:

●Do not use means to accelerate the defrosting process or to clean, other than those recommended by the manufacture.
Should repair be necessary,contact your nearest authorized Service Centre. Any repairs carried out by unqualified personnel may be dangerous. The appliance shall be stored in a room without continuously operating ignition sources. (for example:open flames , an operating gas appliance or an operating electric heater.)
●Do not pierce or burn.
●Appliance shall be installed, operated and stored in a room with a floor area larger than Xm^2.
●Appliance filled with flammable gas R32. For repairs, strictly follow manufacturers instructions only.Be aware that refrigrants not contain odour.
●Read specialists manual.



Safety Operation of Flammable Refrigerant

Qualification requirement for installation and maintenance man

●All the work men who are engaging in the refrigeration system should bear the valid certification awarded by the authoritative organization and the qualification for dealing with the refrigeration system recognized by this industry. If it needs
other technician to maintain and repair the appliance, they should be supervised by the person who bears the qualification for using the flammable refrigerant.
●It can only be repaired by the method suggested by the equipments manufacturer.

Installation notes

●The air conditioner is not allowed to use in a room that has running fire (such as fire source,working coal gas ware, operating heater).
●It is not allowed to drill hole or burn the connection pipe.
●The air conditioner must be installed in a room that is larger than the minimum room area.
The minimum room area is shown on the nameplate or following table a.
●Leak test is a must after installation.

table a - Minimum room area (m^2)

Charge amount (kg)	Floor location	Window mounted	Wall mounted	Ceiling mounted
≤1.2	4	4	4	4
1.3	14.5	5.2	4	4
1.4	16.8	6.1	4	4
1.5	19.3	7	4	4
1.6	22	7.9	4	4
1.7	24.8	8.9	4	4
1.8	27.8	10	4	4
1.9	31	11.2	4	4
2.0	34.3	12.4	4	4
2.1	37.8	13.6	4.2	4
2.2	41.5	15	4.6	4
2.3	45.4	16.3	5	4
2.4	49.4	17.8	5.5	4
2.5	53.6	19.3	6	4

Maintenance notes

●Check whether the maintenance area or the room area meet the requirement of the nameplate.
— Its only allowed to be operated in the rooms that meet the requirement of the nameplate.
●Check whether the maintenance area is well-ventilated.
— The continuous ventilation status should be kept during the operation process.
●Check whether there is fire source or potential fire source in the maintenance area.
— The naked flame is prohibited in the maintenance area; and the “no smoking” warning board should be hanged.
●Check whether the appliance mark is in good condition.
— Replace the vague or damaged warning mark.

Welding

●If you should cut or weld the refrigerant system pipes in the process of maintaining, please follow the steps as below:

a. Shut down the unit and cut power supply
b. Eliminate the refrigerant
c. Vacuuming
d. Clean it with N_2 gas
e. Cutting or welding
f. Carry back to the service spot for welding
●Make sure that there isnt any naked flame near the outlet of the vacuum pump and its well-ventilated.
●The refrigerant should be recycled into the specialized storage tank.

Filling the refrigerant

●Use the refrigerant filling appliances specialized for R32. Make sure that different kinds of refrigerant wont contaminate with each other.
●The refrigerant tank should be kept upright at the time of filling refrigerant.
●Stick the label on the system after filling is finished (or havent finished).
●Dont overfilling.
●After filling is finished, please do the leakage detection before test running; another time of leak detection should be done when its removed.

Safety instructions for transportation and storage

●Please use the flammable gas detector to check before unload and open the container.
●No fire source and smoking.
●According to the local rules and laws.

Specialist's Manual

• The following checks shall be applied to installations using flammable refrigerants:
– the charge size is in accordance with the room size within which the refrigerant containing parts are installed;
– the ventilation machinery and outlets are operating adequately and are not obstructed;
– if an indirect refrigerating circuit is being used, the secondary circuit shall be checked for the presence of refrigerant;
– marking to the equipment continues to be visible and legible. Markings and signs that are illegible shall be corrected;
– refrigeration pipe or components are installed in a position where they are unlikely to be exposed to any substance which may corrode refrigerant containing components, unless the components are constructed of materials which are inherently resistant to being corroded or are suitably protected against being so corroded.
• Repair and maintenance to electrical components shall include initial safety checks and component inspection procedures. If a fault exists that could compromise safety, then no electrical supply shall be connected to the circuit until it is satisfactorily dealt with. If the fault cannot be corrected immediately but it is necessary to continue operation, an adequate temporary solution shall be used. This shall be reported to the owner of the equipment so all parties are advised.
• Initial safety checks shall include:
– that capacitors are discharged: this shall be done in a safe manner to avoid possibility of sparking;
– that no live electrical components and wiring are exposed while charging, recovering or purging the system;
– that there is continuity of earth bonding.
• Checking for presence of refrigerant
The area shall be checked with an appropriate refrigerant detector prior to and during work, to ensure the technician is aware of potentially toxic or flammable atmospheres. Ensure that the leak detection equipment being used is suitable for use with all applicable refrigerants, i.e. non-sparking, adequately sealed or intrinsically safe.
• Presence of fire extinguisher
If any hot work is to be conducted on the refrigeration equipment or any associated parts, appropriate fire extinguishing equipment shall be available to hand. Have a dry powder or CO2 fire extinguisher adjacent to the charging area.
• Ventilated area
Ensure that the area is in the open or that it is adequately ventilated before breaking into the system or conducting any hot work. A degree of ventilation shall continue during the period that the work is carried out. The ventilation should safely disperse any released refrigerant and preferably expel it externally into the atmosphere.
• Leak detection methods
Leak detection fluids are suitable for use with most refrigerants but the use of detergents containing chlorine shall be avoided as the chlorine may react with the refrigerant and corrode the copper pipe-work.
• Checks to the refrigeration equipment
Where electrical components are being changed, they shall be fit for the purpose and to the correct specification. At all times the manufacturer's maintenance and service guidelines shall be followed. If in doubt, consult the manufacturer's technical department for assistance.
• Checks to electrical devices
– that capacitors are discharged: this shall be done in a safe manner to avoid possibility of sparking;
– that no live electrical components and wiring are exposed while charging, recovering or purging the system.
• Repairs to sealed components
During repairs to sealed components, all electrical supplies shall be disconnected from the equipment being worked upon prior to any removal of sealed covers, etc.
If it is absolutely necessary to have an electrical supply to equipment during servicing, then a permanently operating form of leak detection shall be located at the most
critical point to warn of a potentially hazardous situation.
Particular attention shall be paid to the following to ensure that by working on electrical components, the casing is not altered in such a way that the level of protection is affected. This shall include damage to cables, excessive number of connections, terminals not made to original specification, damage to seals, incorrect fitting of glands, etc.
– Ensure that the apparatus is mounted securely.
– Ensure that seals or sealing materials have not degraded to the point that they no longer serve the purpose of preventing the ingress of flammable atmospheres.
Replacement parts shall be in accordance with the manufacturer's specifications.
NOTE:The use of silicon sealant can inhibit the effectiveness

of some types of leak detection equipment. Intrinsically safe components do not have to be isolated prior to working on them.

• Repair to intrinsically safe components

Do not apply any permanent inductive or capacitance loads to the circuit without ensuring that this will not exceed the permissible voltage and current permitted for the equipment in use.

Intrinsically safe components are the only types that can be worked on while live in the presence of a flammable atmosphere. The test apparatus shall be at the correct rating.

Replace components only with parts specified by the manufacturer. Other parts may result in the ignition of refrigerant in the atmosphere from a leak.

• Cabling

Check that cabling will not be subject to wear, corrosion, excessive pressure, vibration, sharp edges or any other adverse environmental effects. The check shall also take into account the effects of aging or continual vibration from sources such as compressors or fans.

• Detection of flammable refrigerants

Under no circumstances shall potential sources of ignition be used in the searching for or detection of refrigerant leaks. A halide torch (or any other detector using a naked flame) shall not be used.

• Decommissioning

Before carrying out this procedure, it is essential that the technician is completely familiar with the equipment and all its detail. It is recommended good practice that all refrigerants are recovered safely. Prior to the task being carried out, an oil and refrigerant sample shall be taken in case analysis is required prior to re-use of reclaimed refrigerant. It is essential that electrical power is available before the task is commenced.

a) Become familiar with the equipment and its operation.

b) Isolate system electrically.

c) Before attempting the procedure, ensure that:

– mechanical handling equipment is available, if required, for handling refrigerant cylinders;

– all personal protective equipment is available and being used correctly;

– the recovery process is supervised at all times by a competent person;

– recovery equipment and cylinders conform to the appropriate standards.

d) Pump down refrigerant system, if possible.

e) If a vacuum is not possible, make a manifold so that refrigerant can be removed from various parts of the system.

f) Make sure that cylinder is situated on the scales before recovery takes place.

g) Start the recovery machine and operate in accordance with manufacturer's instructions.

h) Do not overfill cylinders. (No more than 80% volume liquid charge).

i) Do not exceed the maximum working pressure of the cylinder, even temporarily.

j) When the cylinders have been filled correctly and the process completed, make sure that the cylinders and the equipment are removed from site promptly and all isolation valves on the equipment are closed off.

k) Recovered refrigerant shall not be charged into another refrigeration system unless it has been cleaned and checked.

• Labelling

Equipment shall be labelled stating that it has been decommissioned and emptied of refrigerant. The label shall be dated and signed. For appliances containing flammable refrigerants, ensure that there are labels on the equipment stating the equipment contains flammable refrigerant.

• Recovery

When removing refrigerant from a system, either for servicing or decommissioning, it is recommended good practice that all refrigerants are removed safely.

When transferring refrigerant into cylinders, ensure that only appropriate refrigerant recovery cylinders are employed. Ensure that the correct number of cylinders for holding the total system charge are available. All cylinders to be used are designated for the recovered refrigerant and labelled for that refrigerant (i.e. special cylinders for the recovery of refrigerant). Cylinders shall be complete with pressure-relief valve and associated shut-off valves in good working order. Empty recovery cylinders are evacuated and, if possible, cooled before recovery occurs.

The recovery equipment shall be in good working order with a set of instructions concerning the equipment that is at hand and shall be suitable for the recovery of all appropriate refrigerants including, when applicable, flammable refrigerants. In addition,a set of calibrated weighing scales shall be available and in good working order. Hoses shall be complete with leak-free disconnect couplings and in good condition. Before using the recovery machine, check that it is in satisfactory working order, has been properly maintained and that any associated electrical components are sealed to prevent ignition in the event of a refrigerant release. Consult manufacturer if in doubt.

The recovered refrigerant shall be returned to the refrigerant supplier in the correct recovery cylinder, and the relevant waste transfer note arranged. Do not mix refrigerants in recovery units and especially not in cylinders.

If compressors or compressor oils are to be removed, ensure that they have been evacuated to an acceptable level to make certain that flammable refrigerant does not remain within the lubricant. The evacuation process shall be carried out prior to re- turning the compressor to the suppliers. Only electric heating to the compressor body shall be employed to accelerate this process. When oil is drained from a system, it shall be carried out safely.

Main Tools for Installation and Maintenance



Level meter



Measuring tape



Screw driver



Impact drill



Drill head



Electric drill



Electroprobe



Universal meter



Torque wrench



Open-end wrench



Inner hexagon spanner



Electronic leakage detector



Vacuum pump



Pressure meter



Pipe pliers



Pipe pliers



Pipe cutter



Pipe expander



Pipe bender



Soldering appliance



Refrigerant container




Electronic scale


8. Installation

8.1 Installation Dimension Diagram


24K
48K(XH)

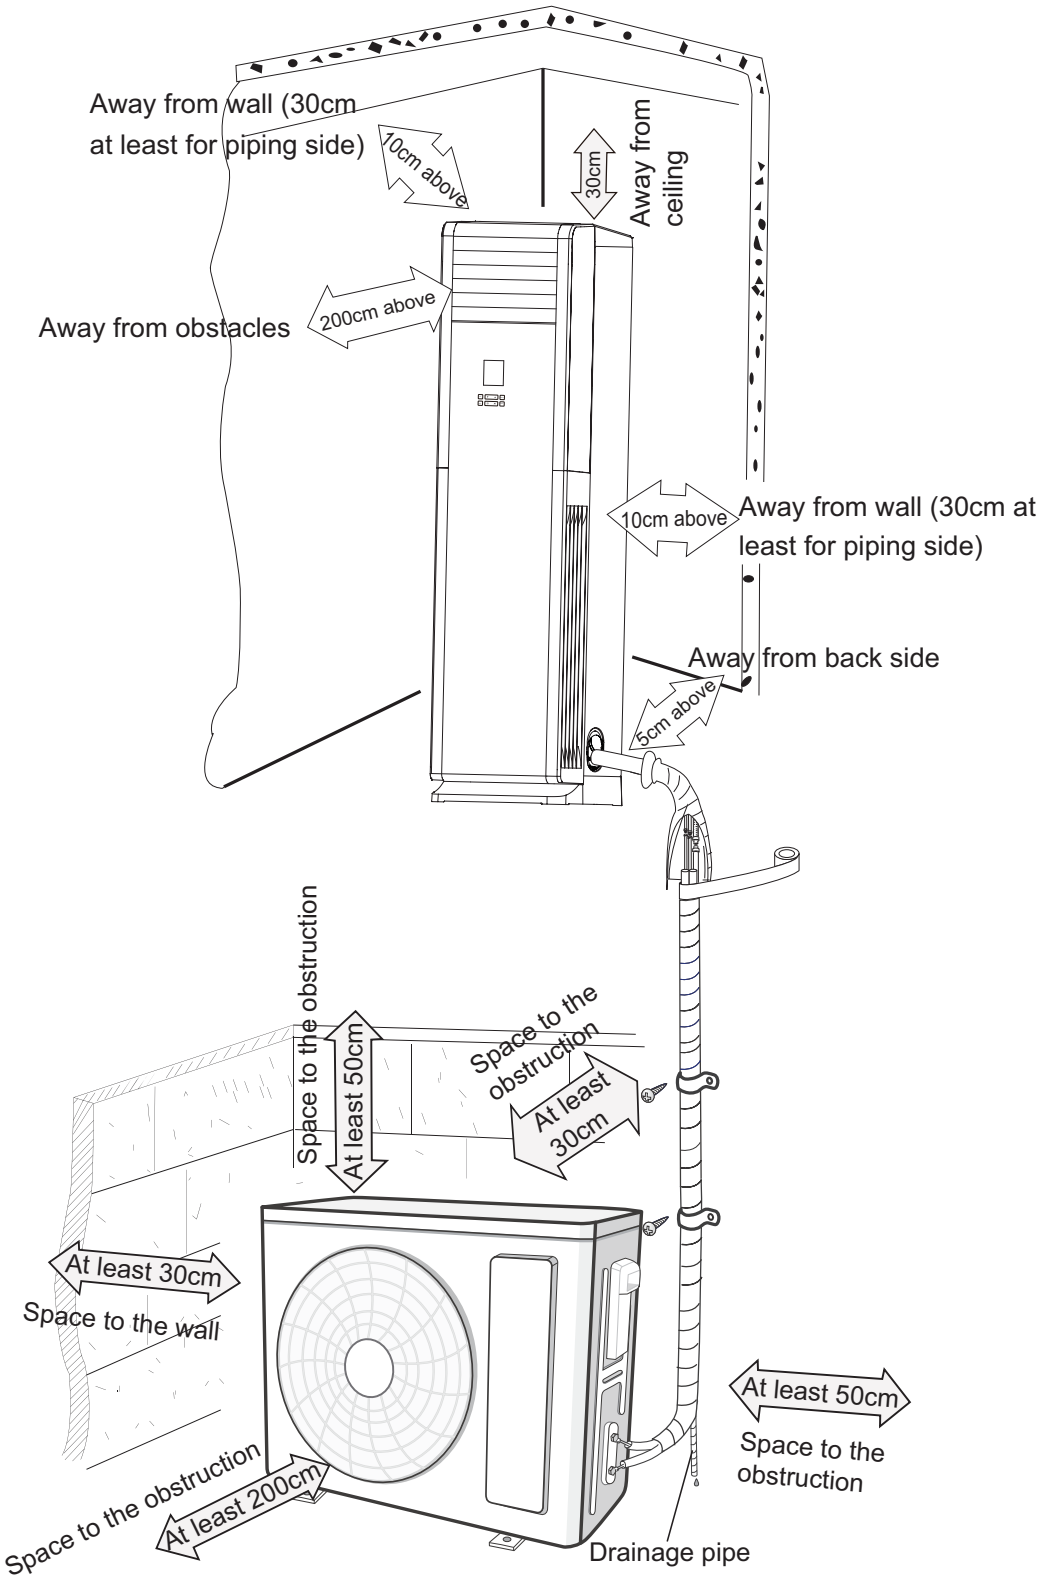

48K(XK)

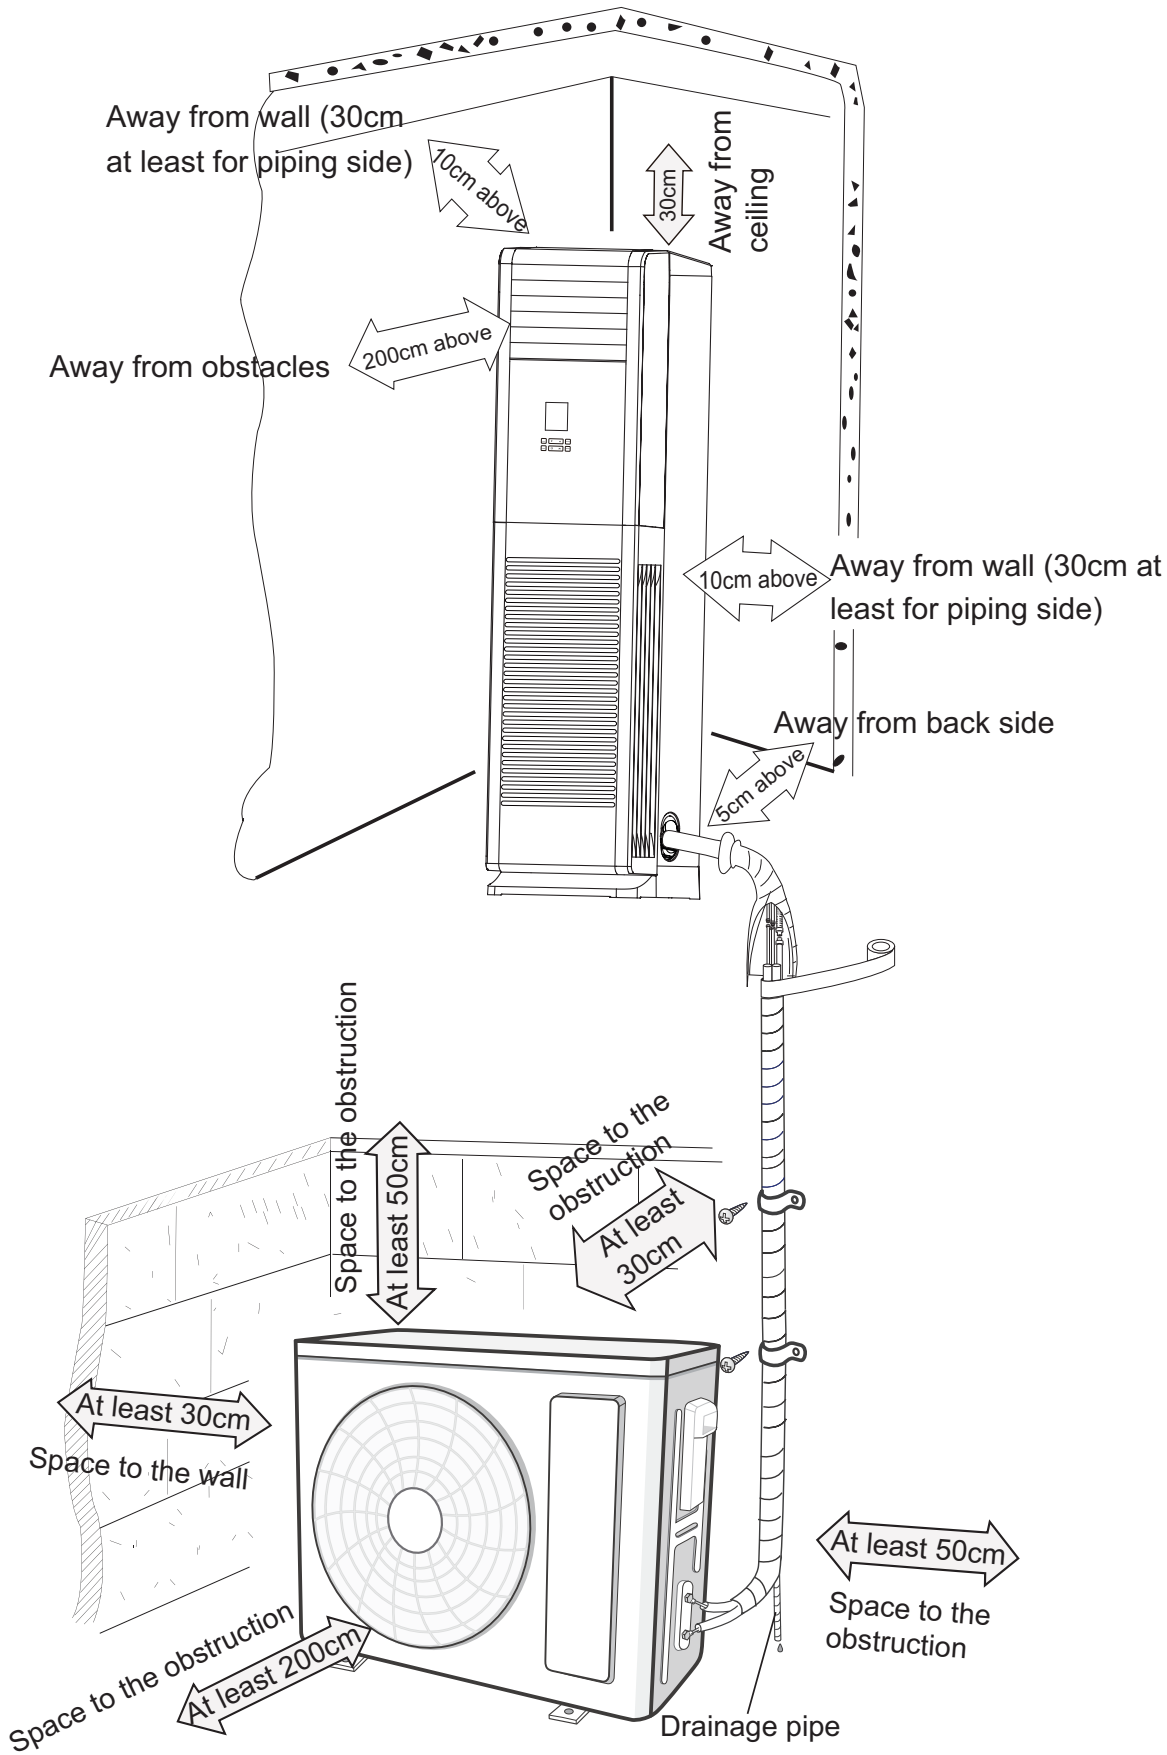
Away from wall (30cm at least for piping side)
10cm above
30cm
Away from ceiling
Away from obstacles
200cm above
10cm above
Away from wall (30cm at least for piping side)
Away from back side
5cm above
Space to the obstruction
At least 50cm
Space to the obstruction
At least 30cm
At least 30cm
Space to the wall
At least 50cm
Space to the obstruction
Space to the obstruction
At least 200cm
Drainage pipe

Installation Procedures

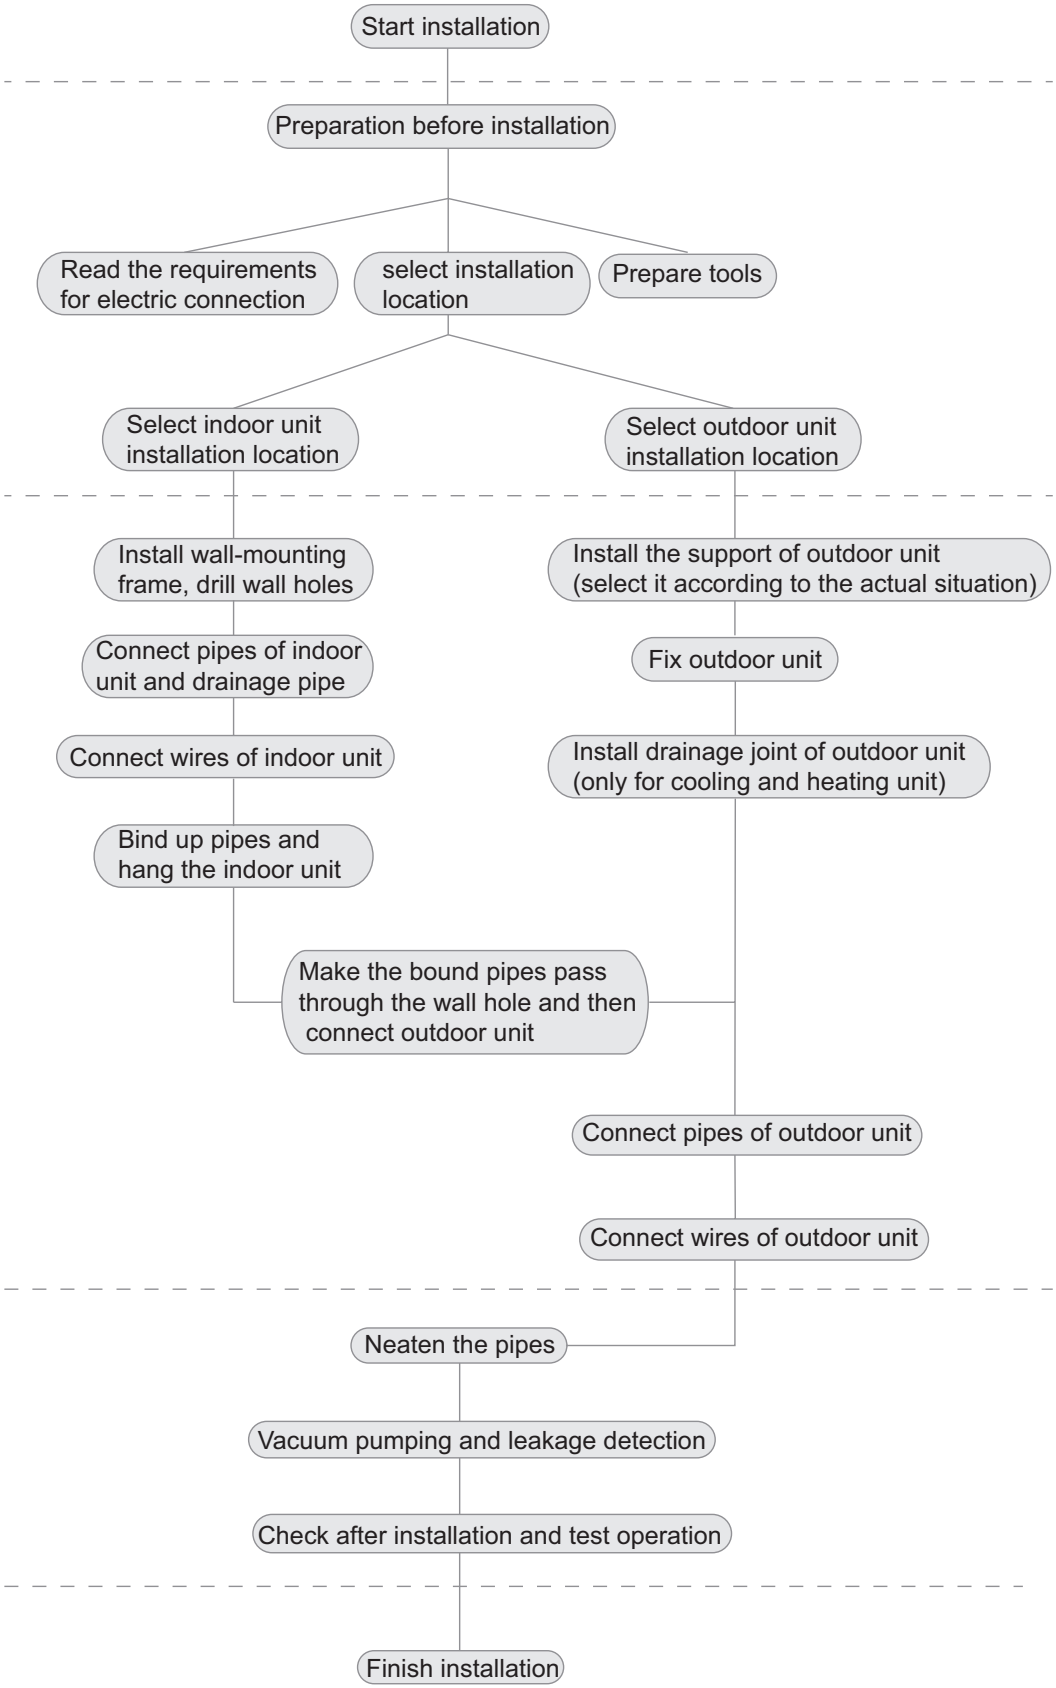

Note: this flow is only for reference; please find the more detailed installation steps in this section.

8.2 Installation Parts-checking

No.	Name
1	Indoor unit
2	Outdoor unit
3	Connection pipe
4	Drainage pipe
5	Connecting cable(power cord)
6	Wall pipe
7	Sealing gum
8	Wrapping tape
9	Support of outdoor unit
10	Fixing screw
11	Drainage plug(cooling and heating unit)
12	Owners manual, remote controller

⚠ **Note:**
1.Please contact the local agent for installation.
2.Don't use unqualified power cord.

8.3 Selection of Installation Location

1. Basic Requirement:
Installing the unit in the following places may cause malfunction. If it is unavoidable, please consult the local dealer:
1. The place with strong heat sources, vapors, flammable or explosive gas, or volatile objects spread in the air.
2. The place with high-frequency devices (such as welding machine, medical equipment).
3. The place near coast area.
4. The place with oil or fumes in the air.
5. The place with sulfureted gas.
6. Other places with special circumstances.
7. The appliance shall nost be installed in the laundry.
8. It's not allowed to be installed on the unstable or motive base structure(such as truck) or in the corrosive environment (such as chemical factory).

2. Indoor Unit:
1. Avoid installing the indoor unit in a place where generated or leaked inflammable gas will stay.
2. Avoid installing the indoor unit in a moist place or in a place where oil may be splashed on the unit.
3. Select a location where outlet air may reach each corner of the room.
4. Select a location where connection pipe can be led to outdoor conveniently.
5. Select a location where air inlet and outlet won't be blocked.
6. Select a location with least affection of outdoor air.
7. Select a location with firm and flat floor.
8. Retain sufficient space for maintenance and installation.
9. Ensure the installation meets the requirement of installation dimension diagram.
10.Do not use the unit in the immediate surroundings of a laundry, a bath, a shower or a swimming pool.

3. Outdoor Unit:
1. Select a location where the noise and outflow air emitted by the outdoor unit will not affect neighborhood.
2. The location should be well ventilated and dry, in which the outdoor unit won't be exposed directly to sunlight or strong wind.
3. The location should be able to withstand the weight of outdoor unit.
4. Make sure that the installation follows the requirement of installation dimension diagram.
5. Select a location which is out of reach for children and far away from animals or plants. If it is unavoidable, please add fence for safety purpose.
6. The height difference between indoor unit and outdoor unit should be within 5m. The length of connection pipe should be within 10m.

8.4 Electric Connection Requirement

1. Safety Precaution
1. Must follow the electric safety regulations when installing the unit.
2. If the supply cord is damaged, it must be replaced by the manufacturer or its service agent or a similarly qualified person in order to avoid a hazard.
3. According to the local safety regulations, use qualified power supply circuit and air switch
4. A air switch having a contact separation of at least 3mm in all poles should be fixed in fixed wiring.
5. The appliance shall be installed in accordance with national wiring regulation.
6. The air switch must have the functions of magnetic tripping and heat tripping in order to prevent short circuit or overload. Please install the air switch with suitable capacity according to the sheet below.
7. Make sure the power supply matches with the requirement of air conditioner.Unstable power supply or incorrect wiring may result in electric shock, fire hazard or malfunction. Please install proper power supply cables before using the air conditioner.
8. Properly connect the live wire, neutral wire and grounding wire of power socket.
9. Be sure to cut off the power supply before proceeding any work related to electric safety.
10. Do not put through the power before finishing installation.

2. Grounding Requirement:
1. The air conditioner is first class electric appliance. It must be properly grounded with specialized grounding device by a professional. Please make sure it is always grounded effectively, otherwise it may cause electric shock.
2. The yellow-green wire in air conditioner is grounding wire, which can't be used for other purposes.
3. The grounding resistance should comply with national electric safety regulations.
4. Including an air switch with suitable capacity, please note the following table. Air switch should be included magnet buckle and heating buckle function, it can protect the circuit-short and overload. (Caution: please do not use the fuse only for protect the circuit)

Air-conditioner	Air switch capacity	Power cord
24K	25A	3G2.5
48K(XH)	32A	3G4.0
48K(XK)	16A	5G1.5

8.5 Installation of Indoor Unit

1. Choosing Installation location

Recommend the installation location to the client and then confirm it with the client.

2. Open piping hole

(1) Choose the position of piping hole according to the direction of outlet pipe.

(2) Open a piping hole with the diameter of Φ70 on the selected outlet pipe position. In order to drain smoothly, slant the piping hole on the wall slightly downward to the outdoor side with the gradient of 5-10°. (As show in Fig.1)

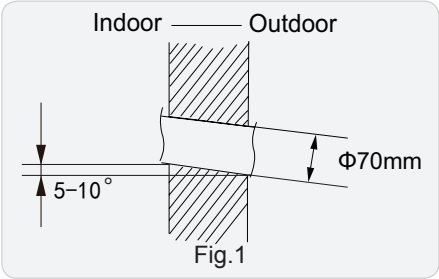


Fig.1

⚠ Note:

Pay attention to dust prevention and take relevant safety measures when opening the hole.

3. Outlet Pipe

(1) The pipe can be led out in the direction of left, right or rear. (As show in Fig.2)

(2) After confirming the direction of outlet pipe, loosen the screws at the upper and lower adjusting baffle to let the connection pipe/ drain pipe connects the indoor unit. (As show in Fig.3)




Fig.2




Fig.3

4. Connect the Pipe of Indoor Unit

(1) Take out the left and right screw cover and then remove the screws on air-inlet panel, push the front door plate upwards and then separate the connector connected to the connection wire of display and then remove the front door plate sub-assy. Remove two screws on the air-in panel sub-assy. Open the air-in panel along the arrow direction and then remove the air-in panel sub-assy.(As show in Fig.4)

(2) Aim the pipe joint at the corresponding bellmouth.(As show in Fig.5)

(3) Pretightening the union nut with hand.

(4) Adjust the torque force by referring to the following sheet. Place the open-end wrench on the pipe joint and place the torque wrench on the union nut. Tighten the union nut with torque wrench.(As show in Fig.6)

(5) Wrap the indoor pipe and joint of connection pipe with insulating pipe, and then wrap it with tape. (As show in Fig.7)

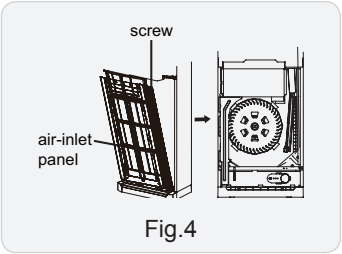


Fig.4

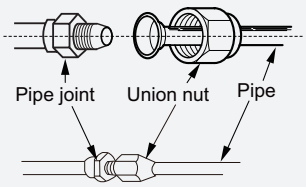


Fig.5

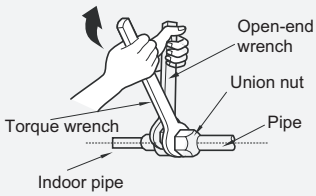


Fig.6

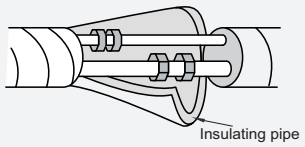


Fig.7

Refer to the following table for wrench moment of force:

Piping size (inch)	Tightening torque (N·m)
1/4	15~20
3/8	35~40
1/2	45~50
5/8	60~65
3/4	70~75

5. Install Drain Hose

(1) Connect the drain hose to the outlet pipe of indoor unit.(As show in Fig.8)

(2) Bind the joint with tape.(As show in Fig.8)

(3) Add insulating pipe in the indoor drain hose in order to prevent condensation.(As show in Fig.10)




Fig.8




Fig.9

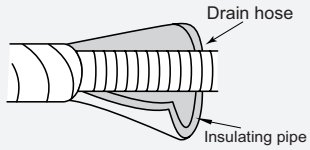


Fig.10

6. Connect Wire of Indoor Unit

(1) Make the power connection wire go through the cablecross hole of indoor unit(As show in Fig.11)


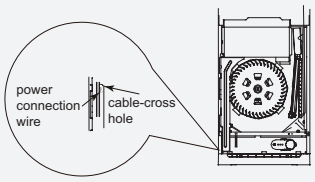


Fig.11

(2) Remove the wire clip; connect the power connection wire to the wiring terminal according to the color; tighten the screw and then fix the power supply wire,power connection wire with wire clip.(As show in Fig.12)

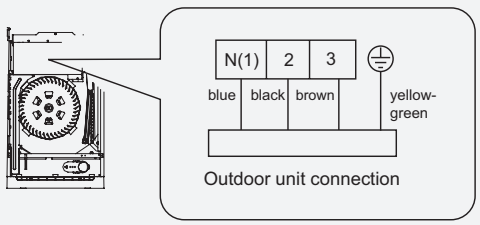

Note:the wiring board is for reference only, please refer to the actual one.

Fig.12

(3) Adjust the position of upper and lower adjusting baffle; clamp the connection pipe and drain pipe as firm as possible.
(4) Tighten the screws.

⚠ **Note:**
(1) All wires of indoor unit and outdoor unit should be connected by a professional.
(2) If the length of power connection wire is insufficient, please contact the supplier for a new one. Avoid extending the wire by yourself.
(3) For the air conditioner with plug, the plug should be reachable after finishing installation.
(4) For the air conditioner without plug, an air switch must be installed in the line. The air switch should be all-pole parting and the contact parting distance should be more than 3mm.

7. Bind up Pipe

(1) Bind up the connection pipe, power cord and drain hose with the band.(As show in Fig.13)
(2) Reserve a certain length of drain hose and power cord for installation when binding them. When binding to a certain degree, separate the indoor power and then separate the drain hose.(As show in Fig.14)
(3) Bind them evenly.
(4) The liquid pipe and gas pipe should be bound separately at the end.

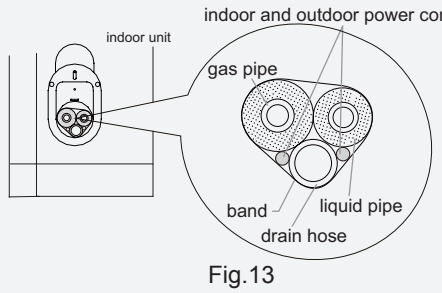


Fig.13

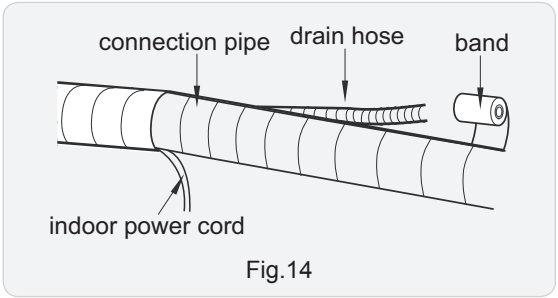


Fig.14

⚠ **Note:**
(1) The power cord and control wire can't be crossed or winding.
(2) The drain hose should be bound at the bottom.

8. Hang the Indoor Unit

(1) Put the bound pipes in the wall pipe and then make them pass through the wall hole.
(2) Stuff the gap between pipes and wall hole with sealing gum. (As show in Fig.15)
(3) Fix the wall pipe.
(4) Check if the indoor unit is installed firmly.

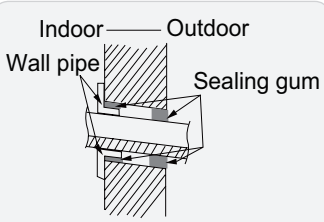


Fig.15

⚠ **Note:**
Do not bend the drain hose too excessively in order to prevent blocking.

8.6 Installation of Outdoor Unit

1. Fix the Support of Outdoor Unit(Select it according to the actual installation situation)

(1) Select installation location according to the house structure.
(2) Fix the support of outdoor unit on the selected location with expansion screws.

⚠ **Note:**
(1) Take sufficient protective measures when installing the outdoor unit.
(2) Make sure the support can withstand at least four times the unit weight.
(3) The outdoor unit should be installed at least 3cm above the floor in order to install drain joint.(As show in Fig.16)

(4) For the unit with cooling capacity of 2300W~5000W, 6 expansion screws are needed; for the unit with cooling capacity of 6000W~8000W, 8 expansion screws are needed; for the unit with cooling capacity of 10000W~16000W, 10 expansion screws are needed.




Fig.16




Fig.17

2. Install Drain Joint(Only for cooling and heating unit)

(1) Connect the outdoor drain joint into the hole on the chassis.

(2) Connect the drain hose into the drain vent.

(As show in Fig.17)

3. Fix Outdoor Unit

(1) Place the outdoor unit on the support.

(2) Fix the foot holes of outdoor unit with bolts.

(As show in Fig.18)




Fig.18




Fig.19

4. Connect Indoor and Outdoor Pipes

(1) Remove the screw on the right handle of outdoor unit and then remove the handle.(As show in Fig.19)

(2) Remove the screw cap of valve and aim the pipe joint at the bellmouth of pipe.(As show in Fig.20)

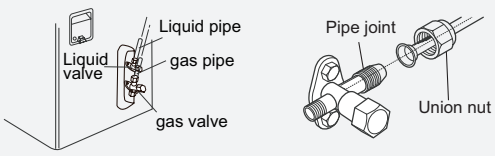


Fig.20

(3) Pretightening the union nut with hand.

(4) Tighten the union nut with torque wrench by referring to the sheet below.

Refer to the following table for wrench moment of force:

Piping size (inch)	Tightening torque (N·m)
1/4	15~20
3/8	35~40
1/2	45~50
5/8	60~65
3/4	70~75

5. Connect Outdoor Electric Wire

(1) Remove the wire clip; connect the power connection wire to the wiring terminal according to the color; fix them with screws. (As show in Fig.21)

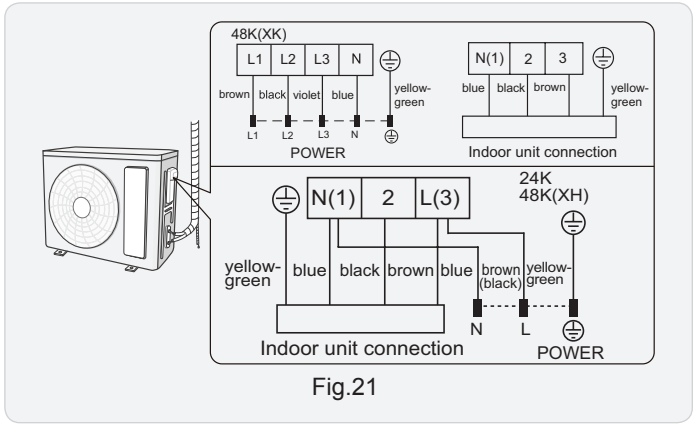


Fig.21

Note: the wiring connect is for reference only,please refer to the actual one.

⚠ Note:

(1) After tightening the screw, pull the power cord slightly to check if it is firm.

(2) Never cut the power connection wire to prolong or shorten the distance.

6. Neaten the Pipes

(1) The pipes should be placed along the wall, bent reasonably and hidden possibly. Min. semidiameter of bending the pipe is 10cm.

(2) If the outdoor unit is higher than the wall hole, you must set a U-shaped curve in the pipe before pipe goes into the room, in order to prevent rain from getting into the room.(As show in Fig.23)




Fig.22

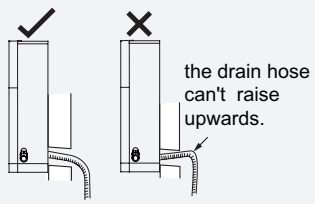


Fig.23

⚠ Note:

(1) The through-wall height of drain hose shouldn't be higher than the outlet pipe hole of indoor unit.(As show in Fig.23)

(2) Slant the drain hose slightly downwards. The drain hose can't be curved, raised and fluctuant, etc. (As show in Fig.24)

(3) The water outlet can't be placed in water in order to drain smoothly.(As show in Fig.25)




Fig.24




Fig.25

8.7 Vacuum Pumping and Leak Detection

1. Use Vacuum Pump

(1) Remove the valve caps on the liquid valve and gas valve and the nut of refrigerant charging vent.

(2) Connect the charging hose of piezometer to the refrigerant charging vent of gas valve and then connect the other charging hose to the vacuum pump.

(3) Open the piezometer completely and operate for 10-15min to check if the pressure of piezometer remains in -0.1MPa.

(4) Close the vacuum pump and maintain this status for 1-2min to check if the pressure of piezometer remains in -0.1MPa. If the pressure decreases, there may be leakage.

(5) Remove the piezometer, open the valve core of liquid valve and gas valve completely with inner hexagon spanner.

(6) Tighten the screw caps of valves and refrigerant charging vent. (As show in Fig.26)

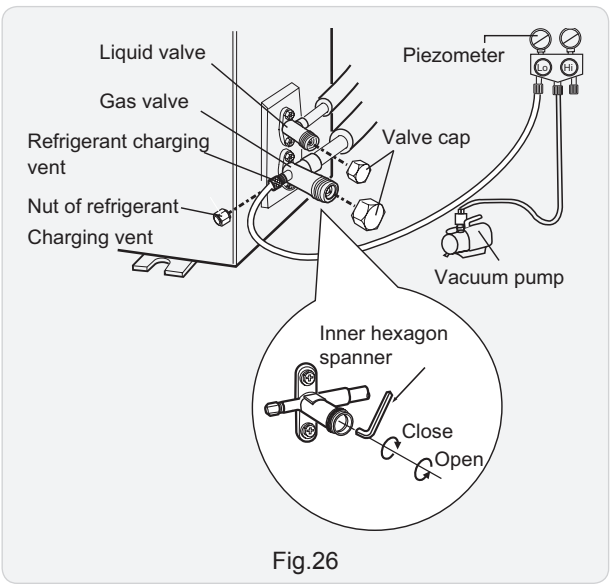


Fig.26

2. Leakage Detection

(1) With leakage detector:

Check if there is leakage with leakage detector.

(2) With soap water:

If leakage detector is not available, please use soap water for leakage detection. Apply soap water at the suspected position and keep the soap water for more than 3min. If there are air bubbles coming out of this position, There's a leakage.

8.8 Check after Installation and Test Operation

1. Check after Installation

Check according to the following requirement after finishing installation.

NO.	Items to be checked	Possible malfunction
1	Has the unit been installed firmly?	The unit may drop, shake or emit noise.
2	Have you done the refrigerant leakage test?	It may cause insufficient cooling (heating) capacity.
3	Is heat insulation of pipeline sufficient?	It may cause condensation and water dripping.
4	Is water drained well?	It may cause condensation and water dripping.
5	Is the voltage of power supply according to the voltage marked on the nameplate?	It may cause malfunction or damage the parts.
6	Is electric wiring and pipeline installed correctly?	It may cause malfunction or damage the parts.
7	Is the unit grounded securely?	It may cause electric leakage.
8	Does the power cord follow the specification?	It may cause malfunction or damage the parts.
9	Is there any obstruction in air inlet and air outlet?	It may cause insufficient cooling (heating) capacity.
10	The dust and sundries caused during installation are removed?	It may cause malfunction or damaging the parts.
11	The gas valve and liquid valve of connection pipe are open completely?	It may cause insufficient cooling (heating) capacity.
12	Is the inlet and outlet of piping hole been covered?	It may cause insufficient cooling(heating) capacity or waster eletricity.

2. Test Operation

(1) Preparation of test operation

- The client approves the air conditioner installation.
- Specify the important notes for air conditioner to the client.

(2) Method of test operation

- Put through the power, press ON/OFF button on the remote controller to start operation.
- Press MODE button to select AUTO, COOL, DRY, FAN and HEAT to check whether the operation is normal or not.
- If the ambient temperature is lower than 16℃ , the air conditioner can't start cooling.

9. Maintenance

9.1 Error Code List

Error code	Malfunction name	AC status	Possible causes
C5	Malfunction of jumper cap	The complete unit stops operation	1. Jumper cap is not installed in control panel; 2. Poor contact of jumper cap; 3. Jumper cap is damaged; 4. The tested circuit of jumper cap on control panel is abnormal.
E6	Communication malfunction between indoor unit and outdoor unit	Cool: compressor stops operation, while indoor fan operates; Heat: all loads stops operation.	See “Communication malfunction”
H5	IPM protection	Cool/Dry: compressor stops operation, while indoor fan operates. Heat: all loads stops operation.	See “IPM protection, over-phase current of compressor”
L3 LA	Malfunction of outdoor fan/ malfunction of DC motor	Cool/Dry: all loads stops operation except indoor fan. Heat: all loads stops operation.	1. Outdoor condenser, air inlet and air outlet are blocked by filth or dirt; 2. Fan is blocked or loosened; 3. Motor or connection wire of motor is damaged; 4. Main board of outdoor unit is damaged; (As for dual-outdoor fan, L3 indicates fan 1; LA indicates fan 2)
H3	Overload protection of compressor	Cool/Dry: compressor stops operation, while indoor fan operates. Heat: all loads stops operation.	1. Overload wire of compressor is loose; 2. The overload protector is damaged. Under normal circumstances, the resistance between both ends of terminal is less than 1ohm. 3.See “Overload protection of compressor , High discharge temperature protection of compressor”
F0	Refrigerant insufficient protection, cut-off protection of refrigerant	Cool: compressor and outdoor fan stops operation, while indoor fan operates; Heat: Compressor, outdoor fan and indoor fan stops operation.	1. Is system cooling under high humidity environment, thus temperature difference of heat transfer is small; 2. Check whether the big valve and small valve of outdoor unit are opened completely; 3. Is the temperature sensor of evaporator of indoor unit loose? 4. Is the temperature sensor of condenser of outdoor unit loose? 5. Is the capillary or the electronic expansion valve blocked? 6. Is refrigerant leaking?
F1	Indoor ambient temperature sensor is open/short-circuited	Cool/Dry: indoor fan operates, while compressor and outdoor fan stops operation; Heat: all loads stops operation.	1. Temperature sensor is not well connected; 2. Temperature sensor is damaged 3. Main board of indoor unit is damaged.
F2	Indoor evaporator temperature sensor is open/short-circuited	Cool/Dry: indoor fan operates, while compressor and outdoor fan stops operation; Heat: all loads stops operation.	1. Temperature sensor is not well connected; 2. Temperature sensor is damaged 3. Main board of indoor unit is damaged.
H6	No feedback from indoor unit’s motor	The complete unit stops operation	1. Is the fan blocked? 2. Is the motor terminal loose? 3. Is the connection wire of motor damaged? 4. Is the motor damaged? 5. Is the main board of indoor unit damaged?
LP	Indoor unit and outdoor can be matched with each other	Heat: compressor, outdoor unit and indoor fan stops operation.	Capacity of indoor unit and outdoor unit can’t be matched.
C4	Malfunction of jumper cap of outdoor unit	Heat: all loads are stopped; other modes: outdoor unit stops operation.	Jumper cap of outdoor unit hasn’t been installed.
b7	Gas valve temperature sensor is ON / short-circuited		1. Temperature sensor is not well connected or damaged; 2. The wire of temperature sensor is damaged, causing short circuit to copper pipe or outer casing; 3. Main board of outdoor unit is damaged.

Error code	Malfunction name	AC status	Possible causes
b5	Liquid valve temperature sensor is ON / short-circuited		1. Temperature sensor is not well connected or damaged; 2. The wire of temperature sensor is damaged, causing short circuit to copper pipe or outer casing; 3. Main board of outdoor unit is damaged.
E1	High pressure protection of system	Cool/Dry: all loads stops operation except indoor fan; Heat: all loads stops operation.	1. Heat exchange of outdoor unit is too dirty, or it blocked the air inlet/outlet; 2. Is power voltage normal; (three-phase unit) 3. Ambient temperature is too high; 4. Wiring of high pressure switch is loose or high pressure switch is damaged; 5. The internal system is blocked; (dirt blockage, ice blockage, oil blockage, angle valve is not completely opened) 6. Main board of outdoor unit is damaged; 7. Refrigerant is too much.
E3	Low pressure/low system pressure protection/ compressor low pressure protection	Cool: compressor, outdoor fan and indoor fan stop operation; Heat: compressor and outdoor fan stop operation at first. About 1min later, indoor fan stops operation; 2mins later, the 4-way valve stop operation.	1. Low pressure switch is damaged; 2. Refrigerant inside the system is insufficient.
E4	High discharge temperature protection of compressor	Cool/Dry: compressor and outdoor fan stops operation, while indoor fan operates; Heat: all loads stops operation.	See “Overload protection of compressor , High discharge temperature protection of compressor”
E5	AC overcurrent protection	Cool/Dry: compressor and outdoor fan stops operation, while indoor fan operates; Heat: all loads stops operation.	1. Power voltage is unstable; 2. Power voltage is too low; 3. System load is too high, which leads to high current; 4. Heat exchange of indoor unit is too dirty, or it blocked the air inlet/outlet; 5. Fan motor operation is abnormal; the fan speed is too low or not functioning; 6. Compressor is blocked; 7. The internal system is blocked; (dirt blockage, ice blockage, oil blockage, angle valve is not completely opened) 8. Main board of outdoor unit is damaged. See “AC overcurrent protection”
E7	Mode shock/sysmte mode shock	Load of indoor unit stops operation (indoor fan, E-heater, swing)	Malfunction of one-to-more system; there may be two indoor units which has set the shock mode, such as one is cooling and the other is heating.
E8	High temperature prevention protection	Cool: compressor stops operation while indoor fan operates; Heat: all loads stops operation.	See “High temperature prevention protection; high power; system isabnormal”
EE	Malfunction of EEPROM	Cool/Dry: compressor stops operation, while indoor fan operates; Heat: all loads stops operation.	Main board of outdoor unit is damaged.
Fo	Refrigerant-recovery mode	Cool/Dry: compressor and outdoor fan stops operation, while indoor fan operates.	Refrigerant recovery. The maintenance personnel operate it when he is maintaining the unit.
F3	Outdoor ambient temperature is open/short-circuited	Cool/Dry: compressor and outdoor fan stop operation, while indoor fan operates; Heat: all loads stops operation.	1. Temperature sensor is not connected well or damaged; 2.Temperature sensor wire of outdoor unit is damaged; short circuit between the temperature sensor and copper pipe or outer case 3.Main board of outdoor unit is damaged;

Error code	Malfunction name	AC status	Possible causes
F4	Outdoor condenser temperature sensor is open/short-circuited	Cool/Dry: compressor and outdoor fan stop operation, while indoor fan operates; Heat: after operating for 3mins, all loads stops operation.	1. Temperature sensor is not connected well or damaged; 2. Temperature sensor wire of outdoor unit is damaged; short circuit between the temperature sensor and copper pipe or outer case; 3. Main board of outdoor unit is damaged.
F5	Outdoor air discharge temperature is open/short-circuited	Complete unit stops operation; motor of sliding door is cut off power.	1. The exhaust temperature sensor is not connected well or damaged. 2.Temperature sensor wire of outdoor unit is damaged; short circuit between the temperature sensor and copper pipe or outer case 3.Main board of outdoor unit is damaged;
FC	Malfunction of micro switch	Cool/Dry: compressor stops operation, while indoor fan operates; Heat: all loads stops operation.	1. The sliding door is blocked; 2. Malfunction of the photoelectric inspection panel of sliding door;
H4	System is abnormal	Cool/Dry: all loads stops operation except indoor fan; Heat: all loads stops operation.	See “High temperature prevention protection; high power; system isabnormal”
H7	Desynchronizing of compressor	Cool/Dry: compressor stops operation, while indoor fan operates; Heat: all loads stops operation.	See “Desynchronization diagnosis for compressor”
HC	PFC protection	Cool/Dry: compressor stops operation, while indoor fan operates; Heat: all loads stops operation.	1. The power grid quality is bad; AC input voltage fluctuates sharply; 2. Power plug of air conditioner or wiring board or reactor is not connected reliably; 3. Indoor and outdoor heat exchanger is too dirty, or air inlet/outlet is blocked; 4. Main board of outdoor unit is damaged.
HE	Demagnetization protection of compressor	Cool: compressor and outdoor fan stop operation; Heat: compressor and outdoor fan stop operation at first; about 1min later, indoor fan stops operation.	1. The main board of outdoor unit is damaged; 2. Compressor is damaged;
JF	Communication malfunction between indoor unit and inspection board	Normal operation	1. Poor connection between the indoor unit and the inspection board. 2.The main board of indoor unit is damaged; 3. The inspection board is damaged;
L1	Malfunction of humidity sensor	Compressor, outdoor fan and indoor fan stop operation;	The inspection board is damaged.
L9	High power protection	Cool: compressor and outdoor fan stops operation, while indoor fan operates.	See “High temperature prevention protection; high power; system is abnormal”
Lc	Start-up failed	Cool/Dry: compressor stops, while indoor fan operates; Heat: all loads stops operation.	See “Malfunction diagnosis for failure startup”
Ld	Lost phase	Cool: compressor and outdoor fan stop operation; Heat: compressor and outdoor fan stop operation at first; about 1min later, indoor fan stops operation.	1. The main board of outdoor unit is damaged; 2. The compressor is damaged; 3. The connection wire of compressor is not connected well.
P5	Over-phase current protection of compressor	Cool/Dry: compressor stops operation, while indoor fan operates; Heat: all loads stops operation.	See “Overload protection of compressor , High discharge temperature protection of compressor”

Error code	Malfunction name	AC status	Possible causes
oE	Undefined outdoor unit error	Cool: compressor and outdoor fan stops operation, while indoor fan operates; Heat: compressor, outdoor fan and indoor fan stop operation.	1. Outdoor ambient temperature exceeds the operation range of unit (eg: less than-20°C or more than 60°C for cooling; more than 30°C for heating); 2. Are wires of compressor not connected tightly? 3. Failure startup of compressor? 4. Is compressor damaged? 5. Is main board damaged?
P6	Communication malfunction between the drive board and the main board	Cool: compressor and outdoor fan stops operation; Heat: compressor and outdoor fan stop at first; about 1min later, indoor fan stops operation;	1. The drive board is damaged; 2. The main board of outdoor unit is damaged; 3. The drive board and the main board is not connected well.
P7	Circuit malfunction of module temperature sensor	Cool/Dry: compressor stops operation, while indoor fan operates; Heat: all loads stops operation.	Replace outdoor control board
P8	Module overheating protection	Cool: compressor stops operation, while indoor fan operates; Heat: all loads stops operation.	1. Air inlet / air outlet of outdoor unit are blocked by filth or dirt; 2. Condenser of outdoor unit is blocked by filth or dirt; 3. IPM screw of main board is not tightened; 4. Main board of outdoor unit is damaged;
PF	Malfunction of ambient temperature sensor of drive board	Cool: compressor, outdoor fan and indoor fan stop operation; Heat: compressor and outdoor fan stop operation at first; about 1min later, indoor fan stops operation.	1. The ambient temperature sensor of the drive board is not connected well; 2. Malfunction of the ambient temperature sensor of drive board.
PH	DC bus voltage is too high	Cool/Dry: compressor stops operation, while indoor fan operates; Heat: all loads stops operation.	1. Measure the voltage between position L and position N on the wiring board (XT). If it's higher than 265 VAC, please turn on the unit until the power voltage is decreased to the normal range; 2. If the AC input is normal, please replace the outdoor control board.
PL	DC bus voltage is too low	Cool/Dry: compressor stops operation, while indoor fan operates; Heat: all loads stops operation.	1. Measure the voltage between position L and position N on the wiring board (XT). If it's lower than 150 VAC, please turn on the unit until the power voltage is increased to the normal range; 2. If the AC input is normal, please replace the outdoor control board.
PU	Charging malfunction of capacitor	Cool/Dry: compressor stops operation, while indoor fan operates; Heat: all loads stops operation.	See "Charging malfunction of capacitor"
rF	Malfunction of RF module	Cool: compressor and outdoor fan stop operation; Heat: compressor and outdoor fan stop operation at first; about 1min later, indoor fan stops operation.	1. The connection wire of RF module is not connected well. 2. Malfunction of RF module;
U1	Phase current detection circuit malfunction of	Cool: compressor and outdoor fan stops operation, while indoor fan operates; Heat: compressor, outdoor fan and indoor fan stops operation.	The control board is damaged
U2	Lost phase protection of compressor	Cool: compressor and outdoor fan stop operation; Heat: compressor and outdoor fan stop operation at first; about 1min later, indoor fan stops operation.	1. The main board of outdoor unit is damaged; 2. The compressor is damaged; 3. The connection wire of compressor is not connected well.

Error code	Malfunction name	AC status	Possible causes
U3	DC bus voltage drop malfunction	Cool/Dry: compressor stops operation, while indoor fan operates; Heat: all loads stops operation.	The power voltage is unstable.
U5	Current detection malfunction of unit	Cool: compressor and outdoor fan stops operation, while indoor fan operates; Heat: compressor, outdoor fan and indoor fan stops operation.	1. Is the complete unit lacking of refrigerant? 2. There's malfunction for the circuit of control board of outdoor unit. Replace the control board of outdoor unit.
U7	4-way valve is abnormal	This malfunction occurs when the unit is heating. All loads stops operation.	1. Power voltage is lower than AC175V; 2. Wiring terminal of 4-way valve is loose or broken;3. 4-way valve is damaged. Replace the 4-way valve.
U8	Malfunction of zero-crossing signal of indoor unit	Compressor, outdoor fan and indoor fan stop operation.	1. The power is abnormal; 2. Main board of indoor unit is damaged.
U9	Zero-crossing malfunction of outdoor unit	Cool: compressor stops operation, while indoor fan operates; Heat: all loads stops operation.	Replace the control board of outdoor unit.
E2	Evaporator anti-freezing protection		Not error code, it is the status code in cooling process
E9	Anti cold air protection		Not error code, it is the status code in cooling process
	Defrosting	Heat indicator Flash once/10s	Not error code, it is the status code in cooling process

Analysis or processing of some of the malfunction display:

1. Compressor discharge protection

Possible causes: shortage of refrigerant; blockage of air filter; poor ventilation or air flow short pass for condenser; the system has noncondensing gas (such as air, water etc.); blockage of capillary assy (including filter); leakage inside four-way valve causes incorrect operation; malfunction of compressor; malfunction of protection relay; malfunction of discharge sensor; outdoor temperature too high.

Processing method: refer to the malfunction analysis in the above section.

2. Low voltage overcurrent protection

Possible cause: Sudden drop of supply voltage.

3.Communication malfunction

Processing method: Check if communication signal cable is connected reliably.

4. Sensor open or short circuit

Processing method: Check whether sensor is normal, connected with the corre sponding position on the controller and if damage of lead wire is found.

5. Compressor over load protection

Possible causes: insufficient or too much refrigrant; blockage of capillary and increase of suction temp.; improper running of compressor, burning in or stuck of bearing, damage of discharge valve; malfunction of protector.

Processing method: adjust refrigerant amount; replace the capillary; replace the compressor; use universal meter to check if the contactor of compress or is fine when it is not overheated, if not replace the protector.

6. System malfunction

i.e.overload protection.When tube temperature(Check the temperature of outdoor heat exchanger when cooling and check the temperatur e of indoor heat exchanger when heating) is too high, protection will be activated.

Possible causes: Outdoor temperature is too high when cooling; insufficient outdoor air circulation; refrigerant flow malfunction.

please refer to the malfunction analysis in the previous section for handling method .


7. IPM module protection

Processing method:Once the module malfunction happens,if it persists for a long time and can not be selfcanceled, cut off the power and turn off the unit,and then re-energize the unit again after about 10 min.After repeating the procedure for sever times, if the malfunction still exists,replace the module.

9.2 Procedure of Troubleshooting

1. Troubleshooting for jumper cap C5


Main check points:
(1) jumper cap (2) control board of indoor unit

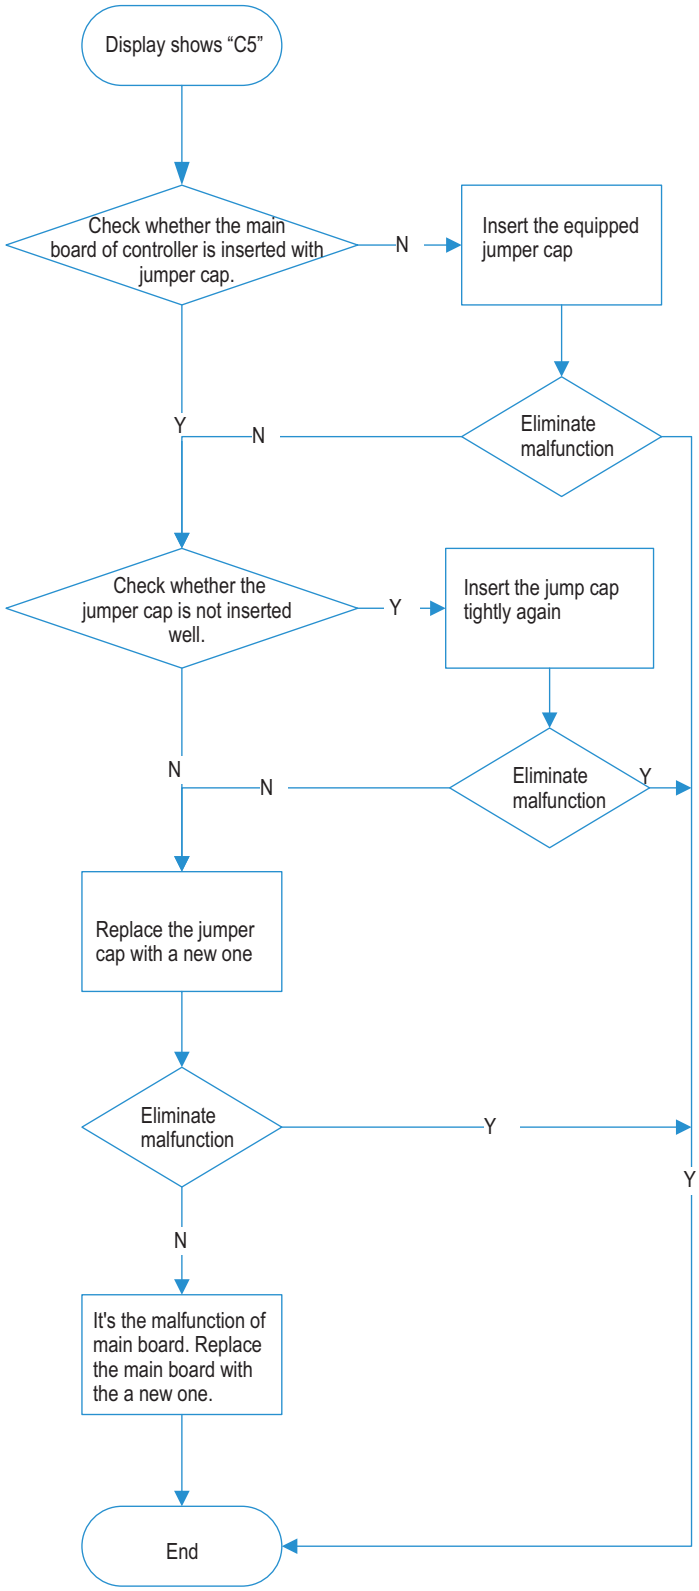

2. Communication malfunction E6

Main check points:


(1) Connection wire between indoor unit and outdoor unit
(2) Wiring inside the unit
(3) Communication circuit of control board of indoor unit
(4) Communication circuit of control board of outdoor unit

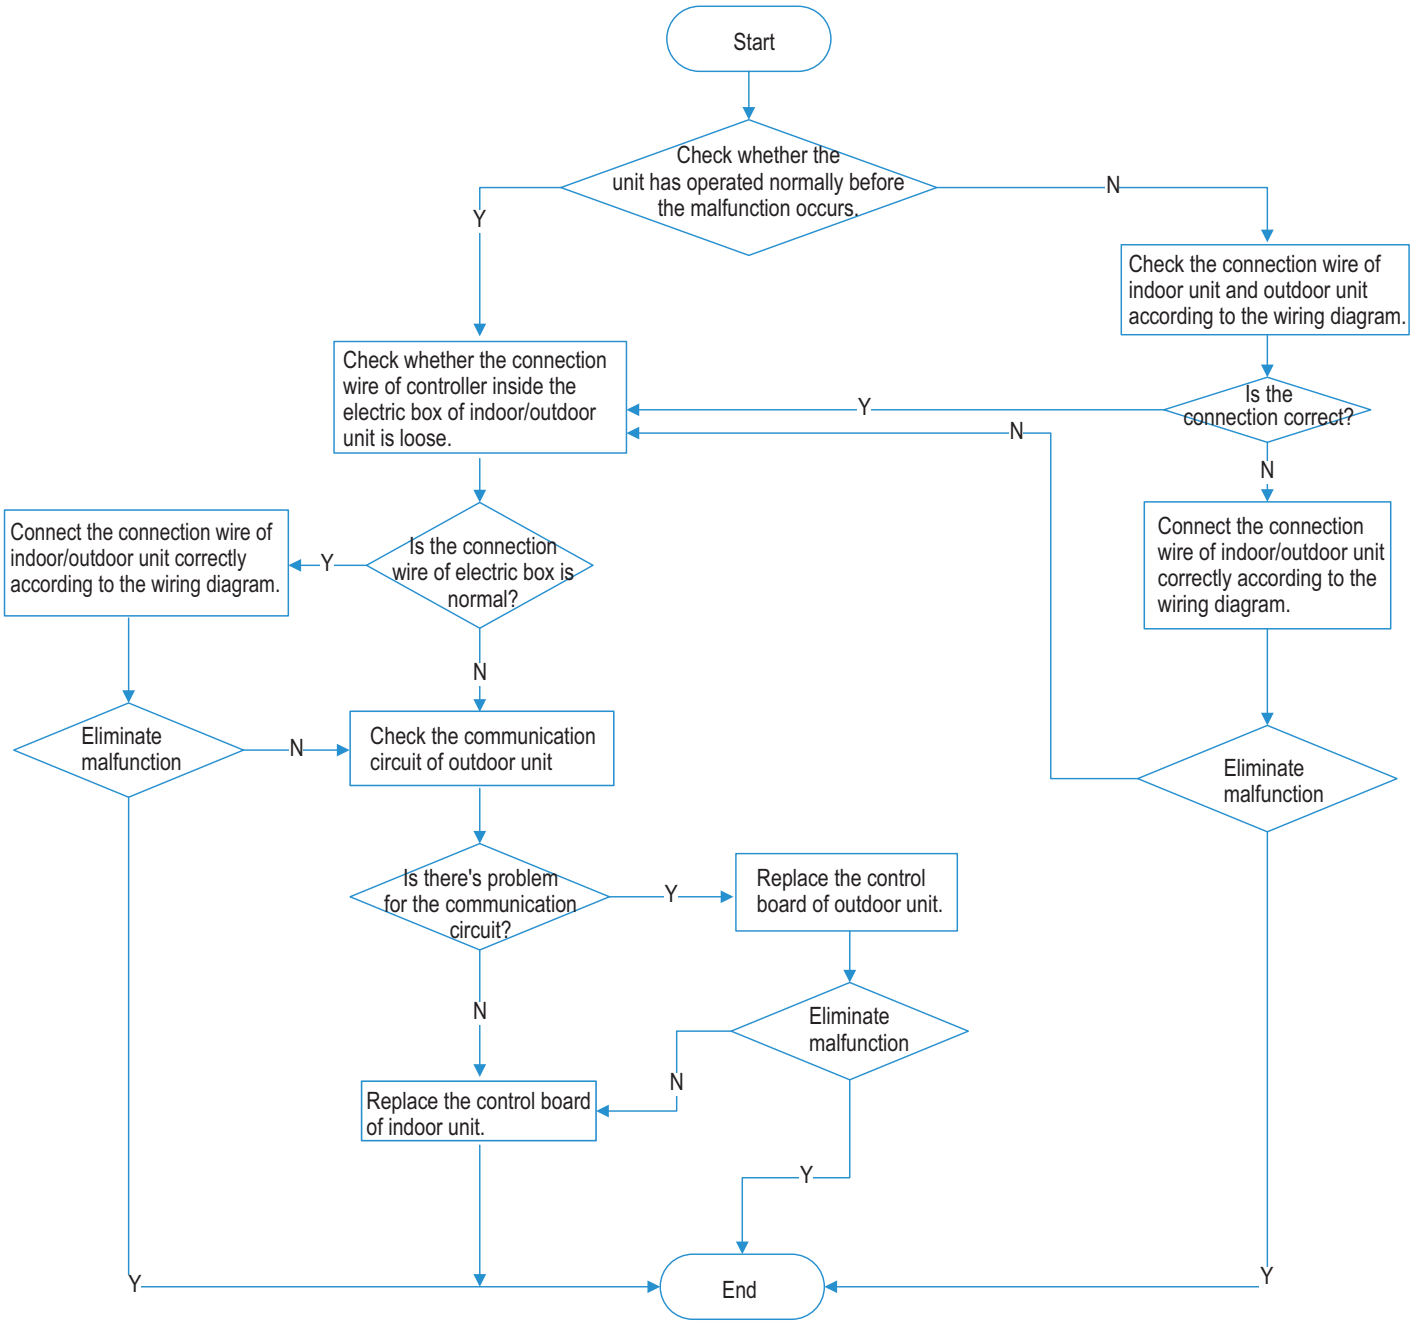

3. IPM protection H5, over-phase current of compressor P5

Main check points:
(1) compressor COMP terminal (2) power supply voltage (3) compressor
(4) charging amount of refrigerant (5) air inlet and air outlet of indoor/outdoor unit

NOTE:The control board as below means the control board of outdoor unit.

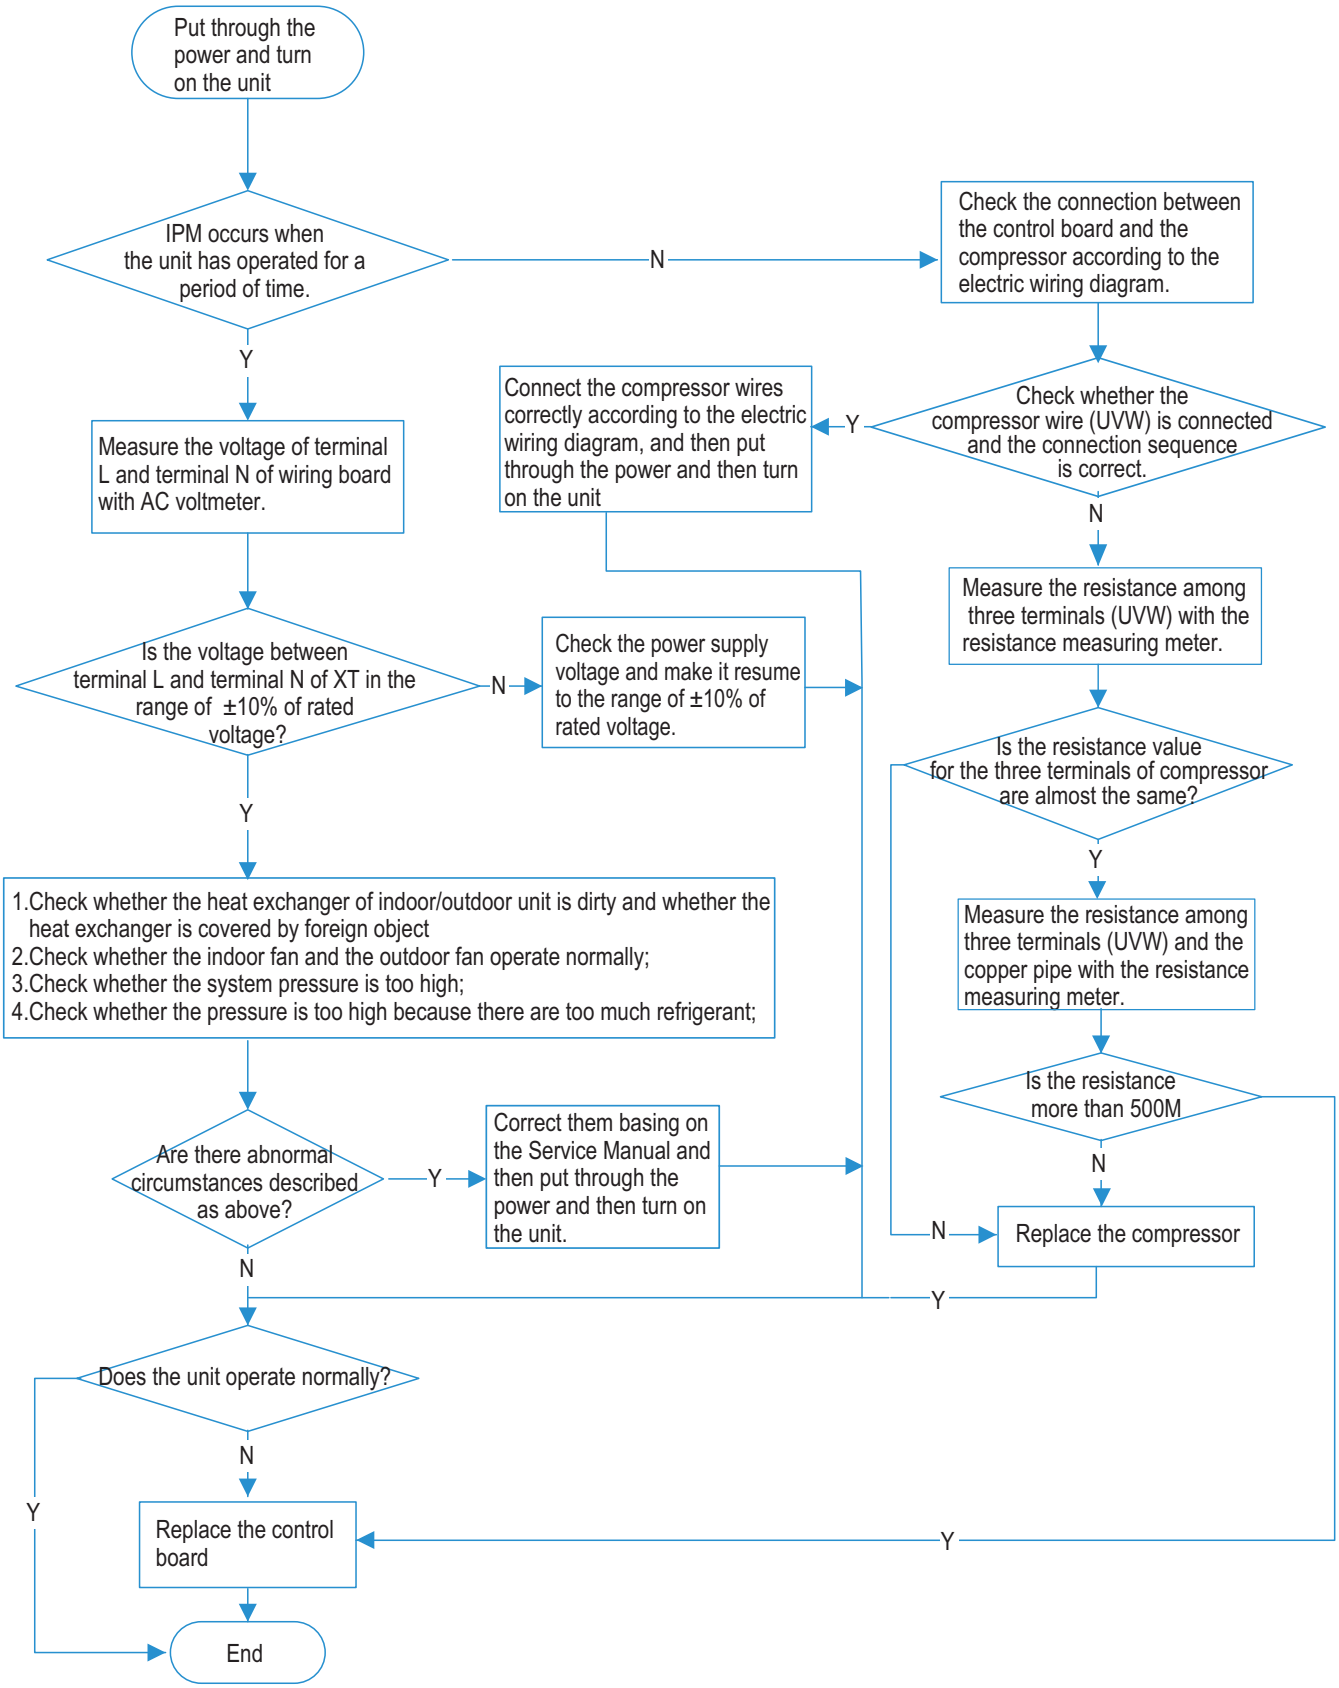


4. Overload protection of compressor H3, high discharge temperature, protection of compressor E4

Main check points:

(1) electronic expansion valve (2) expansion valve terminal


(3) charging amount of refrigerant (4) overload protector

NOTE:The control board as below means the control board of outdoor unit.

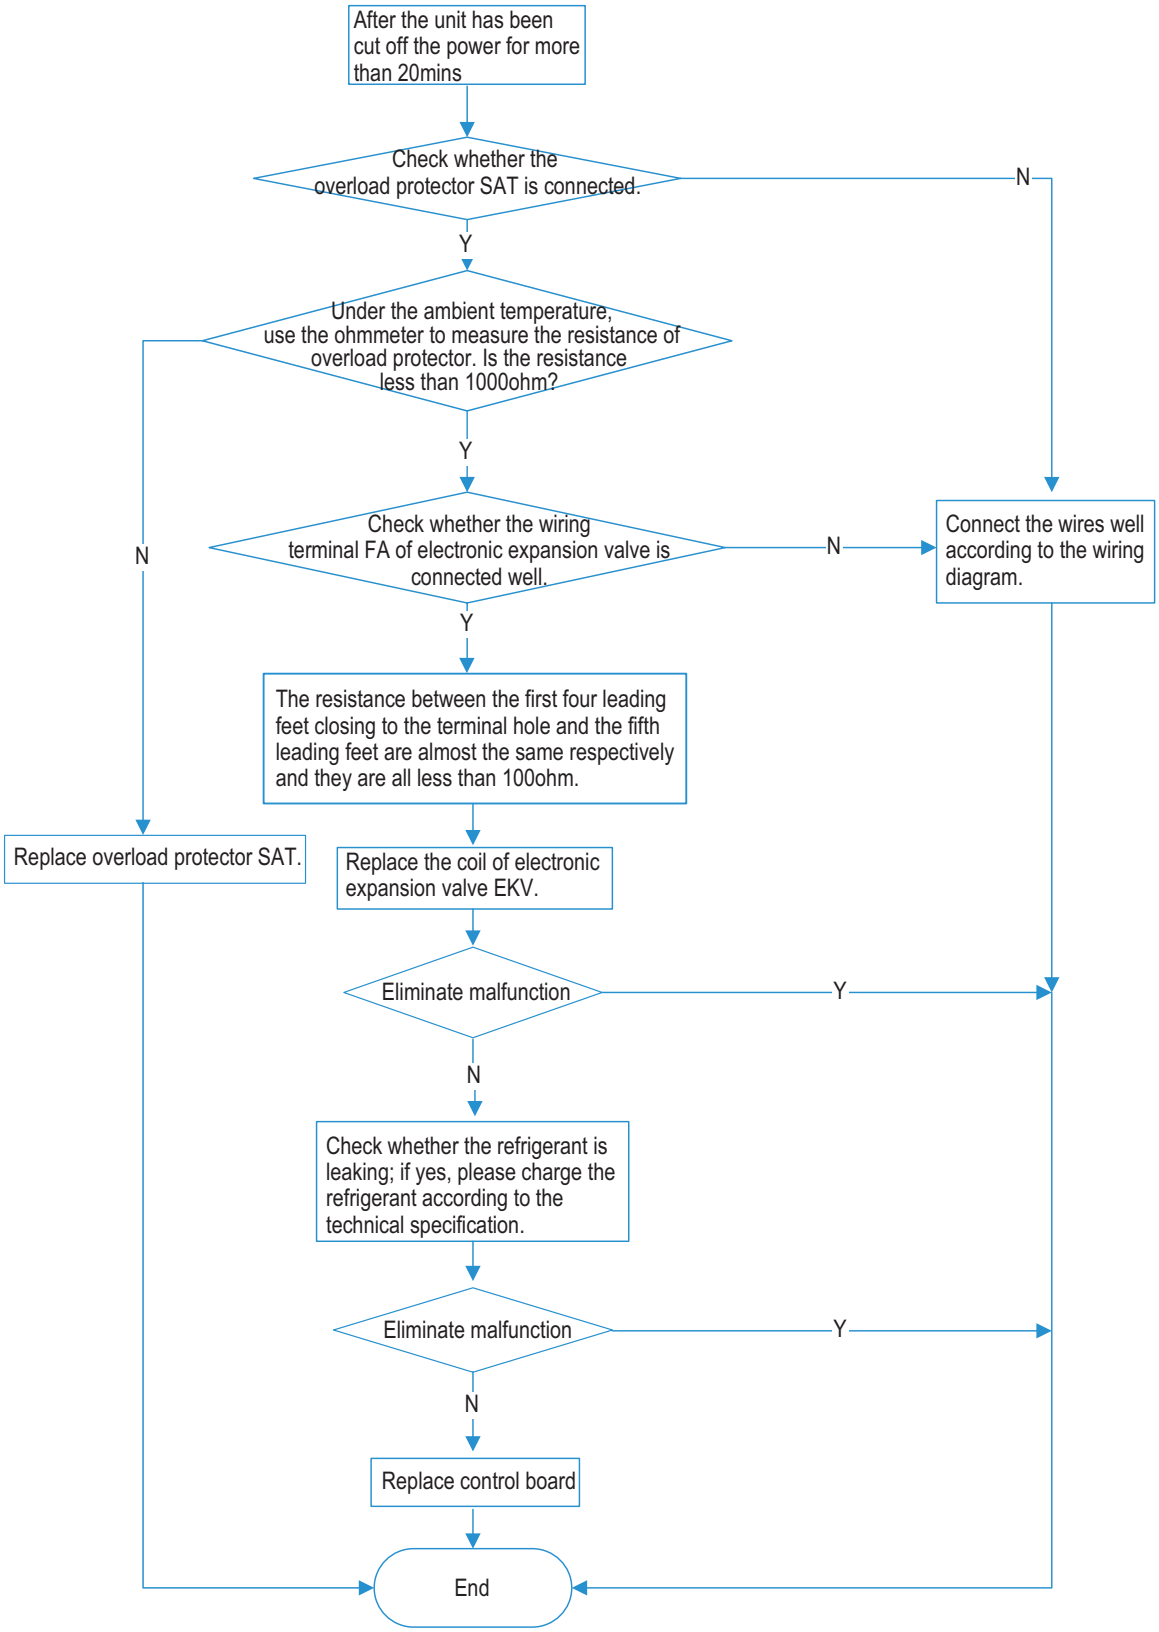

5.Troubleshooting for temperature sensor F 1,F2,F3,F4,F5

Main check points:
(1) connection terminal (2) temperature sensor (3) main board

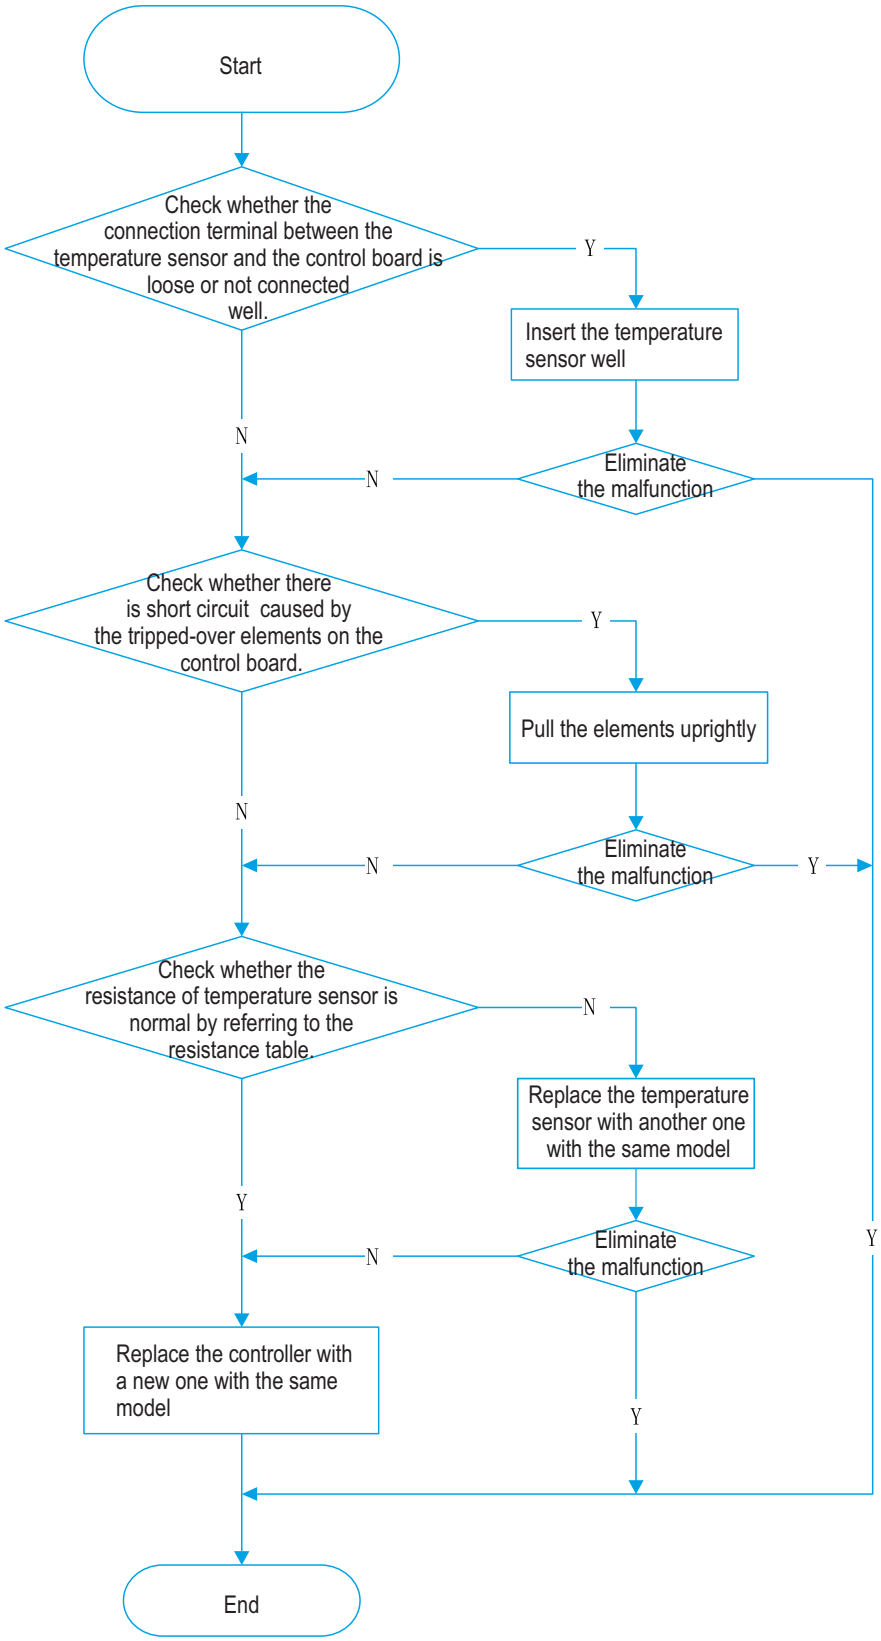


6.High temperature prevention protection E8; high power L9; system is abnormal H4

Main check points:

(1) outdoor temperature (2) fan (3)air inlet and air outlet of indoor/outdoor unit

NOTE:The control board as below means the control board of outdoor unit.

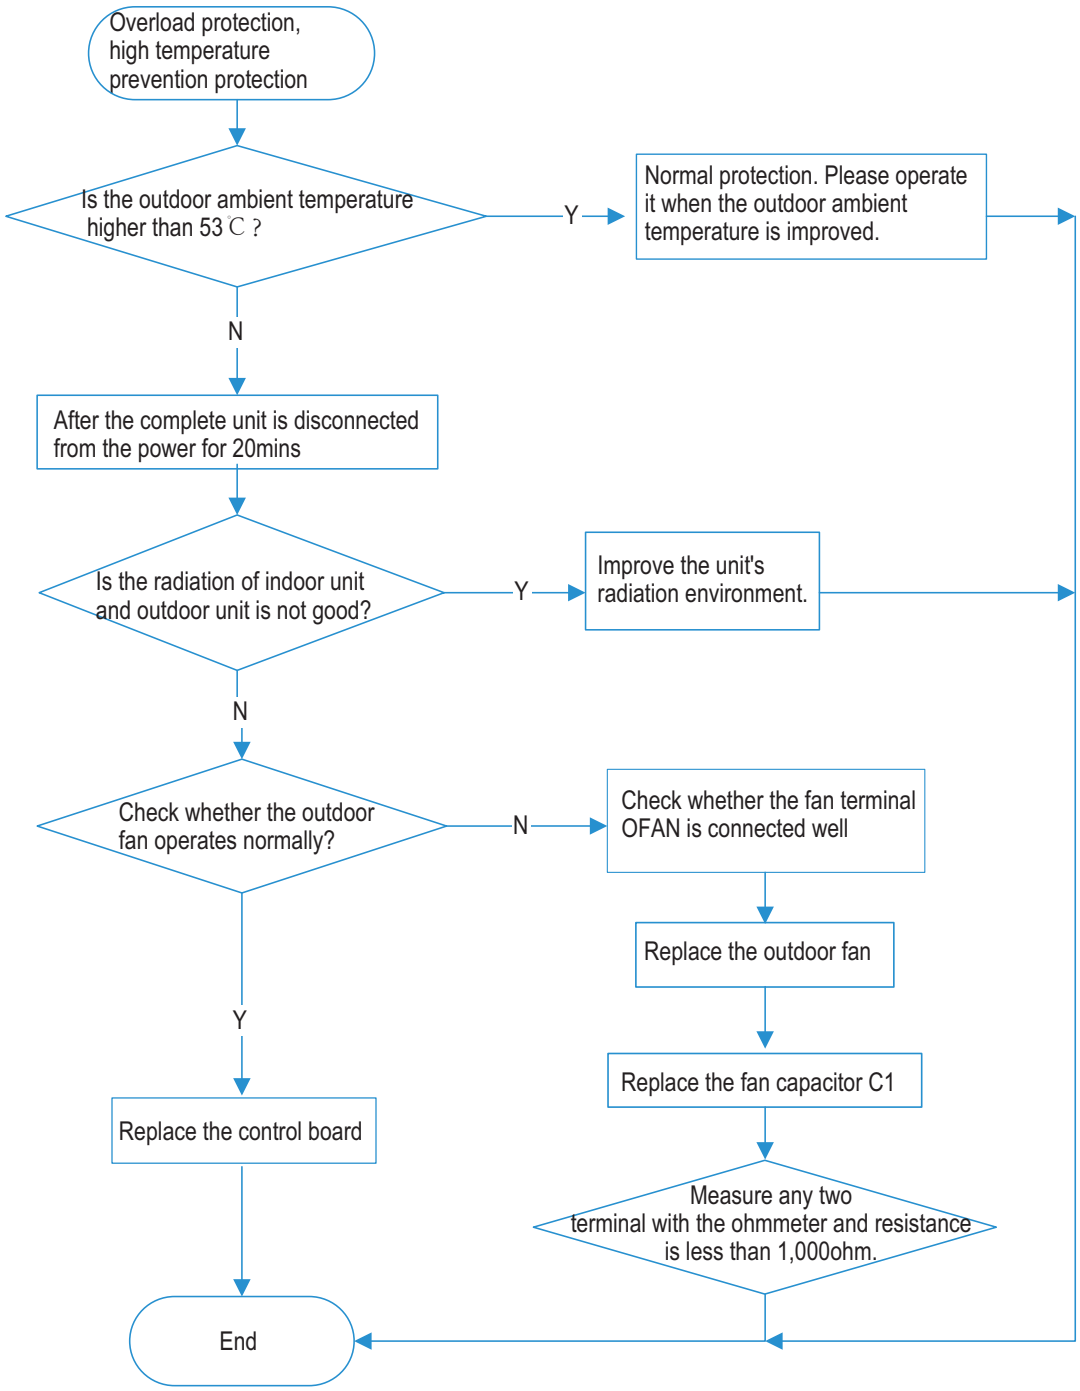


7.Desynchronization diagnosis for compressor H7

Main check point:

(1) system pressure (2) power supply voltage

NOTE:The control board as below means the control board of outdoor unit.

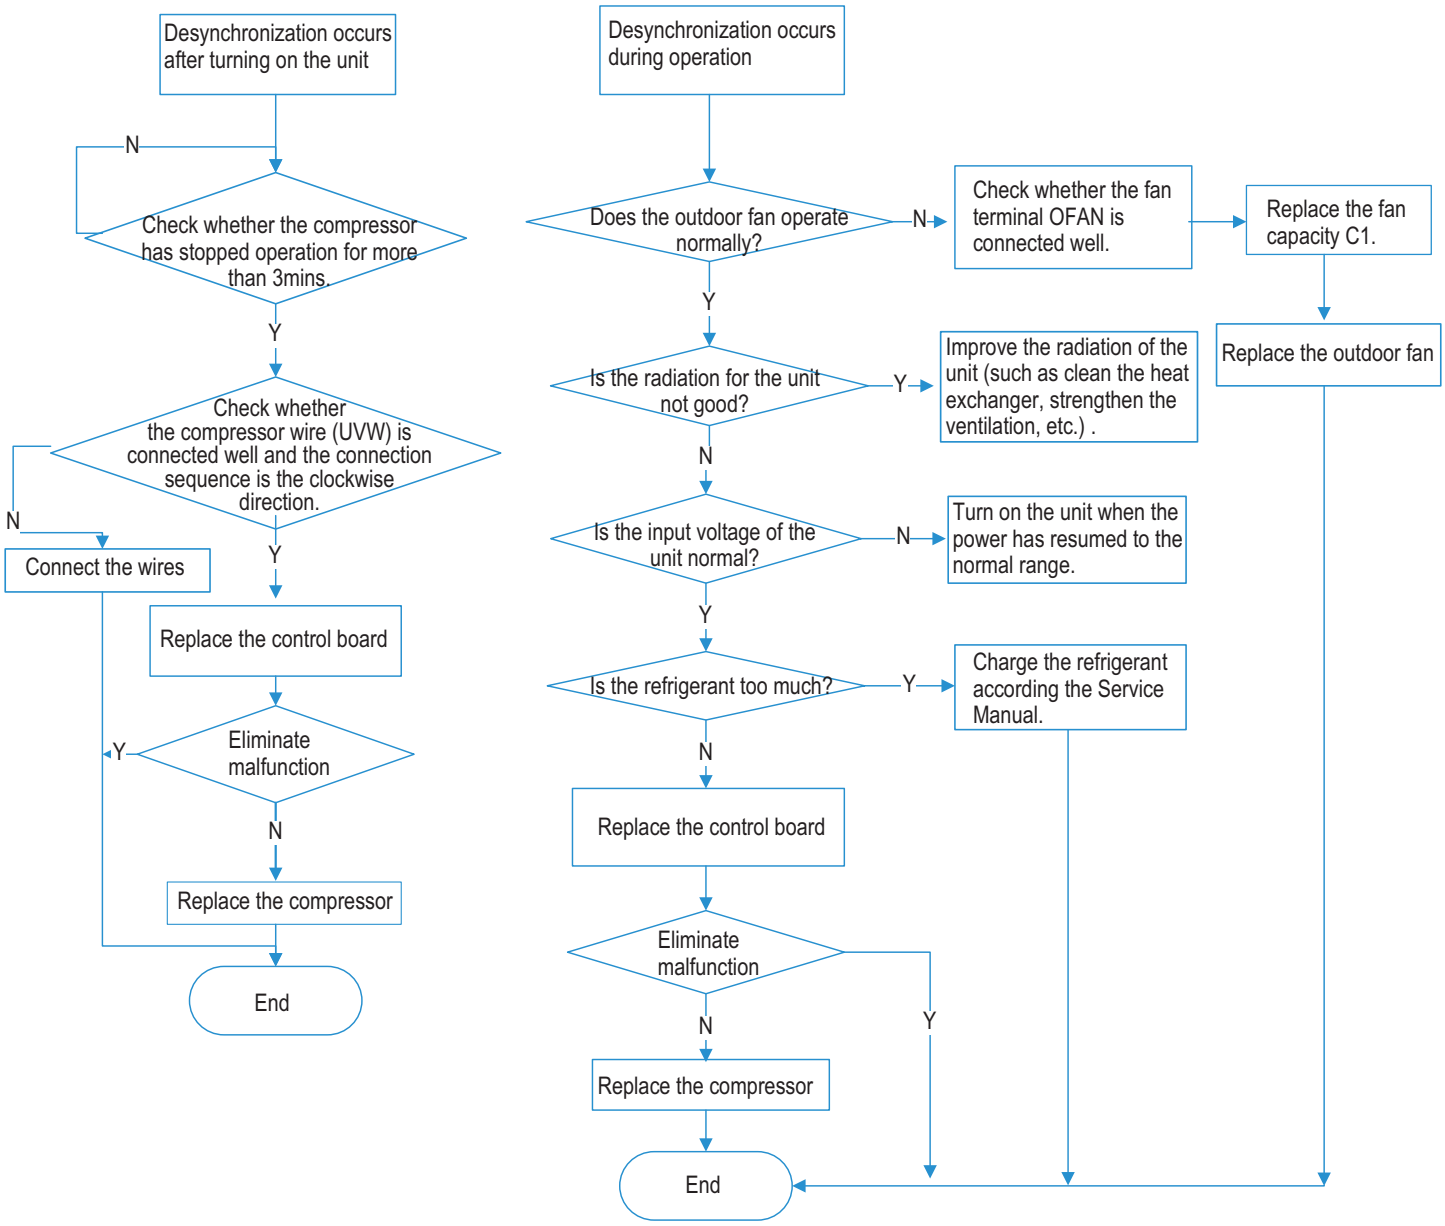


8.Malfunction diagnosis for failure startup Lc

Main check points:

(1) compressor wire (2) compressor (3) charging amount of refrigerant


NOTE:The control board as below means the control board of outdoor unit.

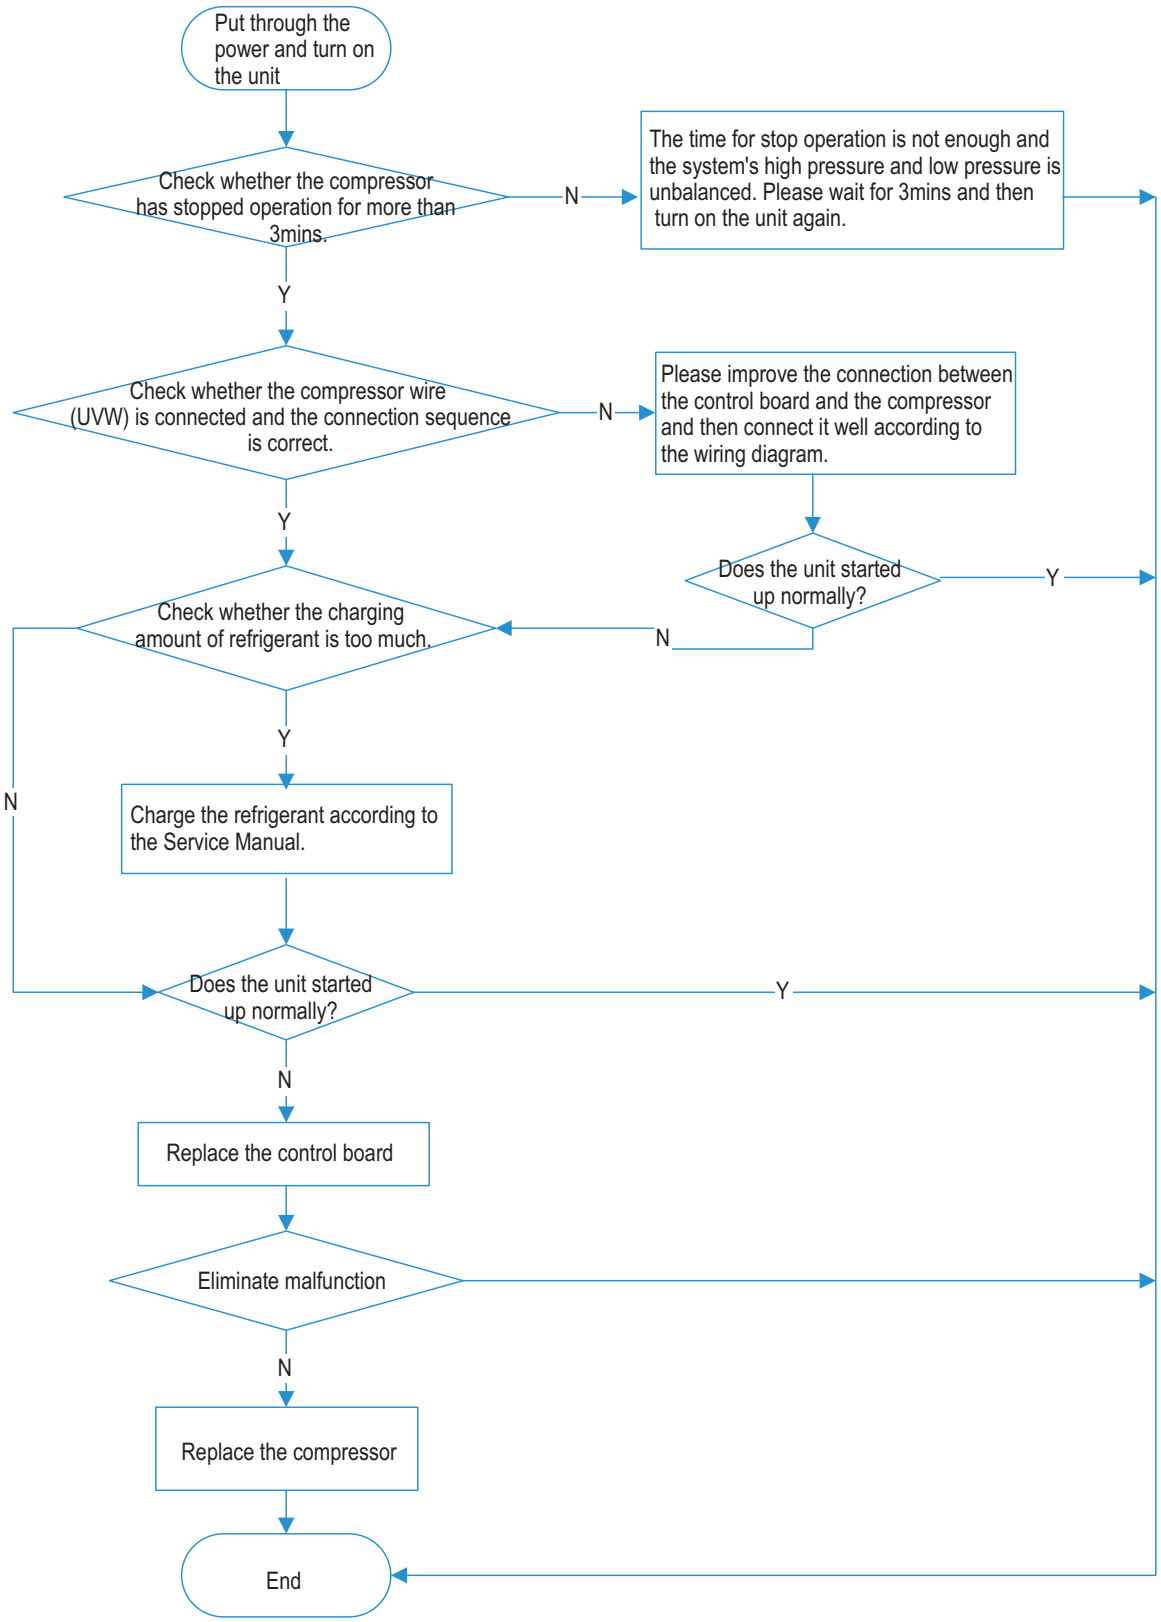

9. Charging malfunction of capacitor PU

Main check points:
(1) wiring board XT (2) reactor

NOTE:The control board as below means the control board of outdoor unit.

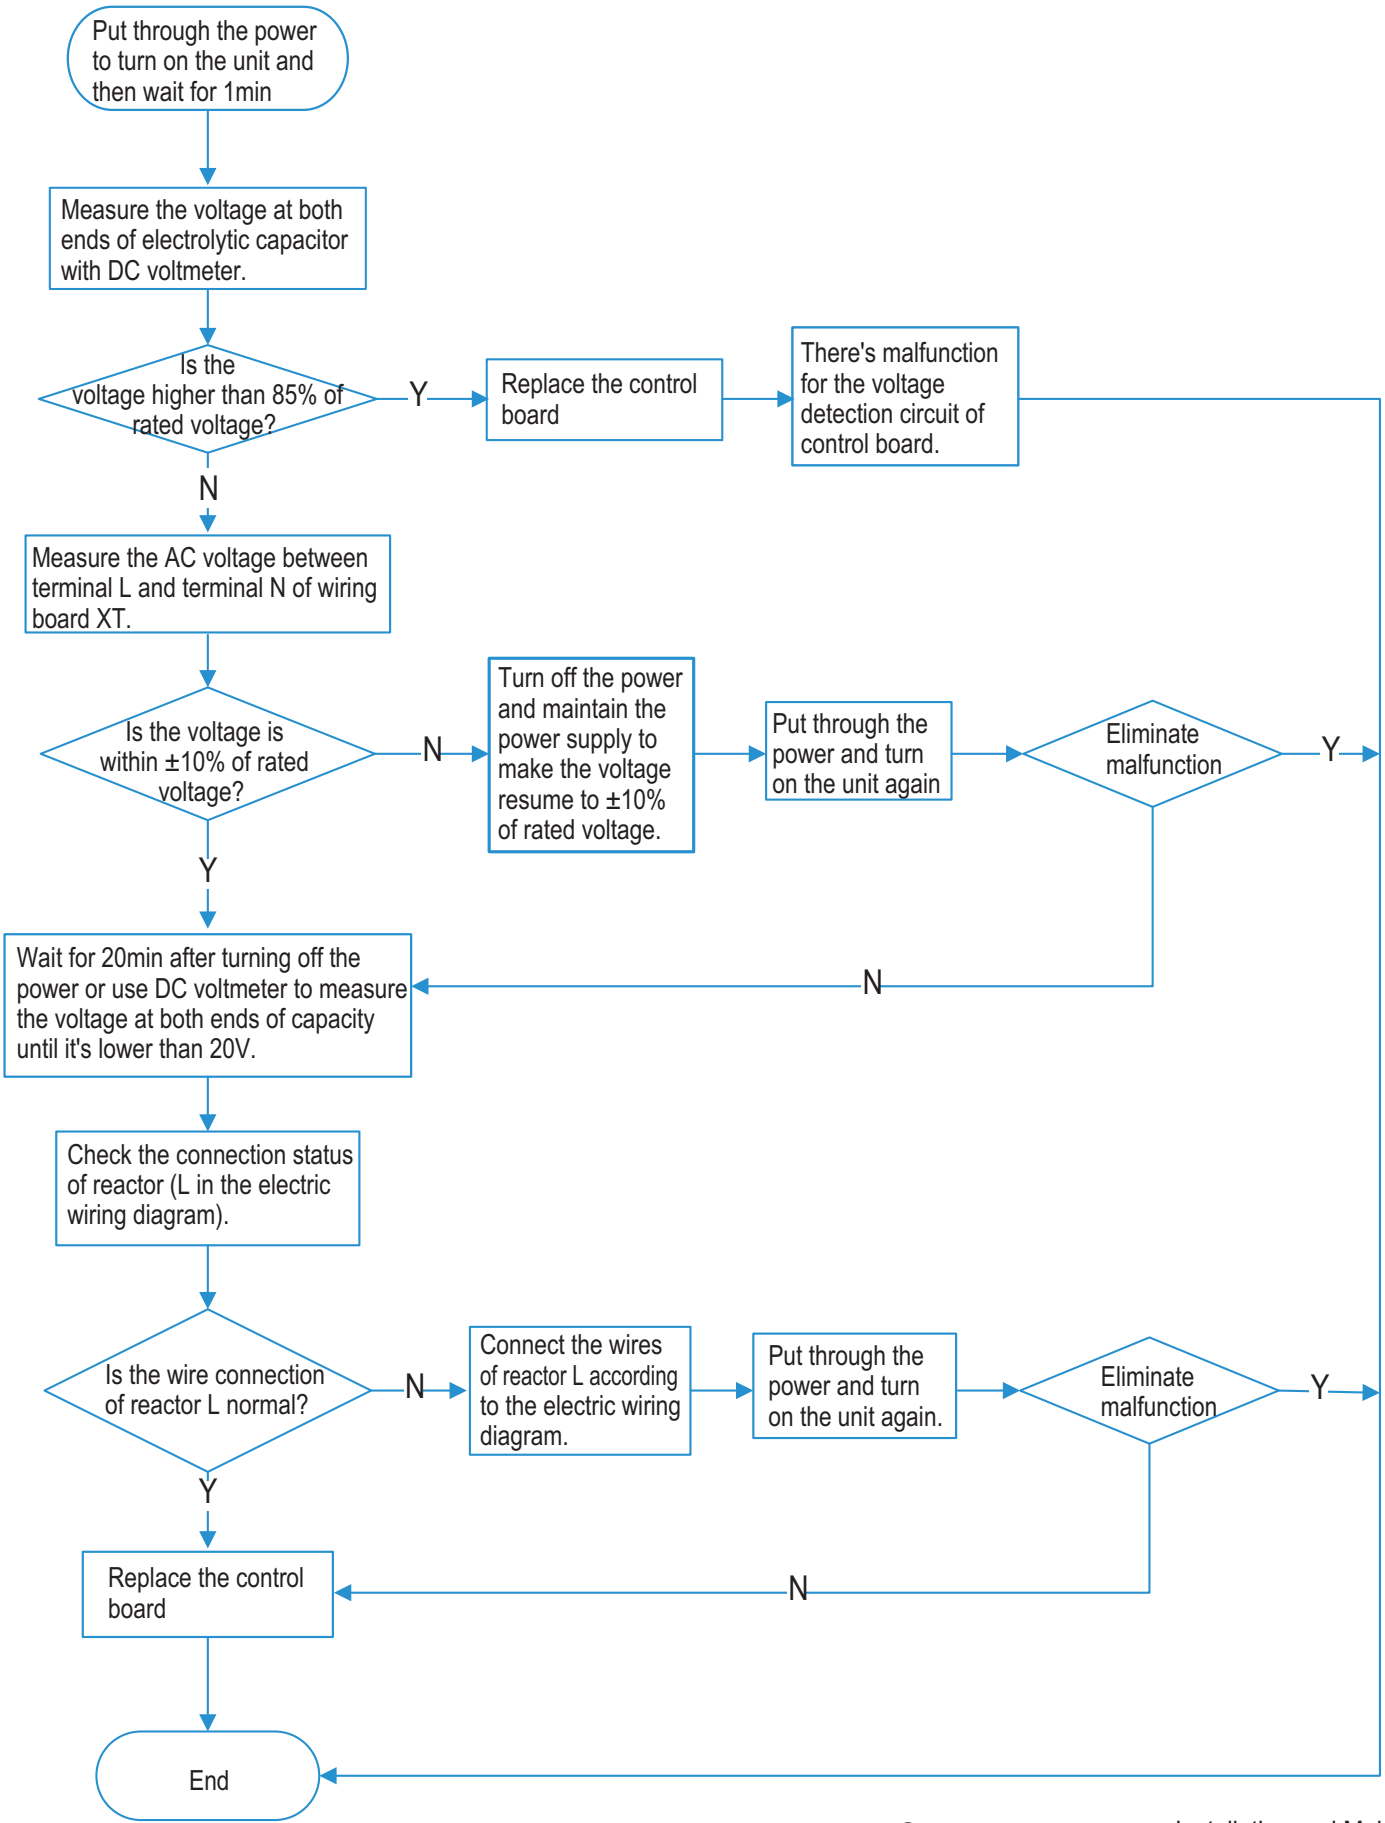


10. Troubleshooting-motor(indoor fan) doesn't operate H6


Main check points:

(1) connection terminal (2) motor (3) control board AP1 of indoor unit (4) blade


10.1 DC motor

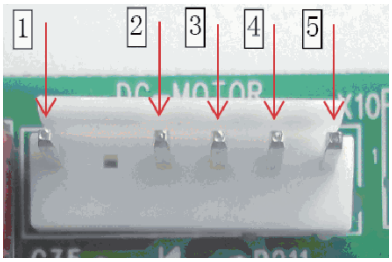

10.2 PG motor

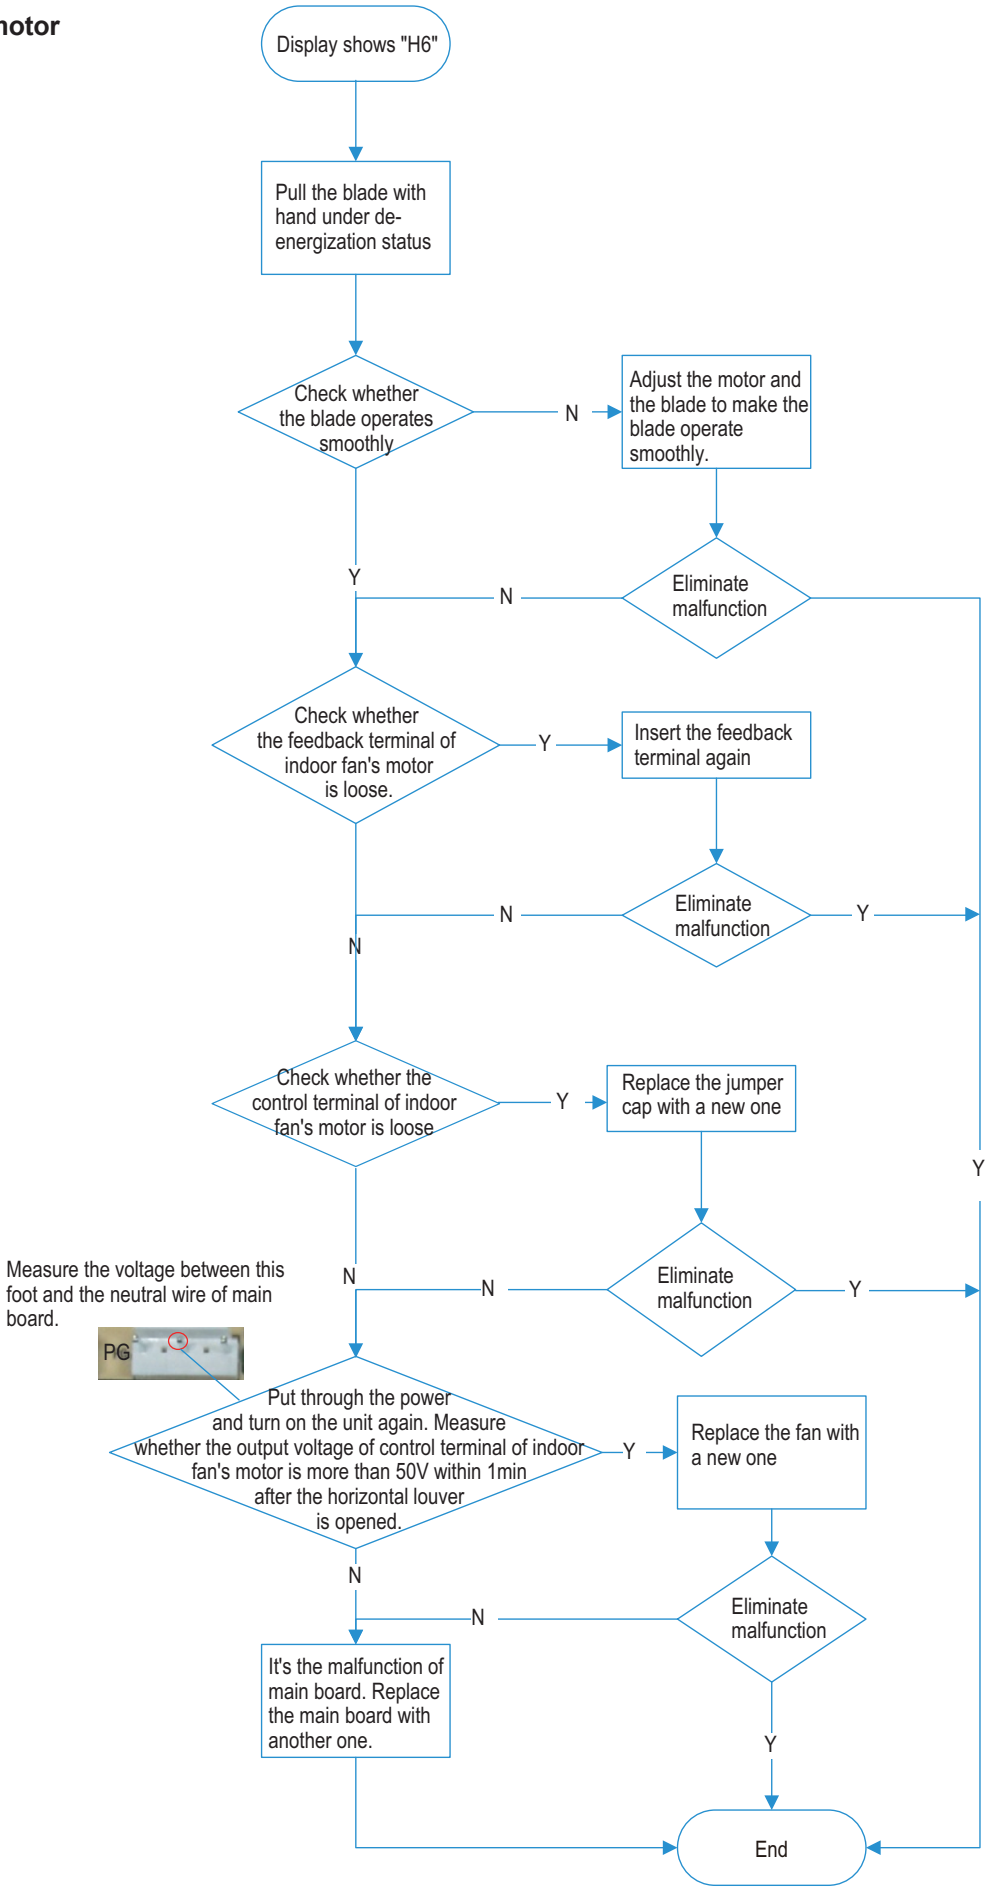
Display shows "H6"
Pull the blade with hand under de-energization status
Check whether the blade operates smoothly
N
Adjust the motor and the blade to make the blade operate smoothly.
Y
N
Eliminate malfunction
Check whether the feedback terminal of indoor fan's motor is loose.
Y
Insert the feedback terminal again
N
Eliminate malfunction
Y
N
Check whether the control terminal of indoor fan's motor is loose
Y
Replace the jumper cap with a new one
Y
Measure the voltage between this foot and the neutral wire of main board.
N
N
Eliminate malfunction
Y
PG
Put through the power and turn on the unit again. Measure whether the output voltage of control terminal of indoor fan's motor is more than 50V within 1min after the horizontal louver is opened.
Y
Replace the fan with a new one
N
N
Eliminate malfunction
It's the malfunction of main board. Replace the main board with another one.
Y
End

11. AC overcurrent protection E5

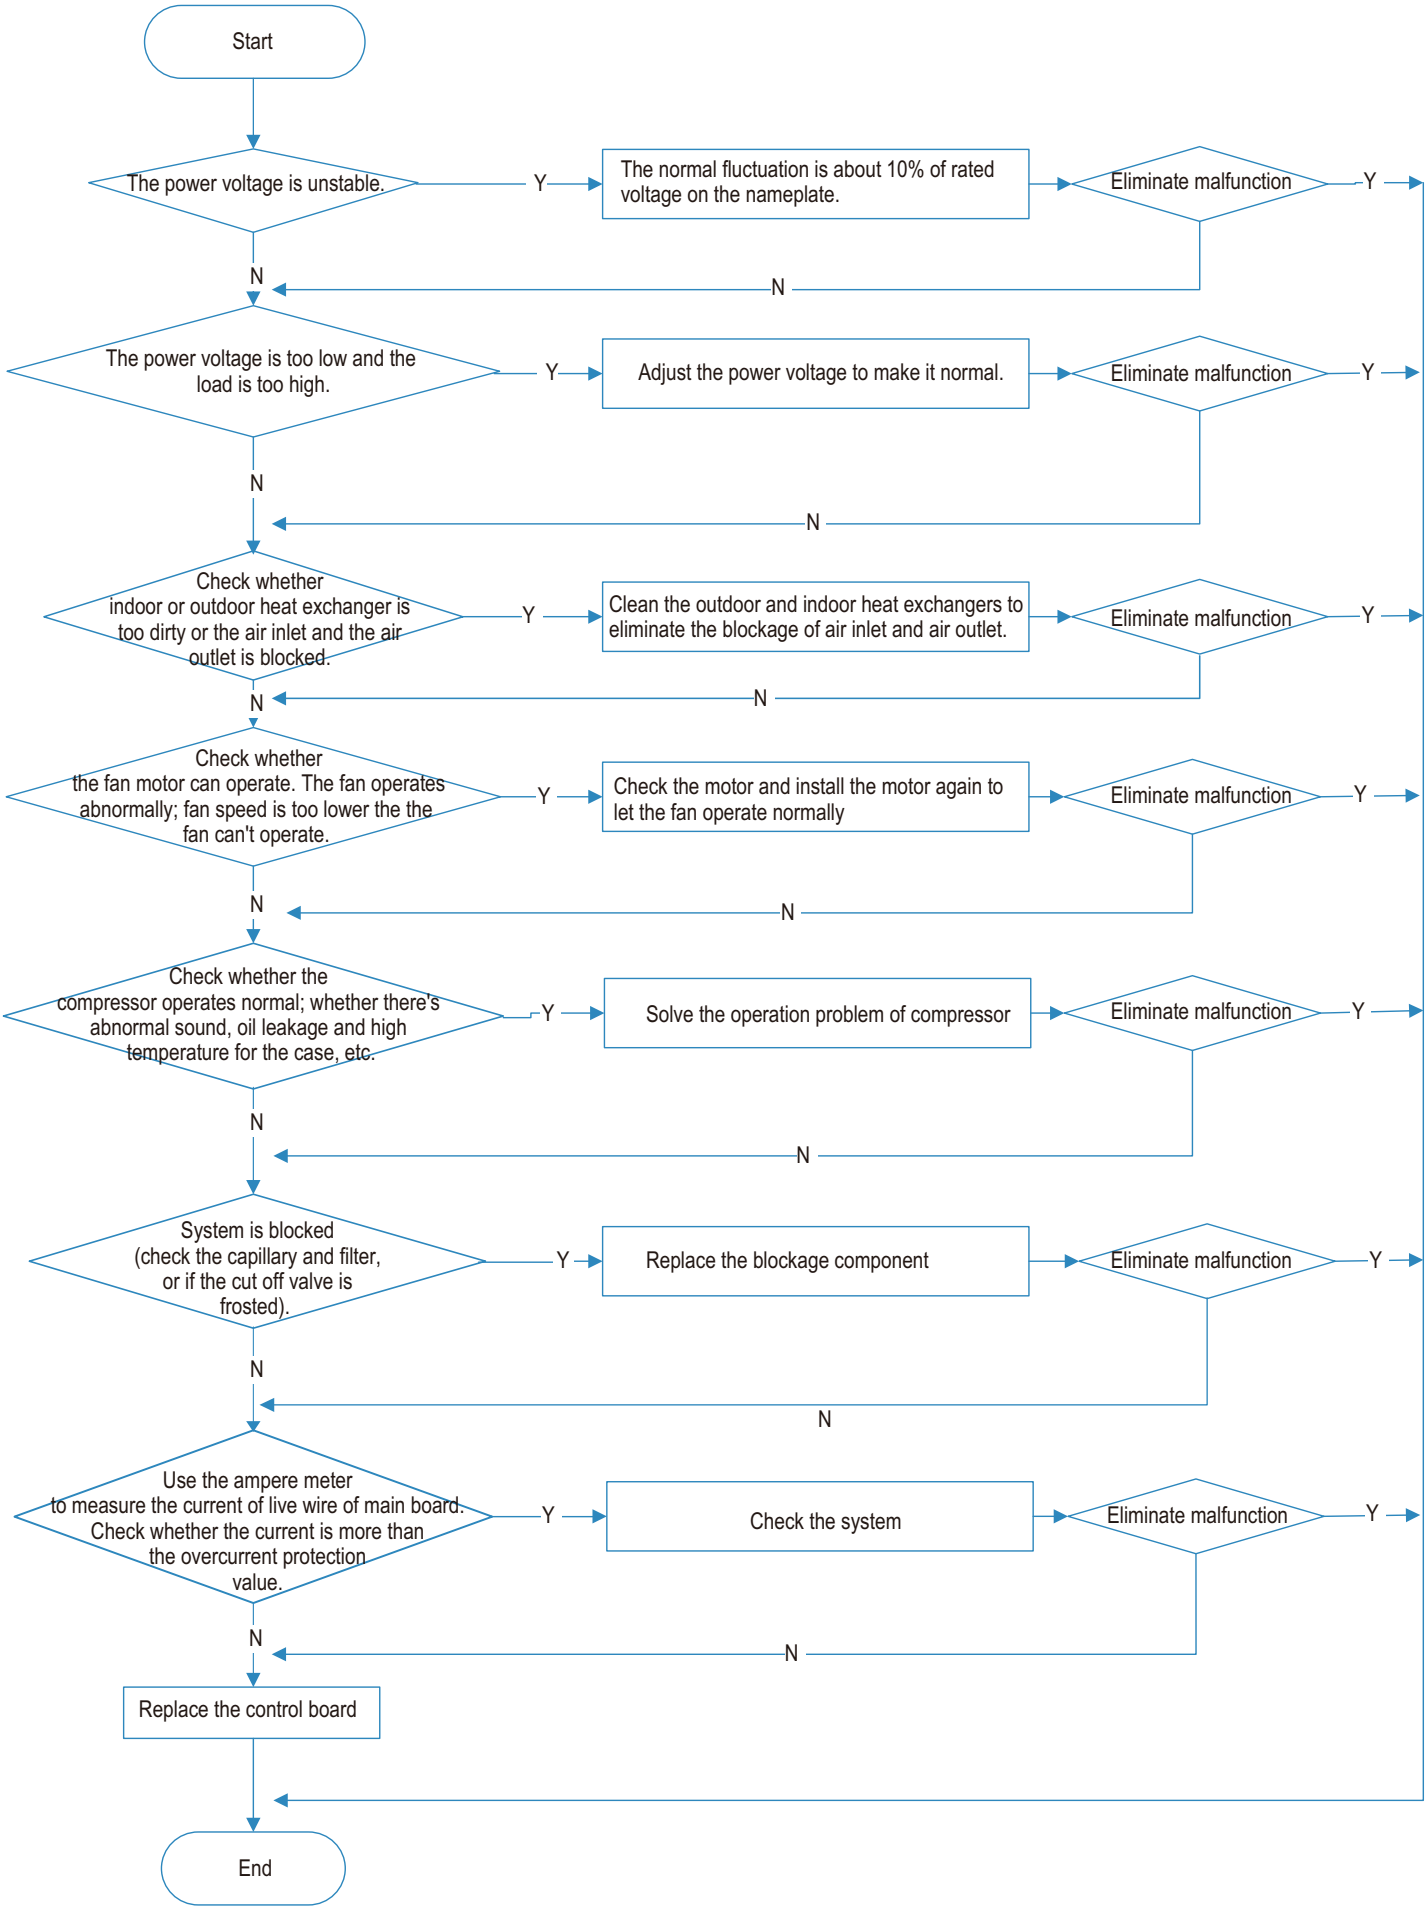

9.4 Troubleshooting for Normal Malfunction

1. Air Conditioner can't be Started Up

Possible Causes	Discriminating Method (Air conditioner Status)	Troubleshooting
No power supply, or poor connection for power plug	After energization, operation indicator isn't bright and the buzzer can't give out sound	Confirm whether it's due to power failure. If yes, wait for power recovery. If not, check power supply circuit and make sure the power plug is connected well.
Wrong wire connection between indoor unit and outdoor unit, or poor connection for wiring terminals	Under normal power supply circumstances, operation indicator isn't bright after energization	Check the circuit according to circuit diagram and connect wires correctly. Make sure all wiring terminals are connected firmly
Electric leakage for air conditioner	After energization, room circuit breaker trips off at once	Make sure the air conditioner is grounded reliably Make sure wires of air conditioner is connected correctly Check the wiring inside air conditioner. Check whether the insulation layer of power cord is damaged; if yes, place the power cord.
Model selection for air switch is improper	After energization, air switch trips off	Select proper air switch
Malfunction of remote controller	After energization, operation indicator is bright, while no display on remote controller or buttons have no action.	Replace batteries for remote controller Repair or replace remote controller

2. Poor Cooling (Heating) for Air Conditioner

Possible Causes	Discriminating Method (Air conditioner Status)	Troubleshooting
Set temperature is improper	Observe the set temperature on remote controller	Adjust the set temperature
Rotation speed of the IDU fan motor is set too low	Small wind blow	Set the fan speed at high or medium
Filter of indoor unit is blocked	Check the filter to see its blocked	Clean the filter
Installation position for indoor unit and outdoor unit is improper	Check whether the installation postion is proper according to installation requirement for air conditioner	Adjust the installation position, and install the rainproof and sunproof for outdoor unit
Refrigerant is leaking	Discharged air temperature during cooling is higher than normal discharged wind temperature; Discharged air temperature during heating is lower than normal discharged wind temperature; Units pressure is much lower than regulated range	Find out the leakage causes and deal with it. Add refrigerant.
Malfunction of 4-way valve	Blow cold wind during heating	Replace the 4-way valve
Malfunction of capillary	Discharged air temperature during cooling is higher than normal discharged wind temperature; Discharged air temperature during heating is lower than normal discharged wind temperature; Unitt pressure is much lower than regulated range. If refrigerant isn't leaking, part of capillary is blocked	Replace the capillary
Flow volume of valve is insufficient	The pressure of valves is much lower than that stated in the specification	Open the valve completely
Malfunction of horizontal louver	Horizontal louver can't swing	Refer to point 3 of maintenance method for details
Malfunction of the IDU fan motor	The IDU fan motor can't operate	Refer to troubleshooting for H6 for maintenance method in details
Malfunction of the ODU fan motor	The ODU fan motor can't operate	Refer to point 4 of maintenance method for details
Malfunction of compressor	Compressor can't operate	Refer to point 5 of maintenance method for details

3. Horizontal Louver can't Swing

Possible Causes	Discriminating Method (Air conditioner Status)	Troubleshooting
Wrong wire connection, or poor connection	Check the wiring status according to circuit diagram	Connect wires according to wiring diagram to make sure all wiring terminals are connected firmly
Stepping motor is damaged	Stepping motor can't operate	Repair or replace stepping motor
Main board is damaged	Others are all normal, while horizontal louver can't operate	Replace the main board with the same model

4. ODU Fan Motor can't Operate

Possible causes	Discriminating method (air conditioner status)	Troubleshooting
Wrong wire connection, or poor connection	Check the wiring status according to circuit diagram	Connect wires according to wiring diagram to make sure all wiring terminals are connected firmly
Capacity of the ODU fan motor is damaged	Measure the capacity of fan capacitor with an universal meter and find that the capacity is out of the deviation range indicated on the nameplate of fan capacitor.	Replace the capacity of fan
Power voltage is a little low or high	Use universal meter to measure the power supply voltage. The voltage is a little high or low	Suggest to equip with voltage regulator
Motor of outdoor unit is damaged	When unit is on, cooling/heating performance is bad and ODU compressor generates a lot of noise and heat.	Change compressor oil and refrigerant. If no better, replace the compressor with a new one

5. Compressor can't Operate

Possible causes	Discriminating method (air conditioner status)	Troubleshooting
Wrong wire connection, or poor connection	Check the wiring status according to circuit diagram	Connect wires according to wiring diagram to make sure all wiring terminals are connected firmly
Capacity of compressor is damaged	Measure the capacity of fan capacitor with an universal meter and find that the capacity is out of the deviation range indicated on the nameplate of fan capacitor.	Replace the compressor capacitor
Power voltage is a little low or high	Use universal meter to measure the power supply voltage. The voltage is a little high or low	Suggest to equip with voltage regulator
Coil of compressor is burnt out	Use universal meter to measure the resistance between compressor terminals and it's 0	Repair or replace compressor
Cylinder of compressor is blocked	Compressor can't operate	Repair or replace compressor

6. Air Conditioner is Leaking

Possible causes	Discriminating method (air conditioner status)	Troubleshooting
Drain pipe is blocked	Water leaking from indoor unit	Eliminate the foreign objects inside the drain pipe
Drain pipe is broken	Water leaking from drain pipe	Replace drain pipe
Wrapping is not tight	Water leaking from the pipe connection place of indoor unit	Wrap it again and bundle it tightly


7. Abnormal Sound and Vibration

Possible causes	Discriminating method (air conditioner status)	Troubleshooting
When turn on or turn off the unit, the panel and other parts will expand and theres abnormal sound	Theres the sound of "PAPA"	Normal phenomenon. Abnormal sound will disappear after a few minutes.
When turn on or turn off the unit, theres abnormal sound due to flow of refrigerant inside air conditioner	Water-running sound can be heard	Normal phenomenon. Abnormal sound will disappear after a few minutes.
Foreign objects inside the indoor unit or therere parts touching together inside the indoor unit	Theres abnormal sound fro indoor unit	Remove foreign objects. Adjust all parts position of indoor unit, tighten screws and stick damping plaster between connected parts
Foreign objects inside the outdoor unit or therere parts touching together inside the outdoor unit	Theres abnormal sound fro outdoor unit	Remove foreign objects. Adjust all parts position of outdoor unit, tighten screws and stick damping plaster between connected parts
Short circuit inside the magnetic coil	During heating, the way valve has abnormal electromagnetic sound	Replace magnetic coil
Abnormal shake of compressor	Outdoor unit gives out abnormal sound	Adjust the support foot mat of compressor, tighten the bolts
Abnormal sound inside the compressor	Abnormal sound inside the compressor	If add too much refrigerant during maintenance, please reduce refrigerant properly. Replace compressor for other circumstances.

10. Exploded View and Parts List

10.1 Indoor Unit

GVH24AMXF-K6DNC7A/I

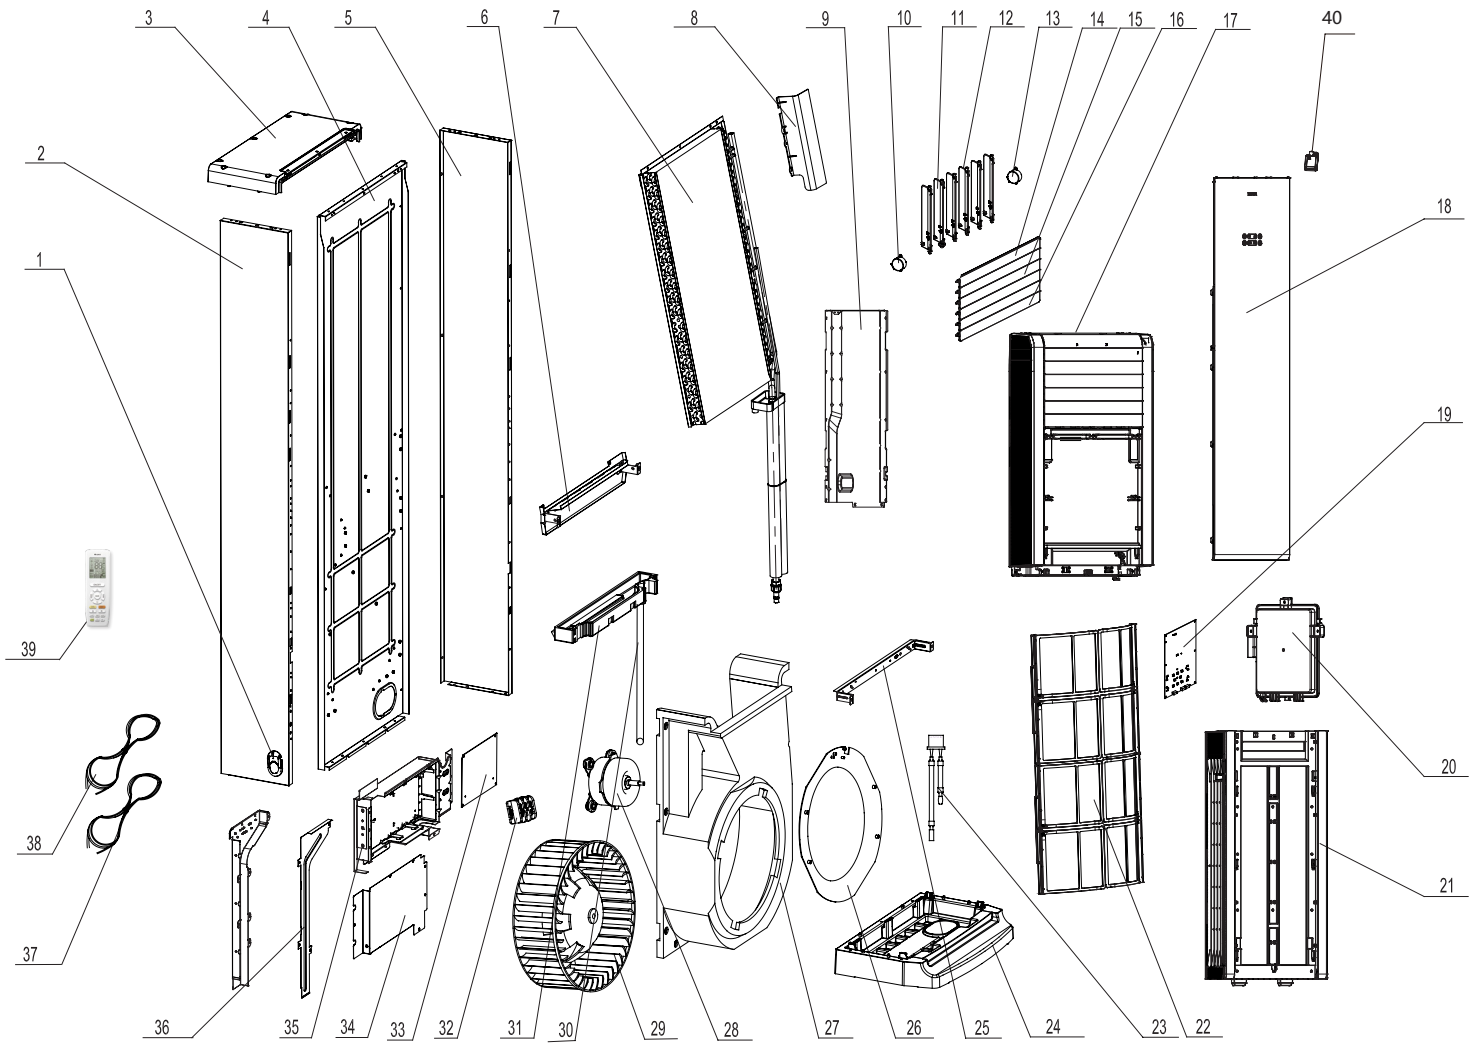


The component picture is only for reference; please refer to the actual product.

NO.	Description
1	Baffle Plate
2	Left Side Plate Sub-Assy
3	Top Cover Sub-Assy
4	Rear Plate Sub-Assy
5	Right Side Plate Sub-Assy
6	Breakwater Sub-Assy
7	Evaporator Assy
8	Protection Cover
9	Air Guard Sub-Assy
10	Stepping Motor
11	Air Louver 1
12	Air Louver 2
13	Stepping Motor
14	Guide Louver 1
15	Guide Louver 2
16	Guide Louver 3
17	Air Outlet Panel Assy
18	Front Door Plate Sub-assy
19	Display Board
20	Display Sub-Assy

NO.	Description
21	Air Intake Panel Assy
22	Filter Sub-Assy
23	Temperature Sensor
24	Chassis
25	Propeller HousingPress Plate
26	Diversion Circle
27	Propeller Housing Sub-assy
28	Fan Motor
29	Centrifugal Fan
30	Drainage Pipe Sub-assy
31	Water Tray Sub-Assy
32	Terminal Board
33	Main Board
34	Electric Box Cover Sub-Assy
35	Electric Box Assy
36	Cover of pass
37	Connecting Cable
38	Connecting Cable
39	Remote Controller
40	Detecting Plate

Some models may not contain some parts, please refer to the actual product.

GVH48ALXH-K6DNC7A/I

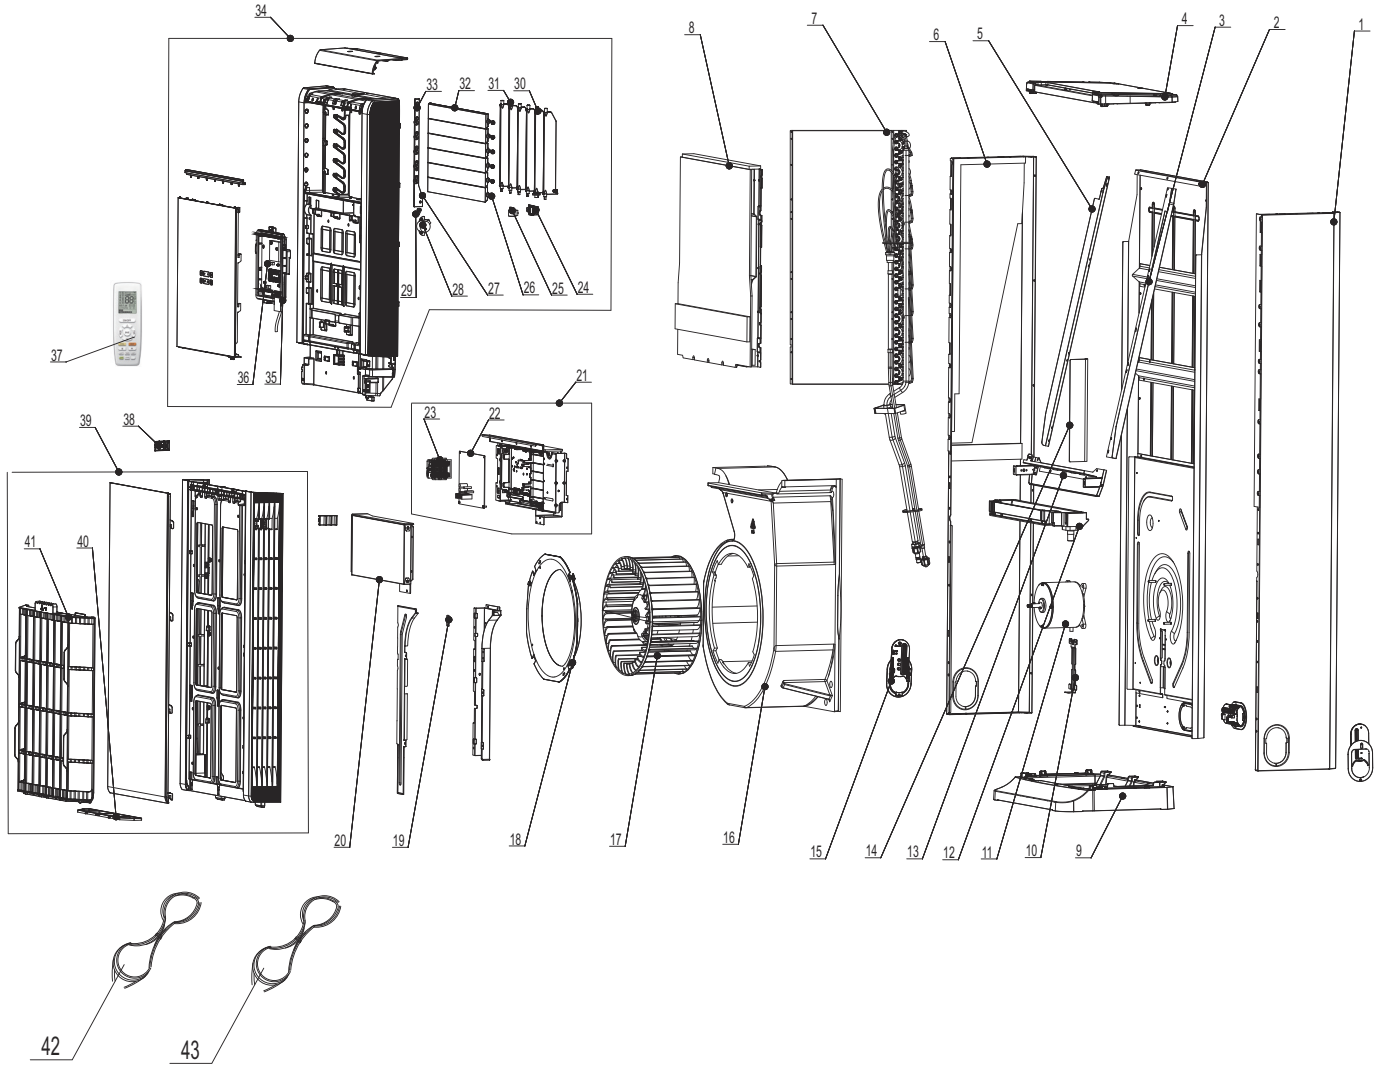


The component picture is only for reference; please refer to the actual product.

NO.	Description
1	Right Side Plate Sub-Assy
2	Rear Plate Sub-Assy
3	Right Air Guard
4	Top Cover Sub-Assy
5	Left Air Guard
6	Left Side Plate Sub-Assy
7	Evaporator Assy
8	Air Guard Assy
9	Chassis
10	Wire Clamp
11	Fan Motor
12	Water Tray Sub-Assy
13	Breakwater Sub-Assy
14	Protection Cover
15	Remote Control Panel Sub-assy
16	Propeller Housing Sub-assy
17	Centrifugal Fan
18	Diversion Circle
19	Gasket
20	Electric Box Cover Sub-Assy
21	Electric Box Assy
22	Main Board

NO.	Description
23	Terminal Board
24	Motor Cover
25	Stepping Motor
26	Air Guide Bushing
27	Guide Blade Lever
28	Stepping Motor
29	Crank 1
30	Air Louver 1
31	Air Louver 2
32	Guide Louver
33	Crankshaft of Guide Louver
34	Air Outlet Panel Assy
35	Display Sub-Assy
36	Display Board
37	Remote Controller
38	Screw Cover
39	Air Intake Panel Assy
40	Filter (lower)
41	Filter Sub-assy(Upper)
42	Connecting Cable
43	Connecting Cable

Some models may not contain some parts, please refer to the actual product.

GVH48ALXK-M6DNC7A/I

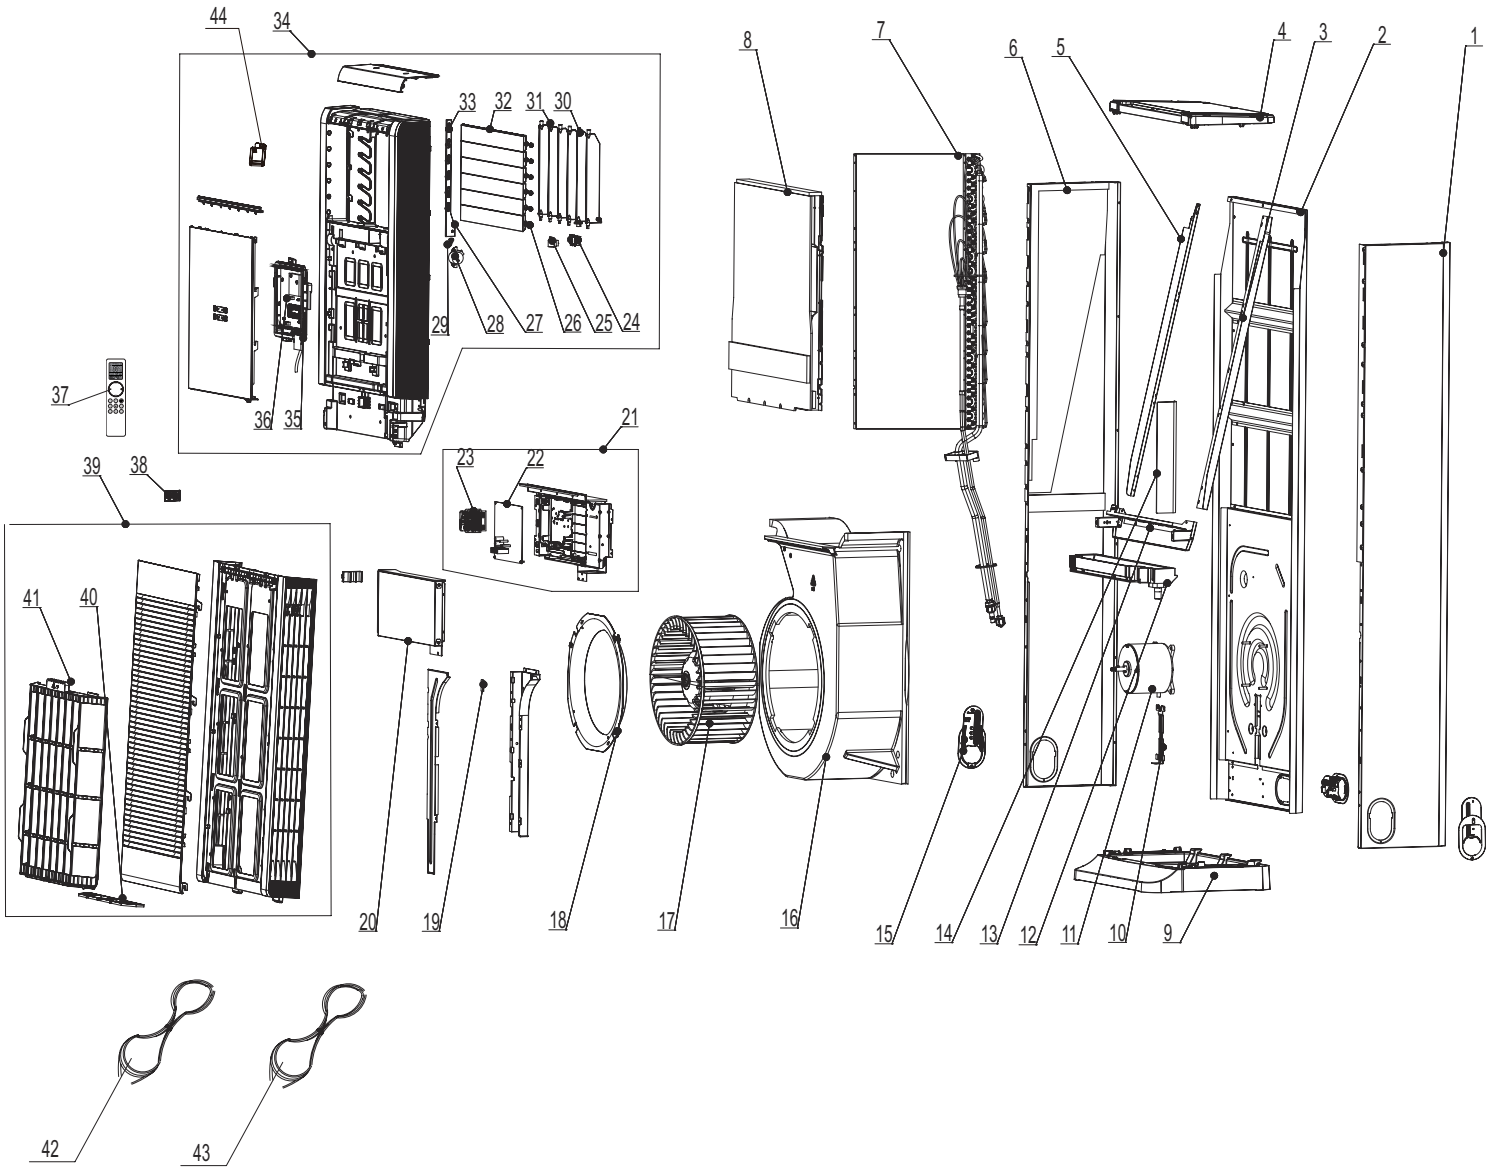

The component picture is only for reference; please refer to the actual product.


NO.	Description
1	Right Side Plate Sub-Assy
2	Rear Plate Sub-Assy
3	Right Air Guard
4	Top Cover Sub-Assy
5	Left Air Guard
6	Left Side Plate Sub-Assy
7	Evaporator Assy
8	Air Guard Assy
9	Chassis
10	Wire Clamp
11	Fan Motor
12	Water Tray Sub-Assy
13	Breakwater Sub-Assy
14	Protection Cover
15	Remote Control Panel Sub-assy
16	Propeller Housing Sub-assy
17	Centrifugal Fan
18	Diversion Circle
19	Gasket
20	Electric Box Cover Sub-Assy
21	Electric Box Assy
22	Main Board

NO.	Description
23	Terminal Board
24	Motor Cover
25	SteppingMotor
26	Air Guide Bushing
27	Guide Blade Lever
28	SteppingMotor
29	Crank 1
30	Air Louver 1
31	Air Louver 2
32	Guide Louver
33	Crankshaft of Guide Louver
34	Air Outlet Panel Assy
35	Display Sub-Assy
36	Display Board
37	Remote Controller
38	Screw Cover
39	Air Intake Panel Assy
40	Filter (lower)
41	Filter Sub-assy(Upper)
42	Connecting Cable
43	Connecting Cable
44	Detecting Plate

Some models may not contain some parts, please refer to the actual product.

10.2 Outdoor Unit

GVH24AMXF-K6DNC7A/O

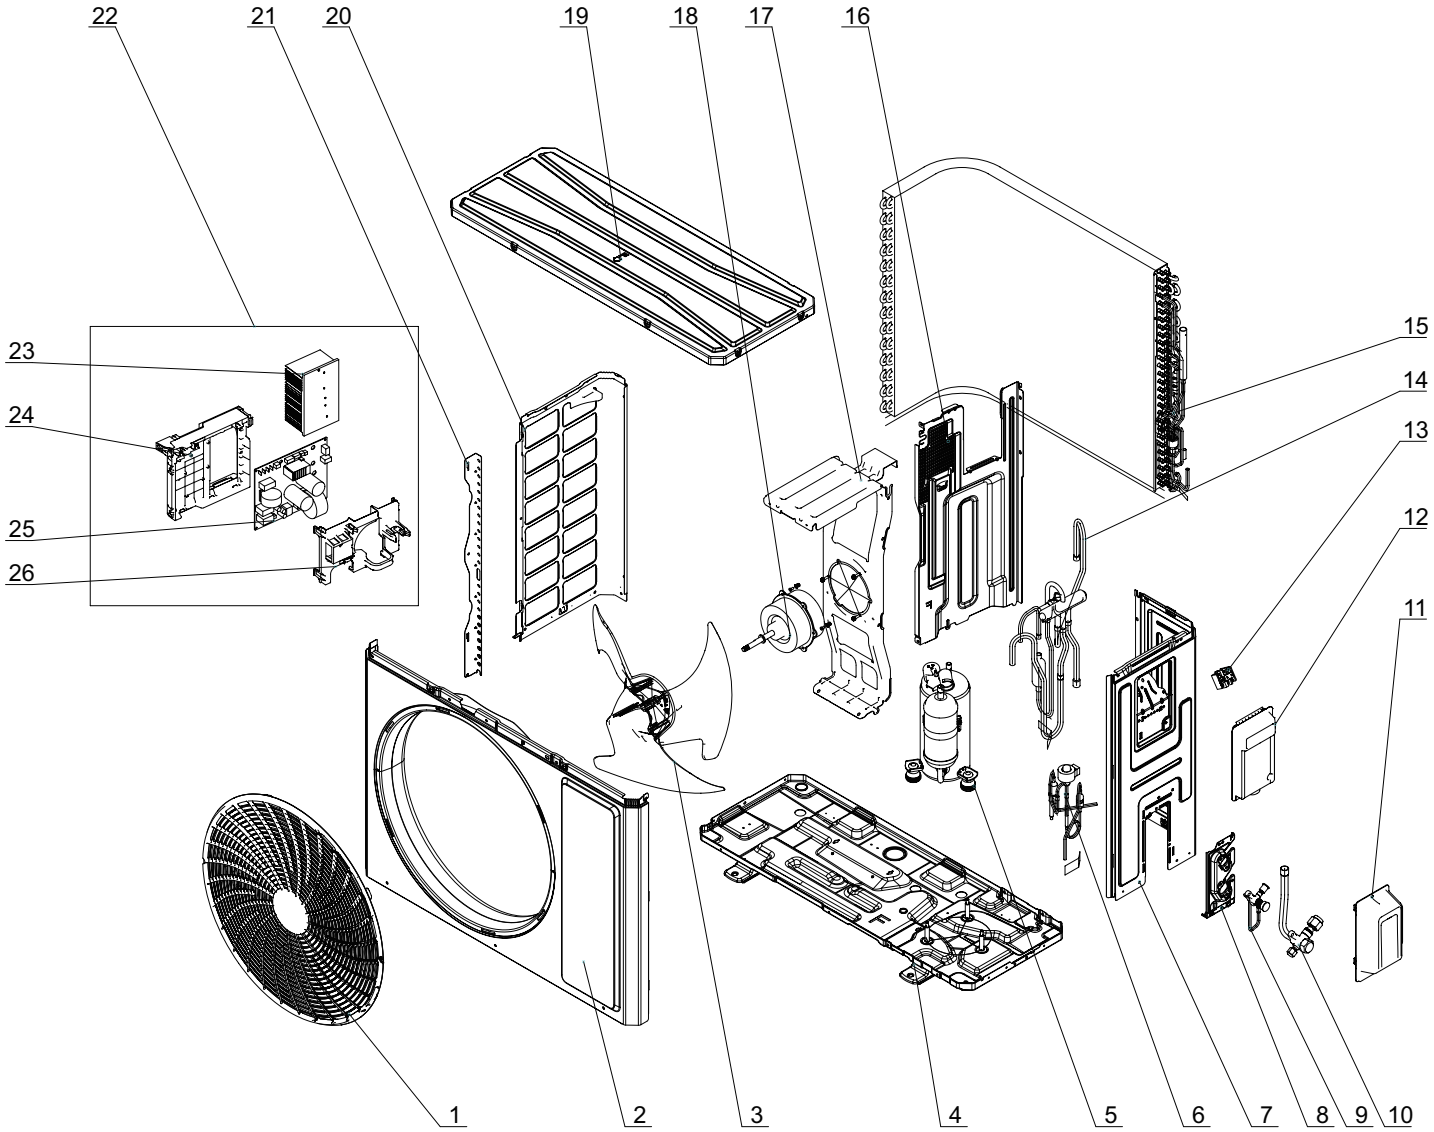


The component is only for rererence;please refer to the actual product

NO.	Description
1	Front Grill
2	Front Panel
3	Axial Flow Fan
4	Chassis Sub-assy
5	Compressor and Fittings
6	Electronic Expansion Valve
7	Right Side Plate
8	Valve Support
9	Cut-off valve
10	Cut-off valve
11	Valve Cover
12	Handle
13	Terminal Board

NO.	Description
14	4-Way Valve Assy
15	Condenser Assy
16	Clapboard Assy
17	Motor Support
18	Brushless DC Motor
19	Top Cover Assy
20	Left Side Plate
21	Condenser Left Border Plate
22	Electric Box Assy
23	Radiator
24	Electric Box
25	Main Board
26	Electric Box Cover

Some models may not contain some parts, please refer to the actual product.

GVH48ALXH-K6DNC7A/O

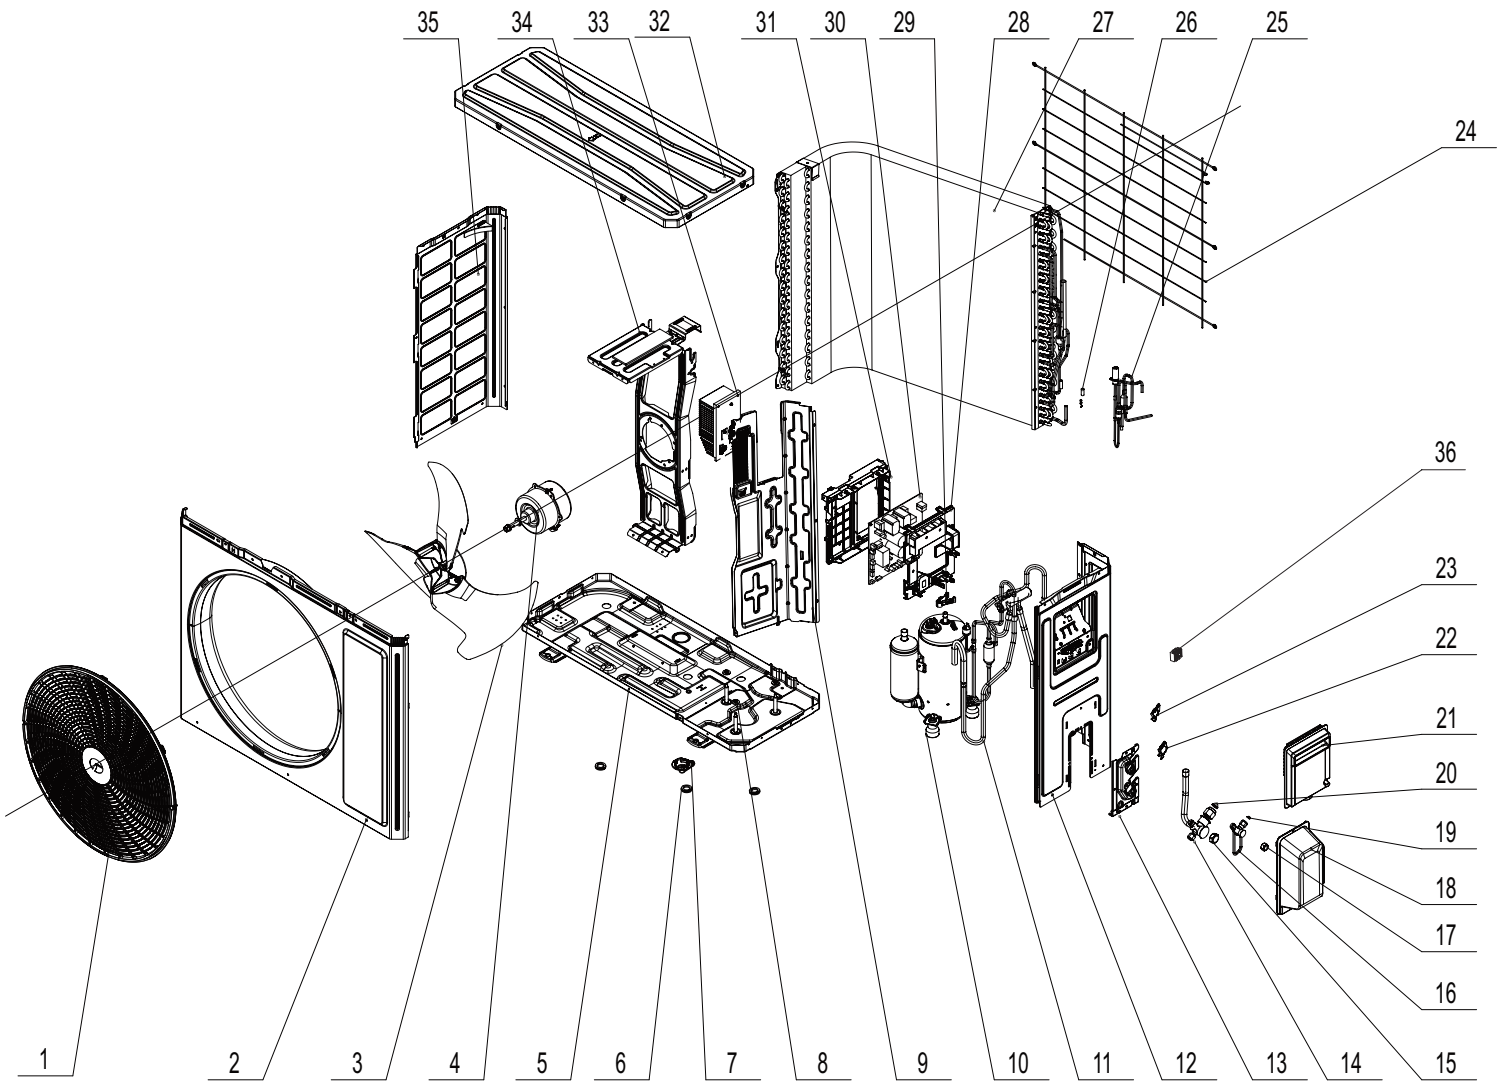


The component is only for rererence;please refer to the actual product

NO.	Description
1	Front Grill
2	Cabinet
3	Axial Flow Fan
4	Brushless DC Motor
5	Chassis Sub-assy
6	Drainage hole Cap
7	Drainage Joint
8	Cushioned Nut
9	Clap Board Assy
10	Compressor and Fittings
11	4-Way Valve Assy
12	Right Side Plate Assy
13	Valve Support Sub
14	Cut-off Valve
15	Back Cover Nut
16	Cut-off valve
17	Back Cover Nut
18	Valve Cover

NO.	Description
19	Union Nut
20	Union Nut
21	Handle
22	Supporter
23	Valve Support Block
24	Rear Grill
25	Electronic Expansion Valve assy
26	Temperature Sensor
27	Condenser Assy
28	Electric Box Cover
29	Tube Clip
30	Main Board
31	Electric box
32	Top Cover-assy
33	Motherboard radiator
34	Motor Support Sub-Assy
35	Left Side Plate
36	Terminal Board

Some models may not contain some parts, please refer to the actual product.

GVH48ALXK-M6DNC7A/O

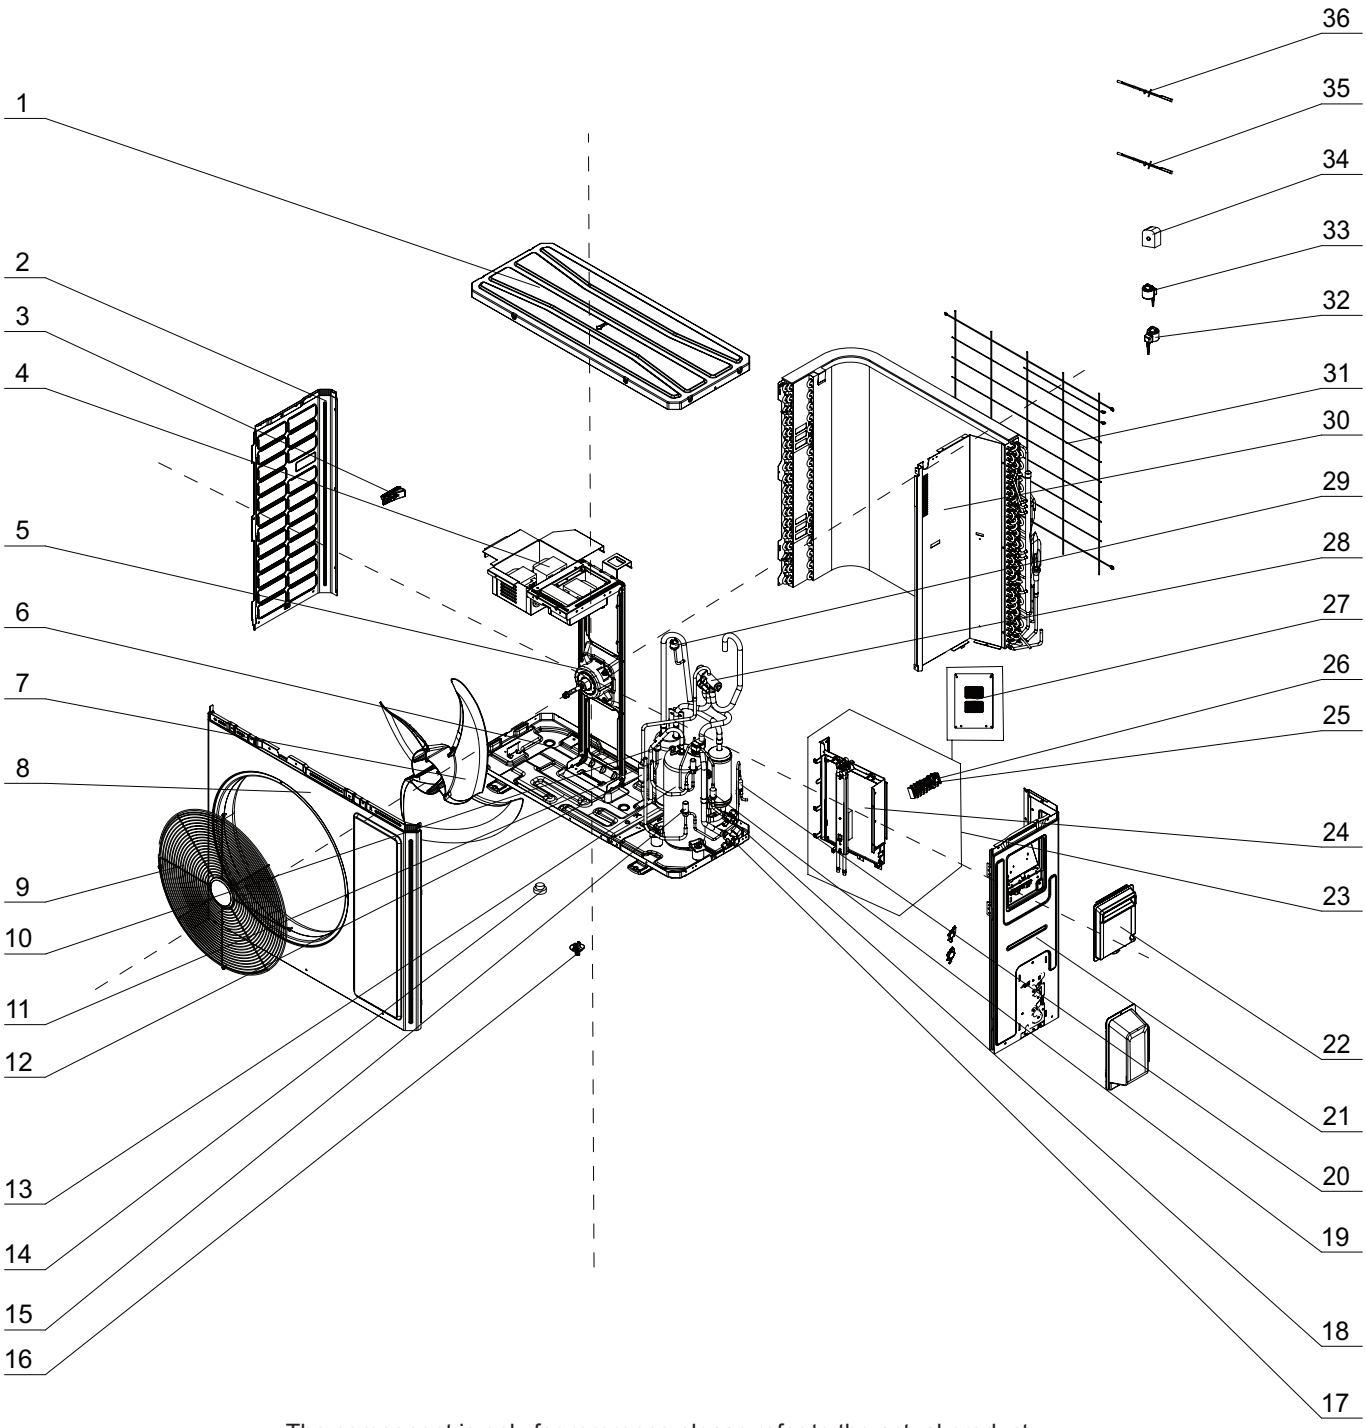

The component is only for rererence;please refer to the actual product

NO.	Description
1	Top cover
2	Left Side Plate
3	Handle
4	Reactor
5	Brushless DC Motor
6	Chassis Sub-assy
7	Axial Flow Fan
8	Cabinet
9	Front Grill
10	Pressure Protect Switch
11	Gas-liquid Separator
12	Silencer
13	Compressor and Fittings
14	Drainage hole Cap
15	Electronic Expansion Valve
16	Drainage Joint
17	Cut-off Valve
18	Cut-off Valve

NO.	Description
19	Strainer
20	Strainer
21	Right Side Plate
22	Handle
23	Electric Box Assy
24	Main Board
25	Terminal Board
26	Terminal Board
27	Filter Board
28	4-way Valve
29	Pressure Protect Switch
30	Condenser Assy
31	Rear Grill
32	Electric Expand Valve Fitting
33	Electric Expand Valve Fitting
34	4-Way Valve Coil
35	Temperature Sensor
36	Temperature Sensor


Some models may not contain some parts, please refer to the actual product.


11. Removal Procedure



11.1 Removal Procedure of Indoor Unit




24K


⚠ **Caution: discharge the refrigerant completely before removal.**

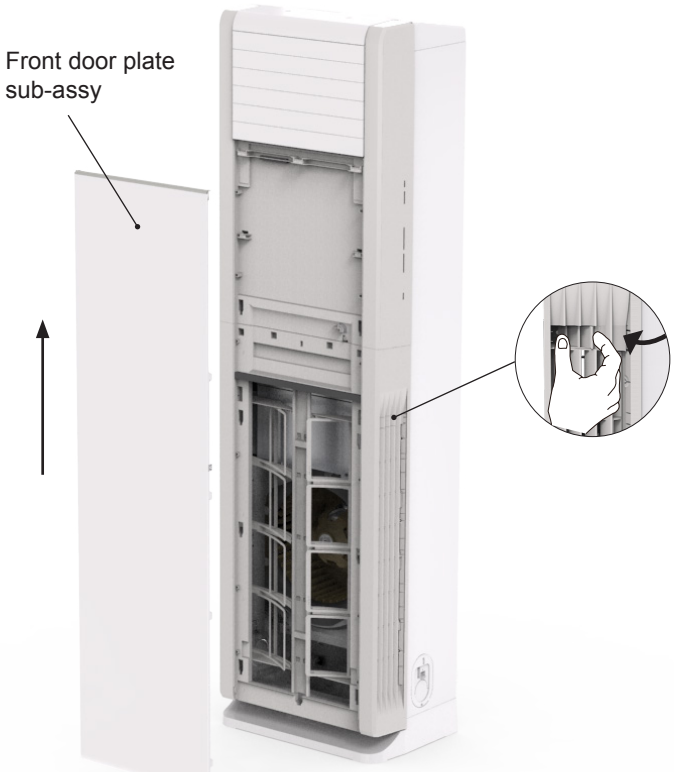
Step	Procedure
1.Outside view of indoor unit	
2.Remove the front door plate sub-assy Take out the screw cover, use screwdriver to remove the screws at both side of air-in panel, push the front door plate upwards and then separate the connector connected to the connection wire of display and then remove the front door plate sub-assy.	

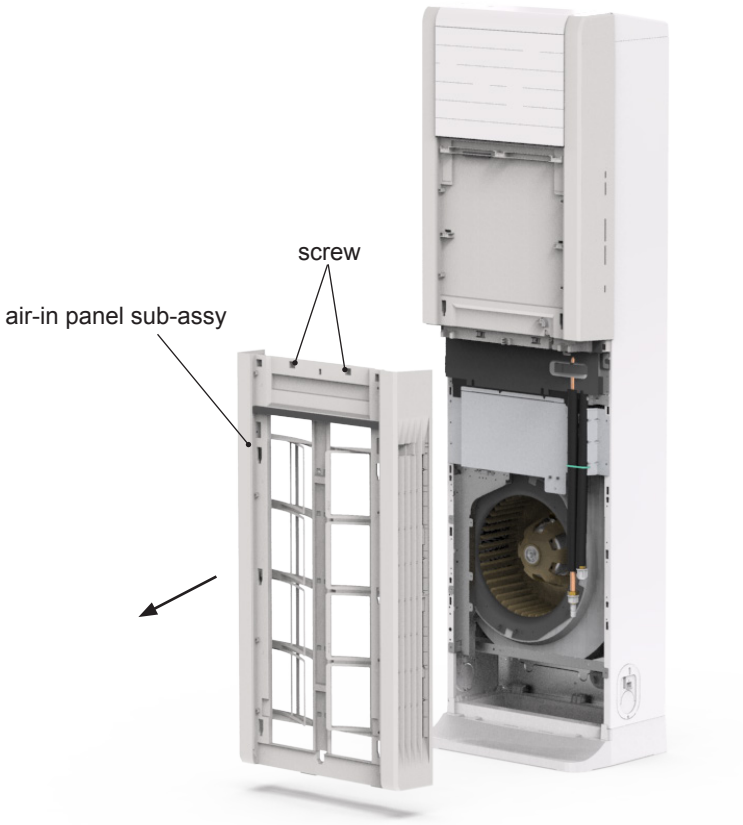Step	Procedure
3. Remove air-in panel sub-assy	
Remove two screws on the air-in panel sub-assy. Open the air-in panel along the arrow direction and then remove the air-in panel sub-assy.	
4.Remove filter sub-assy	
Extend your hands into grooves at both sides, pull it outwards and then draw out 4 filters.	

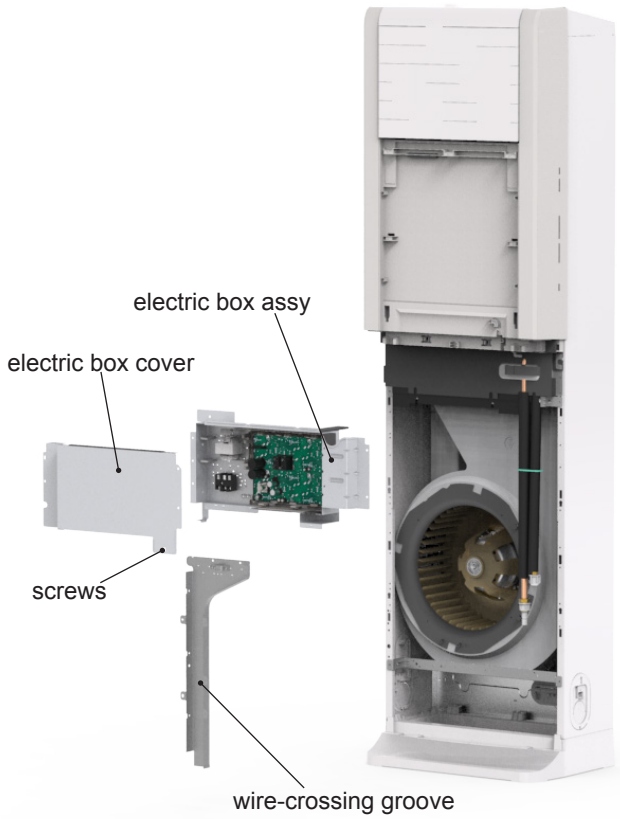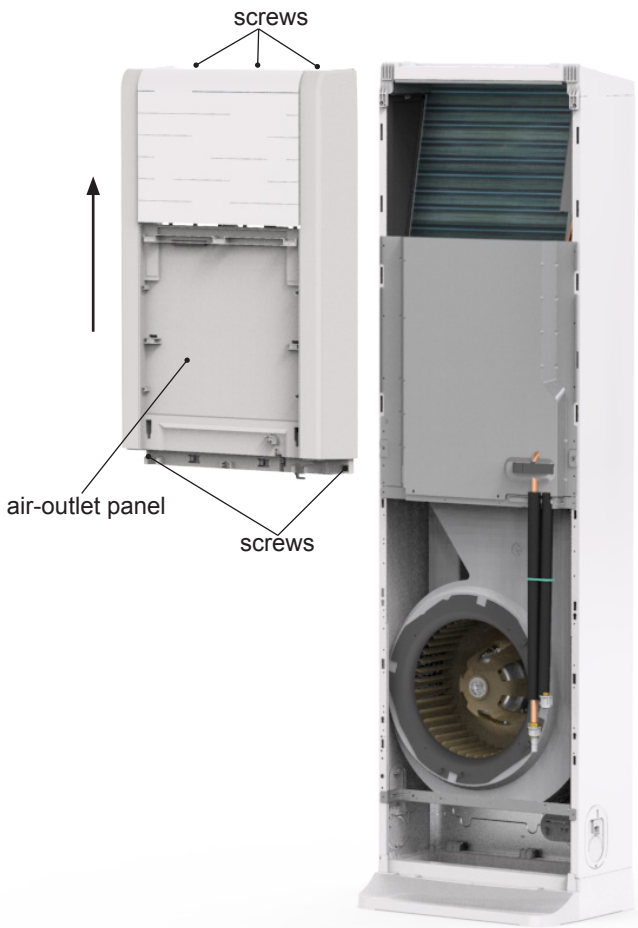Step	Procedure
5.Remove electric box and wire-passing groove sub-assy	
	Remove the four screws fixing the electric box cover and then remove the electric box cover; disconnect the wiring terminal of each electronic components and then remove related electronic components according to your requirements; 1.Remove the two screws fixing the electric box assy and then lift the electric box assy outwards to remove it; 2.Remove the four screws fixing the cover of wire-crossing groove and then remove the cover of wire-crossing groove; 3.Remove the four screws fixing the wirecrossing groove and then remove the wirecrossing groove sub-assy.
	
6. Remove air-outlet panel	
	Remove the three screws at the top and two screws at the lower part of air outlet panel and screws in the screw covers at two sides; push the air outlet panel upwards slightly to remove the air outlet panel assy.
	

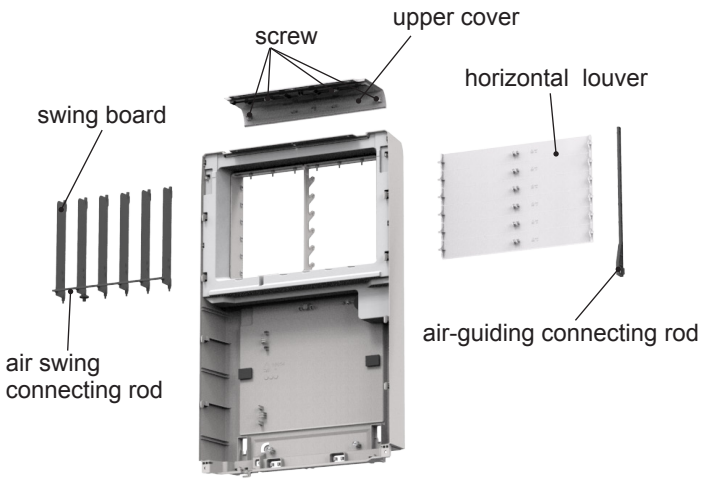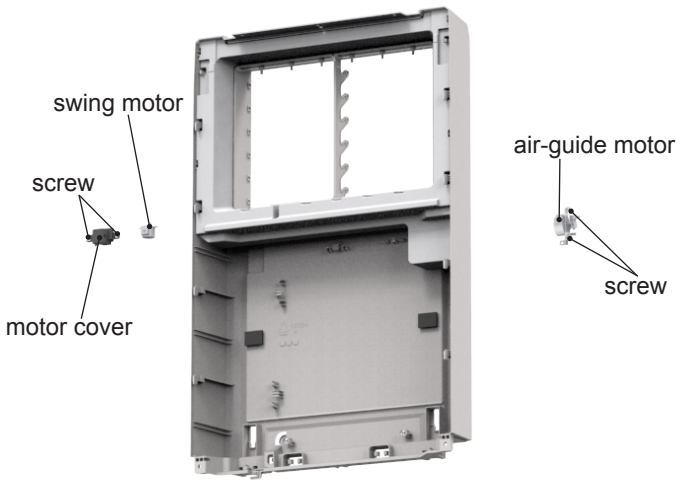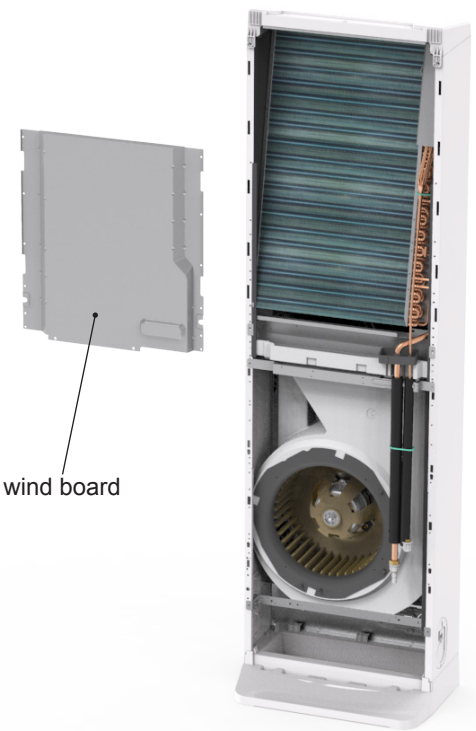Step	Procedure
7.Remove upper cover, horizontal louver, swing board	
a	Remove 2 screws at the upper part of the upper cover and two screws at the back side of the air-outlet panel.
b	After removing the air-guiding connecting robe, and then pull the horizontal louver outwards to remove it.
c	After removing the air swing connection rod, pull the swing board inwards to remove it.
8.Remove swing motor and air-guide motor	
a	Remove screws used for fixing the airguide motor and the remove the air-guide motor.
b	Remove screws used for fixing the motor cover, remove the motor cover and then remove the swing motor.
9.Remove wind board	
	Remove 11 screws used for fixing the wind board and then remove the wind board.


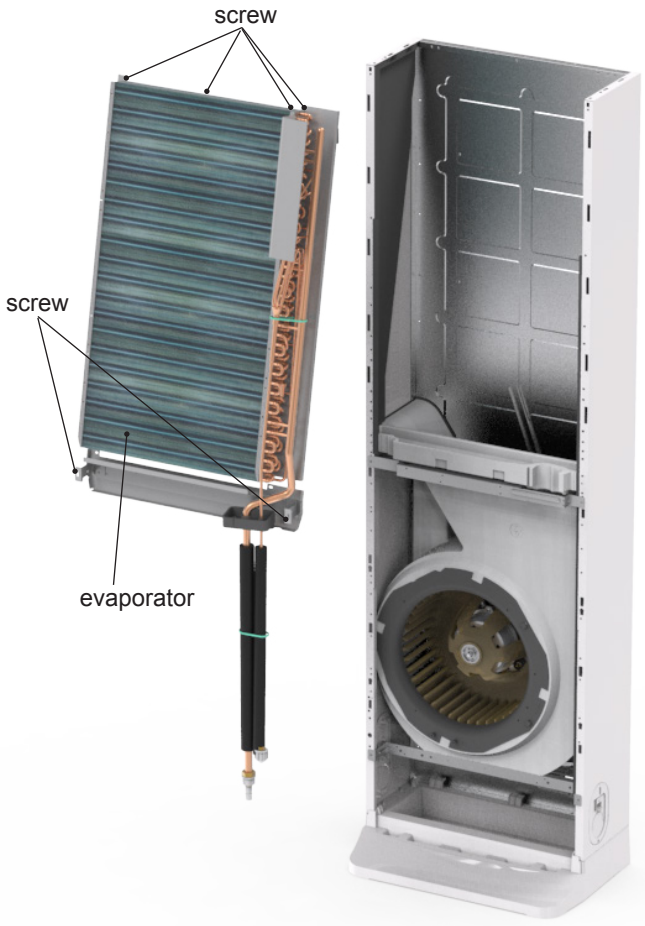
Step	Procedure
10.Remove top cover	
Remove 5 screws used for fixing the top cover, pull it upwards and then remove the top cover.	
11.Remove evaporator	
Remove 4 screws used for fixing the top connection board and lower connection board of evaporator and 2 screws used for fixing the side plate, pull left and right side plates outwards slightly and take out evaporator, baffle board and water tray. After the evaporator is removed, remove left and right wind boards on the evaporator and the baffle board.	

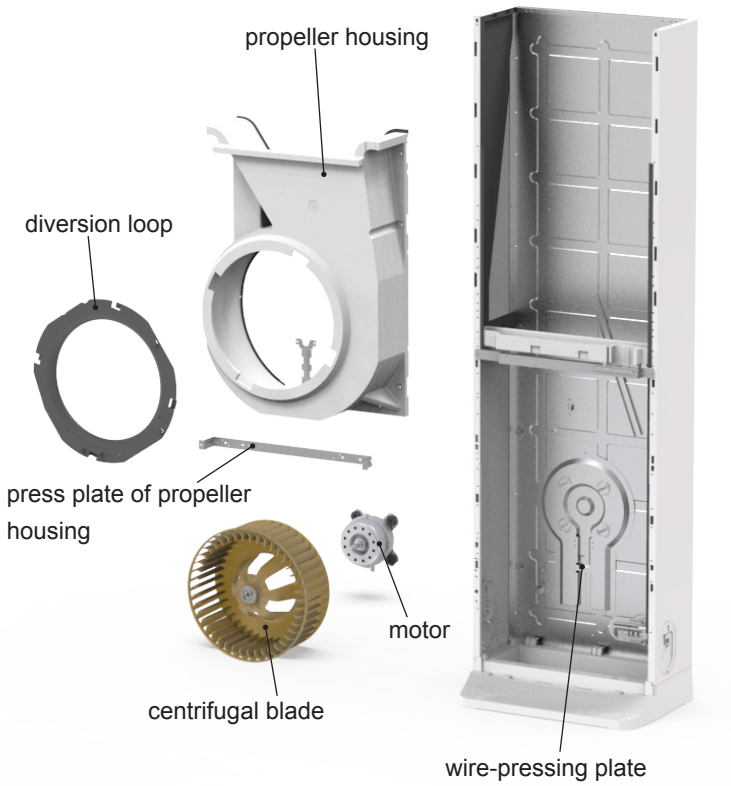
Step	Procedure
12.Remove propeller housing, centrifugal blade and motor	
a Remove 3 screws used for fixing the press plate of propeller housing, and then take out the pressure plate of propeller housing.	
b Rotate the diversion loop to a certain position in the clockwise direction and then take out the diversion loop.	
c Remove 9 screws used for fixing the propeller housing and then take out the propeller housing.	
d Use wrench to remove the nuts used for fixing the centrifugal blade and then pull the centrifugal blade outwards.	
e Take out the centrifugal blade.	
f Remove 4 screws fixing the motor and 2 screws fixing the wire-pressing late, and then remove the motor.	
13.Remove chassis	
Remove 9 screws, pull it downwards and then remove the chassis.	



Step	Procedure
14.Remove left and right side plates sub-assy	
	Remove screws on both plates, pull it to both sides respectively and then remove left and right side plates sub-assy.






⚠ **Caution: discharge the refrigerant completely before removal.**

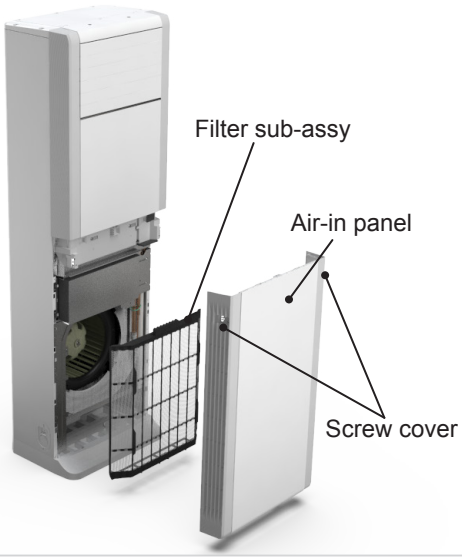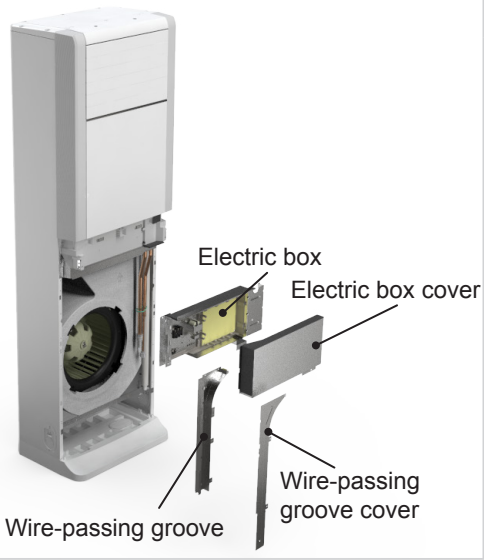Step	Procedure
1. Before disassemble	
2. Remove filter sub-assy (1) Open the screw cover, use the screwdriver to remove 2 screws at both sides of air-in panel and then pull the air-in panel to remove it; (2) Draw out the filter sub-assy.	
3. Remove electric box and wire-passing groove sub-assy Remove 4 screws used for fixing the electric box cover, remove the electric box cover and then pull out the wiring terminals for each component. At this time, you can remove related electric components according to the needs; Remove 9 screws used for fixing the electric box, pull the electric box outwards to remove it. Remove 3 screws used for fixing the wirepassing groove, and then remove the wirepassing groove cover. Remove 3 screws used for fixing the wirepassing groove and then remove the wirepassing groove sub-assy.	


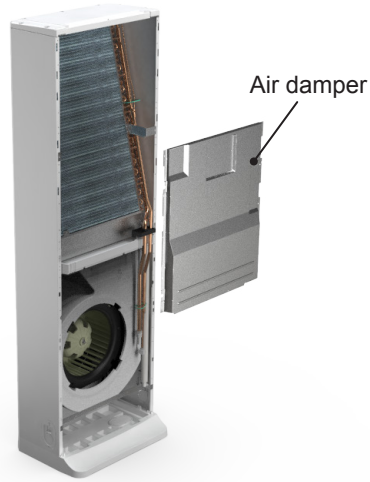
Step	Procedure
4. Remove air-outlet panel	
Remove 3 screws at the top part of the air-out panel, 2 screw at the lower part and screws under the screw cover, push the air-output panel upwards slightly and then remove the air-output panel.	
5. Remove air damper	
Remove 10 screws used for fixing the air damper, and then the air damper can be removed.	
6. Remove top cover	
Remove 7 screws on the top cover, and then pull the top cover upwards to remove it.	

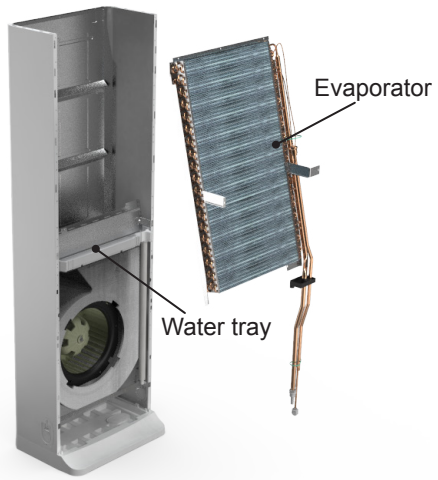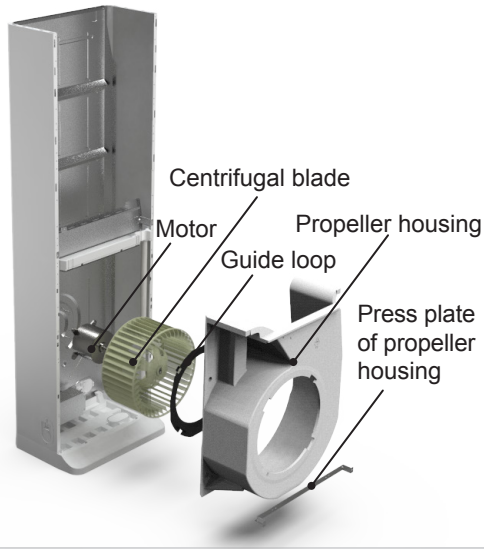
Step	Procedure
7. Remove evaporator	
Remove 3 screws on the evaporator, 2 screw at the middle part and 2 screws at the lower part. Pull left and right side plates outwards slightly and then take out the evaporator, baffle board and water tray. When the evaporator is removed, the left and the right air damper and the baffle board of the evaporator can be removed.	
8. Remove retaining plate of water tray and evaporator	
Remove 3 screws used for fixing the press plate of propeller housing and then remove the press plate of propeller housing; Rotate the guide loop to a certain position along the clockwise direction, and then remove the guide loop; Remove 9 screws used for fixing the propeller housing, and then remove the propeller housing; Use wrench to twist off the nuts used for fixing the centrifugal chiller and then pull the centrifugal blade outwards; Remove the centrifugal blade; Remove 4 nuts used for fixing the motor and 2 screws used for fixing the wire-pressing plate, and the remove the motor.	
9. Remove breakwater sub-assy and water tray sub-assy	
Remove 2 screws used for fixing the left and right side plate and then remove the breakwater sub-assy and water tray sub-assy.	

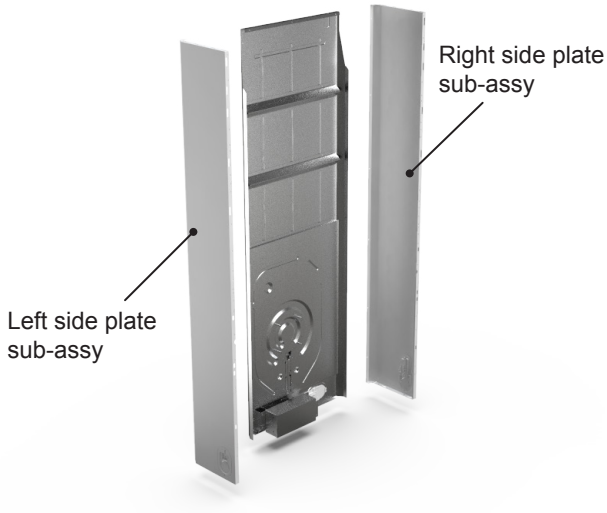Step	Procedure
10. Remove chassis	
After 9 screws are removed, pull the chassis downwards to remove it.	
11. Remove left and right side plate sub-assys	
Remove screws at both sides, pull them to both sides respectively and then left and right plate sub-assys can be removed.	

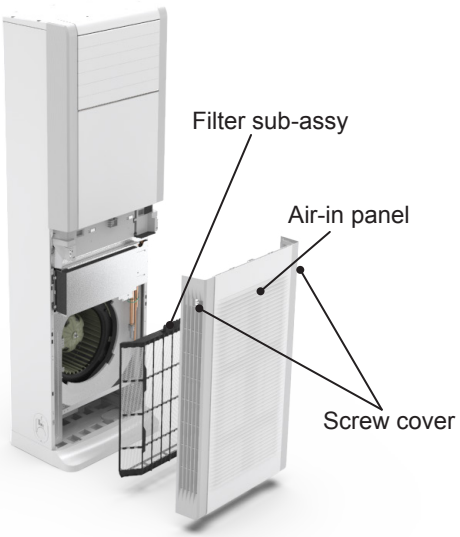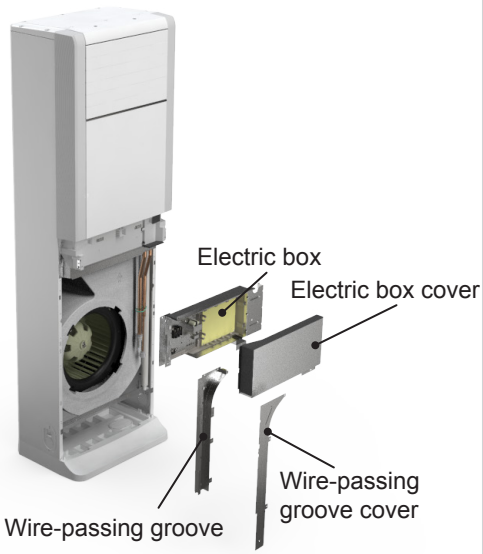Step	Procedure
1. Before disassemble	
2. Remove filter sub-assy (1) Open the screw cover, use the screwdriver to remove 2 screws at both sides of air-in panel and then pull the air-in panel to remove it; (2) Draw out the filter sub-assy.	
3. Remove electric box and wire-passing groove sub-assy Remove 4 screws used for fixing the electric box cover, remove the electric box cover and then pull out the wiring terminals for each component. At this time, you can remove related electric components according to the needs; Remove 9 screws used for fixing the electric box, pull the electric box outwards to remove it. Remove 3 screws used for fixing the wirepassing groove, and then remove the wirepassing groove cover. Remove 3 screws used for fixing the wirepassing groove and then remove the wirepassing groove sub-assy.	

Step	Procedure
4. Remove air-outlet panel	
Remove 3 screws at the top part of the air-out panel, 2 screw at the lower part and screws under the screw cover, push the air-output panel upwards slightly and then remove the air-output panel.	
5. Remove air damper	
Remove 10 screws used for fixing the air damper, and then the air damper can be removed.	
6. Remove top cover	
Remove 7 screws on the top cover, and then pull the top cover upwards to remove it.	

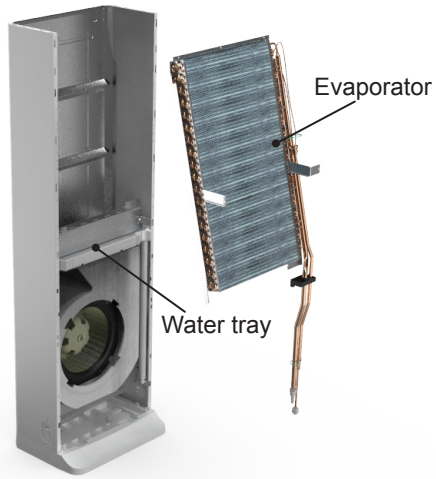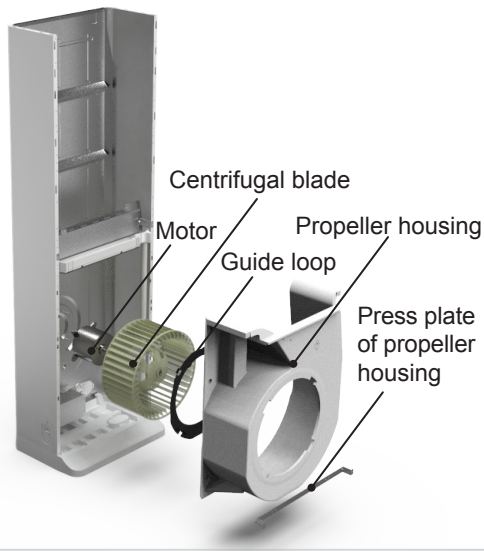Step	Procedure
7. Remove evaporator	
	Remove 3 screws on the evaporator, 2 screw at the middle part and 2 screws at the lower part. Pull left and right side plates outwards slightly and then take out the evaporator, baffle board and water tray. When the evaporator is removed, the left and the right air damper and the baffle board of the evaporator can be removed.
	
8. Remove retaining plate of water tray and evaporator	
	Remove 3 screws used for fixing the press plate of propeller housing and then remove the press plate of propeller housing; Rotate the guide loop to a certain position along the clockwise direction, and then remove the guide loop; Remove 9 screws used for fixing the propeller housing, and then remove the propeller housing; Use wrench to twist off the nuts used for fixing the centrifugal chiller and then pull the centrifugal blade outwards; Remove the centrifugal blade; Remove 4 nuts used for fixing the motor and 2 screws used for fixing the wire-pressing plate, and the remove the motor.
	
9. Remove breakwater sub-assy and water tray sub-assy	
	Remove 2 screws used for fixing the left and right side plate and then remove the breakwater sub-assy and water tray sub-assy.
	

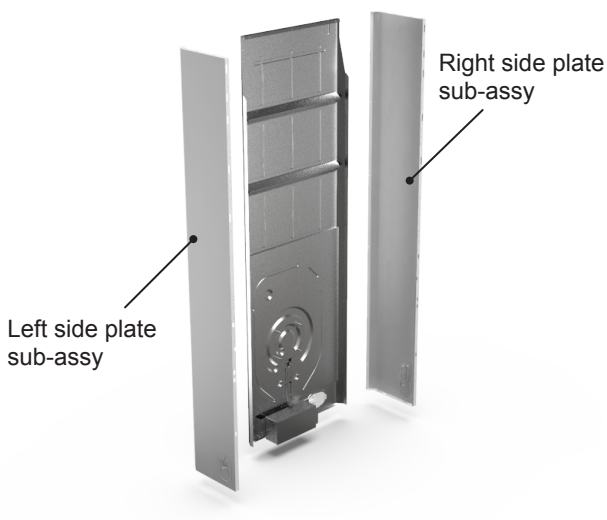
Step	Procedure
10. Remove chassis	
After 9 screws are removed, pull the chassis downwards to remove it.	
11. Remove left and right side plate sub-assys	
Remove screws at both sides, pull them to both sides respectively and then left and right plate sub-assys can be removed.	




11. Removal Procedure


11.2 Removal Procedure of Outdoor Unit




⚠ **Caution: discharge the refrigerant completely before removal.**

24K

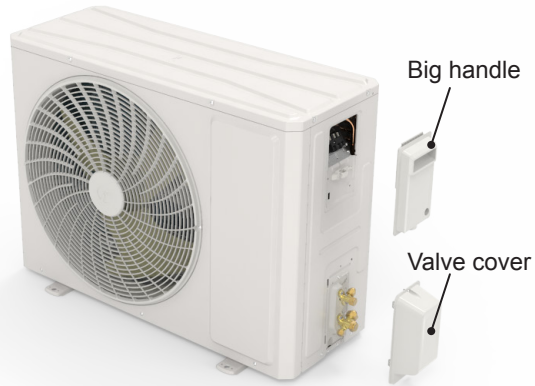Step	Procedure
1. Before disassembly	
2. Remove big handle and valve cover Remove the screws fixing big handle, valve cover and then remove them.	
3. Remove top cover Remove the screws fixing top panel and then remove the top panel.	

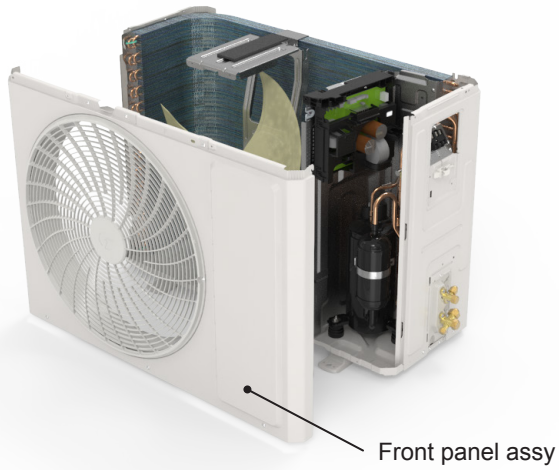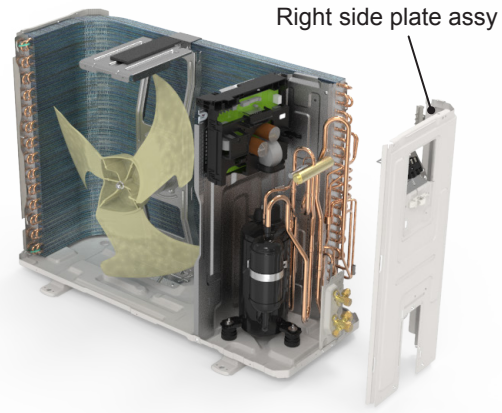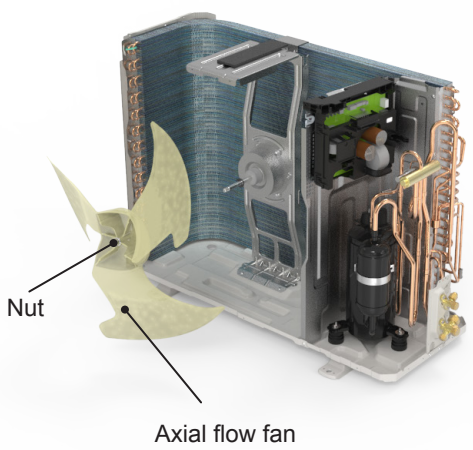Step	Procedure
4. Remove front panel assy	
Remove connection screws connecting the front panel assy with the chassis and the motor support, and then remove the front panel assy.	
5. Remove right side plate assy	
Rescrew the ground screws, remove the ground wires, loosen the screws fixing terminal board, remove the terminal board, rescrew the screws fixing the right plate, and remove the right side plate assy.	
6. Remove axial flow fan	
Remove the nut on the fan and then remove the axial flow fan.	

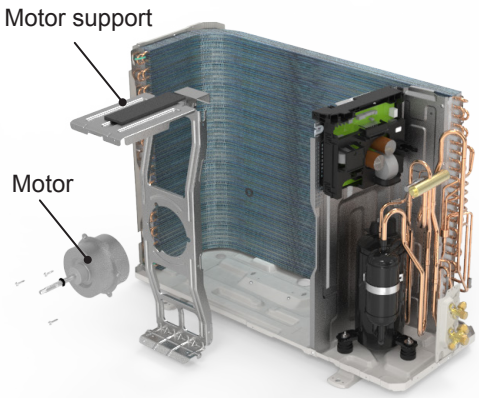Step	Procedure
7. Remove motor support and motor	
Remove the screws fixing the motor support and lift the motor support to remove it. Remove the screws fixing the motor and then remove the motor.	
8. Remove electric box assy	
Remove the terminals, lift up and rotate the electrical box assy to the right so that the snaps on the clapboard are removed and the electrical box assy are removed.	
9. Remove clapboard assy	
Remove the screws fixing the clapboard assy and then remove the clapboard assy.	

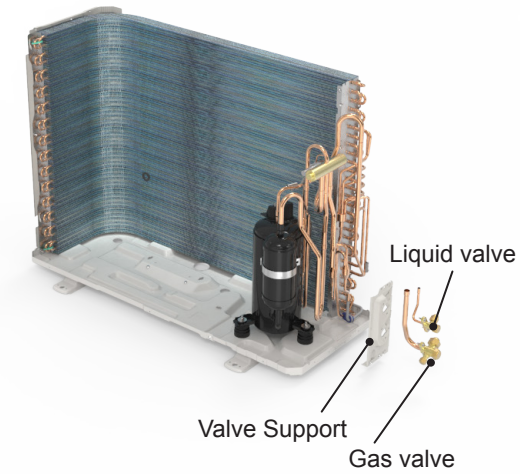
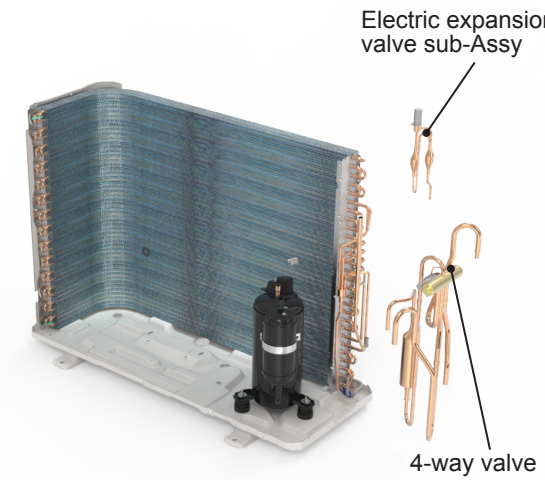
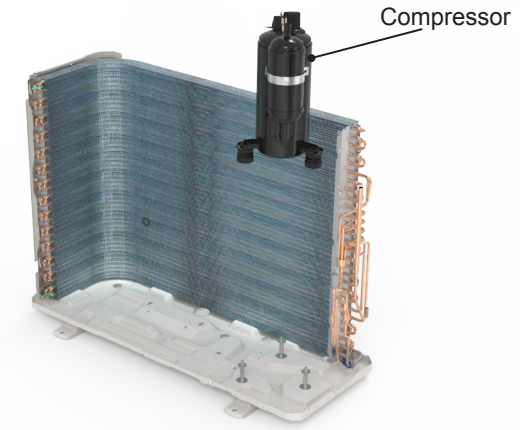
Step	Procedure
10. Remove gas valve and liquid valve	
	Remove the valve support bolck, remove the screws fixing the gas valve and the liquid valve,unsolder the welding joint connecting the gas valve and the liquid valve, remove them. Note: Discharge the refrigerant completely befor unsoldering; when unsoldering, wrap the gas valve with a wet cloth completely to avoid damage to the valve caused by high temperature.
	
11. Remove 4-way valve and electric expansion valve sub-Assy	
	Unsolder the welding joints connecting the 4-way valve assy, remove the 4-way valve. Unsolder the spot weld of electric expansion valve sub-Assy and condenser, and then remove the electric expansion valve sub-Assy. Note: Before unsoldering the welding joint, wrap the 4-way valve with a wet cloth completely to avoid damage to the valve caused by high temperature. When unsoldering the spot weld, wrap the electric expansion valve sub-Assy with wet cloth completely to avoid damaging the valve due to high temperature.
	
12. Remove compressor	
	Remove the 3 foot nuts on the compressor and then remove the compressor.
	




48K(XH)
Note:The appearance of front grill is for reference only.




Caution: discharge the refrigerant completely before removal.



Step	Procedure
1. Before disassembly	
2. Remove top cover Remove the screws fixing top cover and then remove the top cover.	
3. Remove big handle and valve cover Remove the screws fixing big handle, valve cover and then remove them.	




Step	Procedure
4. Remove front panel assy	
	Remove connection screws connecting the front panel assy with the chassis and the motor support, and then remove the front panel assy.
	
5. Remove rear grill	
	Remove the screws connecing the left side plate and right side plate and then remove rear grill.
	
6. Remove right side plate assy	
	Rescrew the ground screws, remove the ground wires, loosen the screws fixing terminal board, remove the terminal board, rescrew the screws fixing the right plate, and remove the right side plate assy.
	

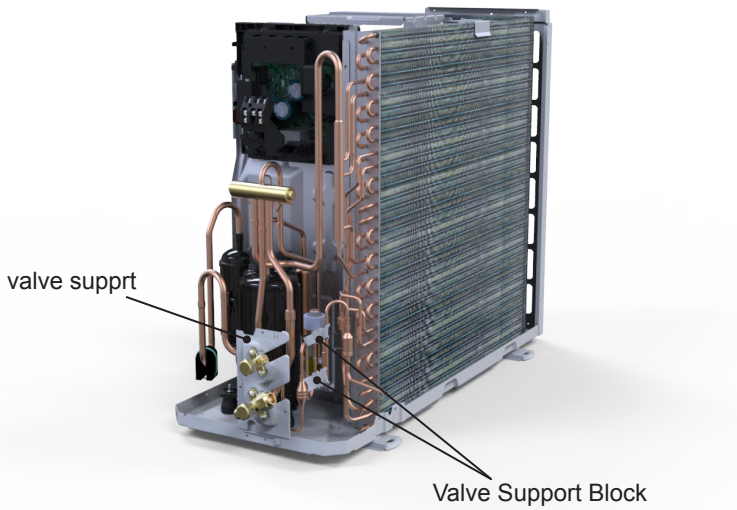
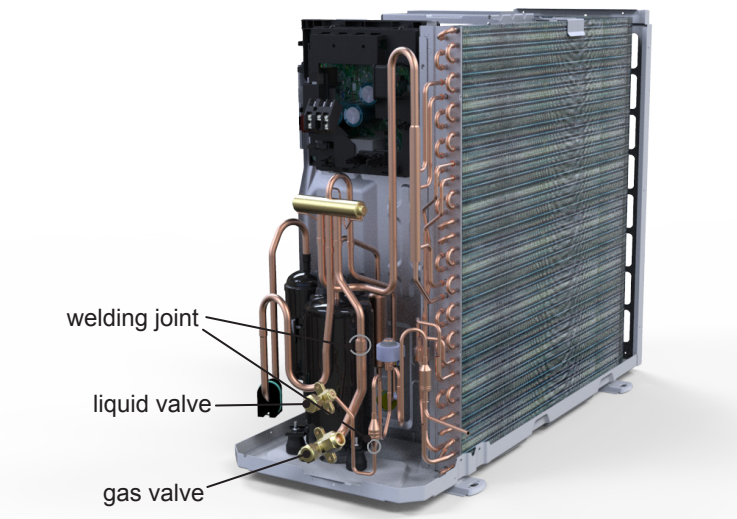
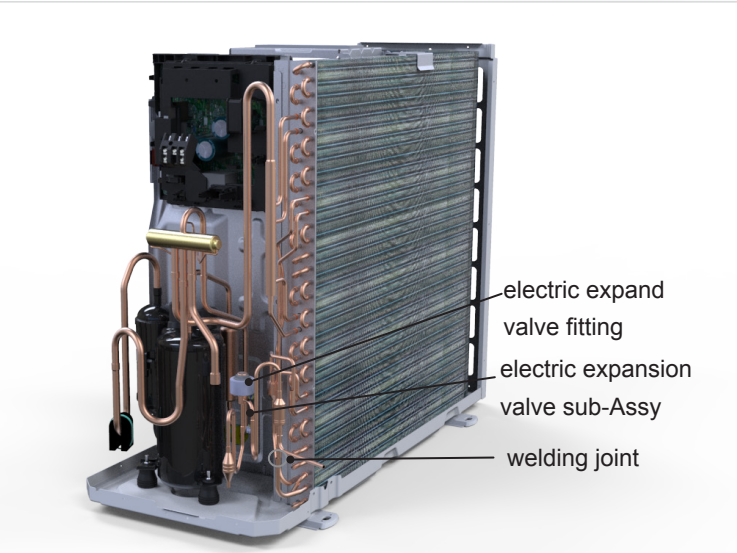
Step	Procedure
7. Remove valve suppprt	
Remove the valve support bolck, remove the screws fixing valve support, remove the screws fixing the liquid valve and gas valve then remove the valve support.	
8. Remove gas valve and liquid valve	
Unsolder the welding joint connecting the gas valve and the liquid valve, remove them. Note: Discharge the refrigerant completely befor unsoldering; when unsoldering, wrap the gas valve with a wet cloth completely to avoid damage to the valve caused by high temperature.	
9. Remove electronic expansion valve	
Remove the terminals of the electric expand valve fitting and rotate to remove the electric expand valve fitting. Unsolder the welding joint connecting the electronic expansion Valve and then remove the electronic expansion valve.	

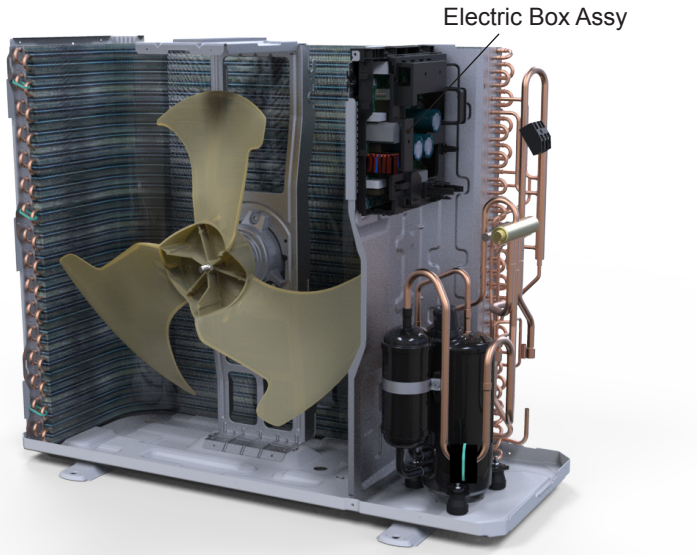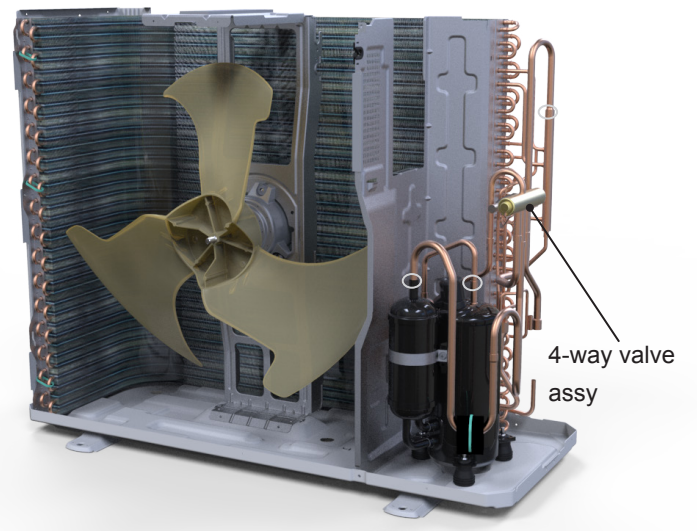
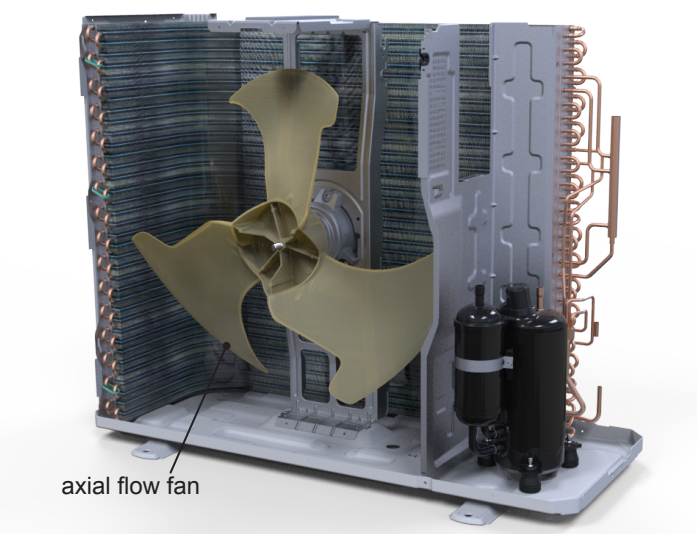
Step	Procedure
10. Remove electric box assy	
Unplug the terminals, unscrew 1 screw that secures the electrical box assy, release the two snaps on the electrical box assy (in the clapboard and condenser angle), pull outwards, and remove the electrical box assy.	
11. Remove 4-way valve assy	
Unsolder the welding joints connecting the 4-way valve assy, remove the 4-way valve. Note: Before unsoldering the welding joint, wrap the 4-way valve with a wet cloth completely to avoid damage to the valve caused by high temperature.	
12. Remove axial flow fan	
Remove the nut on the fan and then remove the axial flow fan.	

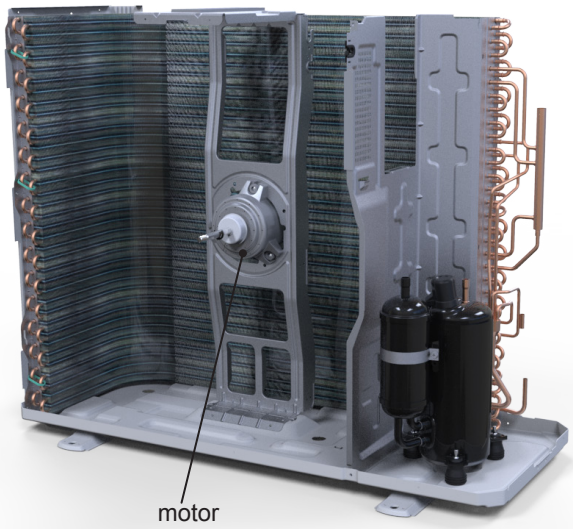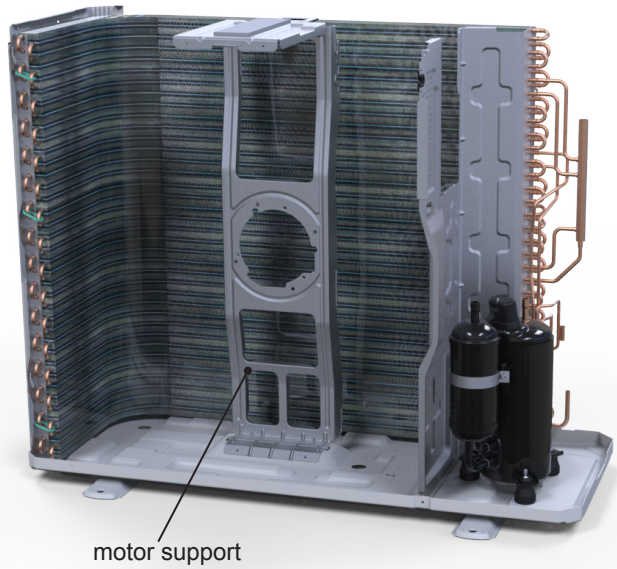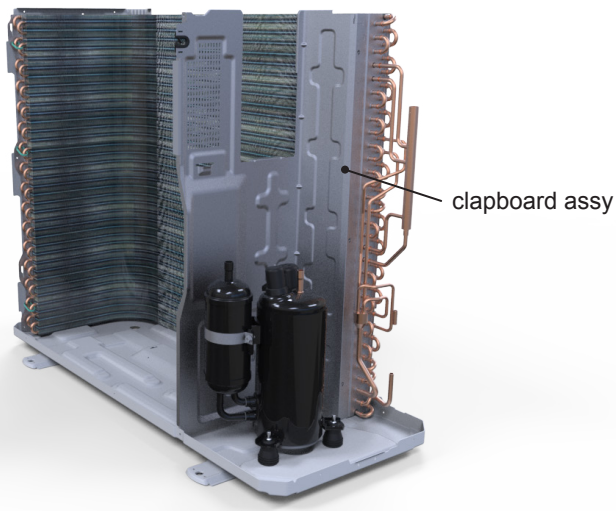Step	Procedure
13. Remove motor	
Remove the screws fixing the motor and then remove the motor.	
14. Remove motor support	
Remove the screws fixing the motor support and lift the motor support to remove it.	
15. Remove clapboard assy	
Remove the screws fixing the clapboard assy and then remove the clapboard assy.	

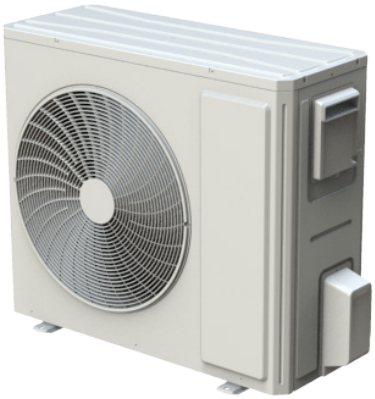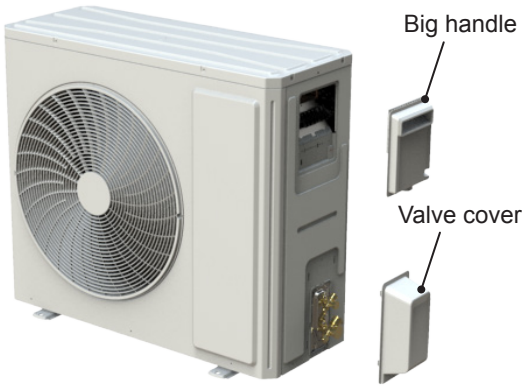Step	Procedure
1. Before disassembly	
2. Remove big handle and valve cover Remove the screws fixing big handle, valve cover and then remove them.	
3. Remove top cover Remove the screws fixing top panel and then remove the top panel.	

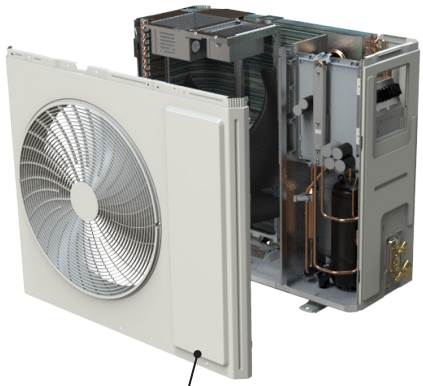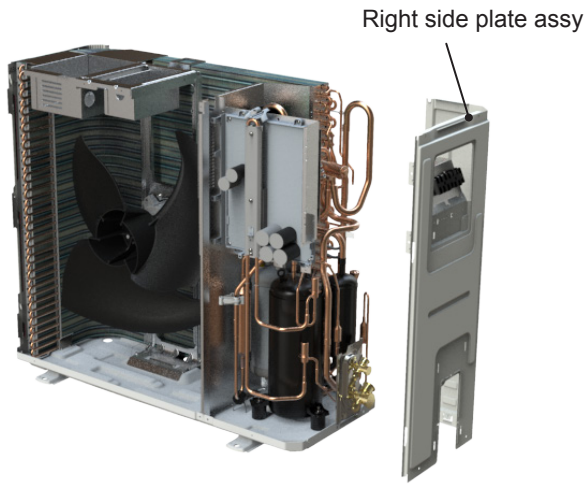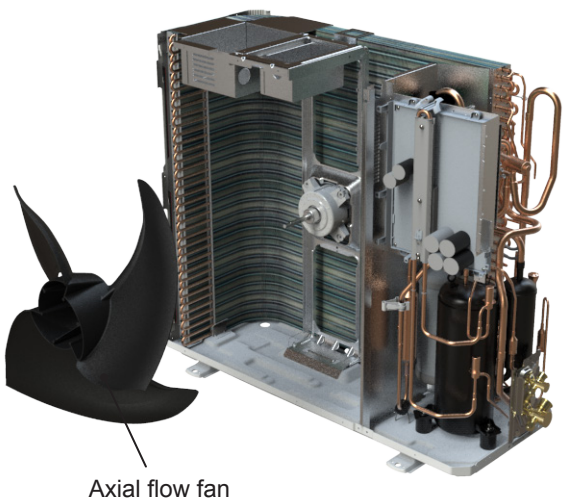Step	Procedure
4. Remove front panel assy	
Remove connection screws connecting the front panel assy with the chassis and the motor support, and then remove the front panel assy.	
5. Remove right side plate assy	
Rescrew the ground screws, remove the ground wires, loosen the screws fixing terminal board, remove the terminal board, rescrew the screws fixing the right plate, and remove the right side plate assy.	
6. Remove axial flow fan	
Remove the nut on the fan and then remove the axial flow fan.	

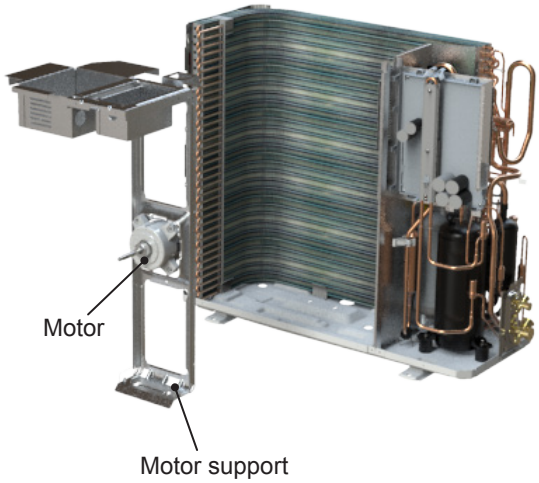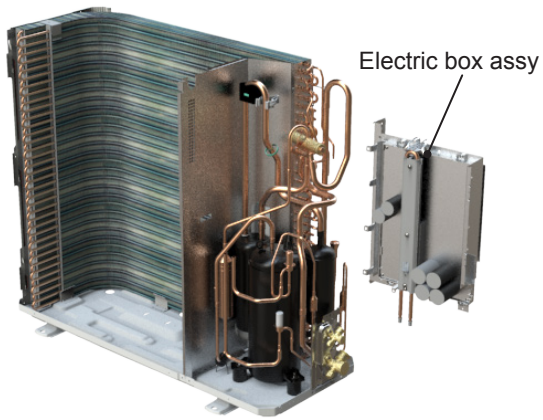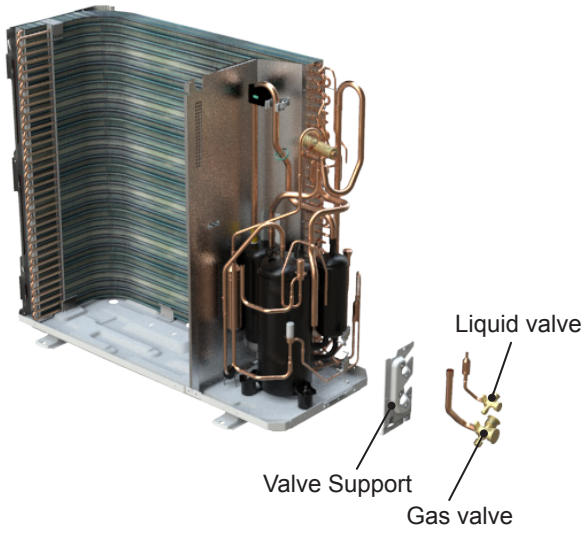Step	Procedure
7. Remove motor support and motor	
	Remove the screws fixing the motor support and lift the motor support to remove it. Remove the screws fixing the motor and then remove the motor.
	
8. Remove electric box assy	
	Remove the terminals, lift up and rotate the electrical box assy to the right so that the snaps on the clapboard are removed and the electrical box assy are removed.
	
9. Remove gas valve and liquid valve	
	Remove the valve support bolck, remove the screws fixing the gas valve and the liquid valve,unsolder the welding joint connecting the gas valve and the liquid valve, remove them. Note: Discharge the refrigerant completely befor unsoldering; when unsoldering, wrap the gas valve with a wet cloth completely to avoid damage to the valve caused by high temperature.
	

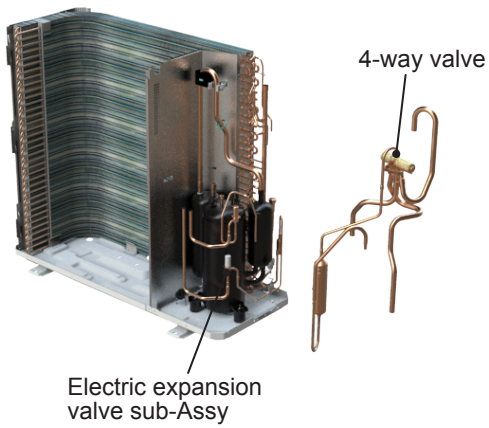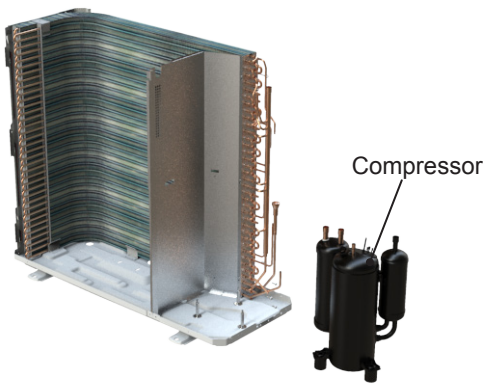Step	Procedure
10. Remove 4-way valve and electric expansion valve sub-Assy	
Unsolder the welding joints connecting the 4-way valve assy, remove the 4-way valve. Unsolder the spot weld of electric expansion valve sub-Assy and condenser, and then remove the electric expansion valve sub-Assy. Note: Before unsoldering the welding joint, wrap the 4-way valve with a wet cloth completely to avoid damage to the valve caused by high temperature. When unsoldering the spot weld, wrap the electric expansion valve sub-Assy with wet cloth completely to avoid damaging the valve due to high temperature.	
11. Remove compressor	
Remove the 3 foot nuts on the compressor and then remove the compressor.	

Appendix:

Appendix 1: Reference Sheet of Celsius and Fahrenheit

Conversion formula for Fahrenheit degree and Celsius degree: Tf=Tcx1.8+32

Set temperature

Fahrenheit display temperature（˚F）	Fahrenheit（˚F）	Celsius（℃）	Fahrenheit display temperature（˚F）	Fahrenheit（˚F）	Celsius（℃）	Fahrenheit display temperature（˚F）	Fahrenheit（˚F）	Celsius（℃）
61	60.8	16	69/70	69.8	21	78/79	78.8	26
62/63	62.6	17	71/72	71.6	22	80/81	80.6	27
64/65	64.4	18	73/74	73.4	23	82/83	82.4	28
66/67	66.2	19	75/76	75.2	24	84/85	84.2	29
68	68	20	77	77	25	86	86	30

Ambient temperature

Fahrenheit display temperature（˚F）	Fahrenheit（˚F）	Celsius（℃）	Fahrenheit display temperature（˚F）	Fahrenheit（˚F）	Celsius（℃）	Fahrenheit display temperature（˚F）	Fahrenheit（˚F）	Celsius（℃）
32/33	32	0	55/56	55.4	13	79/80	78.8	26
34/35	33.8	1	57/58	57.2	14	81	80.6	27
36	35.6	2	59/60	59	15	82/83	82.4	28
37/38	37.4	3	61/62	60.8	16	84/85	84.2	29
39/40	39.2	4	63	62.6	17	86/87	86	30
41/42	41	5	64/65	64.4	18	88/89	87.8	31
43/44	42.8	6	66/67	66.2	19	90	89.6	32
45	44.6	7	68/69	68	20	91/92	91.4	33
46/47	46.4	8	70/71	69.8	21	93/94	93.2	34
48/49	48.2	9	72	71.6	22	95/96	95	35
50/51	50	10	73/74	73.4	23	97/98	96.8	36
52/53	51.8	11	75/76	75.2	24	99	98.6	37
54	53.6	12	77/78	77	25			

Appendix 2: Configuration of Connection Pipe

1. Standard length of connection pipe(More details please refer to the specifications.)
2. Min. length of connection pipe for the unit with standard connection pipe of 5m, there is no limitation for the min. length of connection pipe. For the unit with standard connection pipe of 7.5m and 8m, the min. length of connection pipe is 3m.
3. Max. length of connection pipe and max. high difference.(More details please refer to the specifications.)
4. The additional refrigerant oil and refrigerant charging required after prolonging connection pipe

● After the length of connection pipe is prolonged for 10m at the basis of standard length, you should add 5ml of refrigerant oil for each additional 5m of connection pipe.

● The calculation method of additional refrigerant charging amount (on the basis of liquid pipe):

● Basing on the length of standard pipe, add refrigerant according to the requirement as shown in the table. The additional refrigerant charging amount per meter is different according to the diameter of liquid pipe. See the following sheet.

● Additional refrigerant charging amount = prolonged length of liquid pipe X additional refrigerant charging amount per meter.

Additional refrigerant charging amount for R32				
Diameter of connection pipe		Indoor unit throttle	Outdoor unit throttle	
Liquid pipe	Gas pipe	Cooling only, cooling and heating (g / m)	Cooling only(g/m)	Cooling and heating(g/m)
1/4”	3/8” or 1/2”	16	12	16
1/4” or 3/8”	5/8” or 3/4”	40	12	40
1/2”	3/4” or 7/8”	80	24	96
5/8”	1" or 1 1/4”	136	48	96
3/4"	/	200	200	200
7/8"	/	280	280	280


Appendix 3: Pipe Expanding Method

⚠ **Note:**

Improper pipe expanding is the main cause of refrigerant leakage.Please expand the pipe according to the following steps:

A:Cut the pip


- Confirm the pipe length according to the distance of indoor unit and outdoor unit.
- Cut the required pipe with pipe cutter.

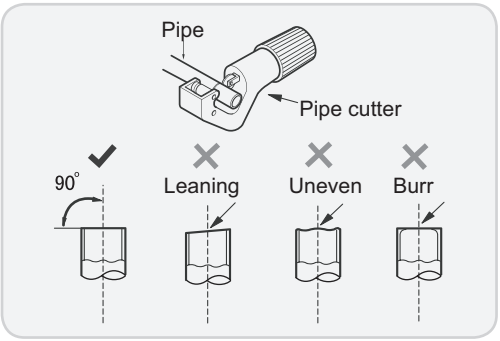

B:Remove the burrs


- Remove the burrs with shaper and prevent the burrs from getting into the pipe.

C:Put on suitable insulating pipe.

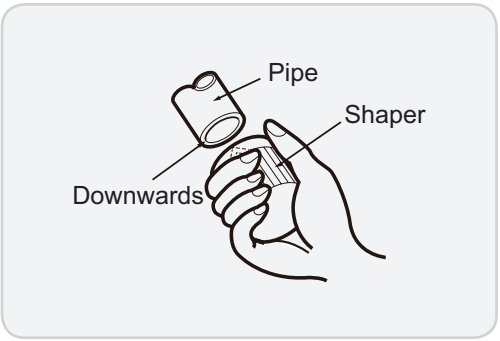

D:Put on the union nut

- Remove the union nut on the indoor connection pipe and outdoor valve; install the union nut on the pipe.

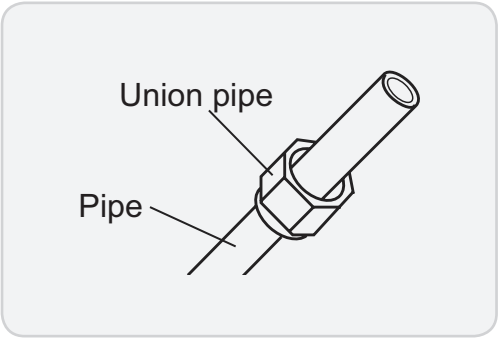


E:Expand the port

- Expand the port with expander.

⚠ **Note:**


- "A" is different according to the diameter, please refer to the sheet below:

Outer diameter(mm)	A(mm)	
	Max	Min
Φ6 - 6.35 (1/4")	1.3	0.7
Φ9.52 (3/8")	1.6	1.0
Φ12 - 12.70 (1/2")	1.8	1.0
Φ16 - 15.88 (5/8")	2.4	2.2

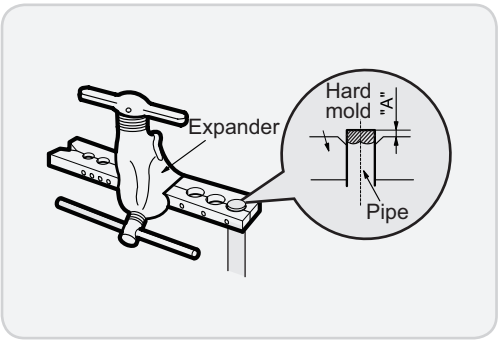

F:Inspection

- Check the quality of expanding port. If there is any blemish, expand the port again according to the steps above.

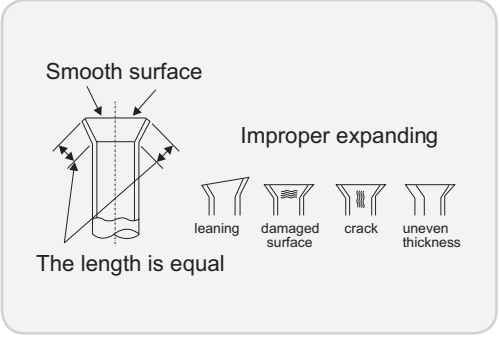

Appendix 4: List of Resistance for Temperature Sensor

Resistance Table of Ambient Temperature Sensor for Indoor and Outdoor Units (15K)

Temp(°C)	Resistance(kΩ)	Temp(°C)	Resistance(kΩ)	Temp(°C)	Resistance(kΩ)	Temp(°C)	Resistance(kΩ)
-19	138.10	0	49.02	20	18.75	40	7.97
-18	128.60	2	44.31	22	17.14	42	7.35
-16	115.00	4	40.09	24	15.68	44	6.79
-14	102.90	6	36.32	26	14.36	46	6.28
-12	92.22	8	32.94	28	13.16	48	5.81
-10	82.75	10	29.90	30	12.07	50	5.38
-8	74.35	12	27.18	32	11.09	52	4.99
-6	66.88	14	24.73	34	10.20	54	4.63
-4	60.23	16	22.53	36	9.38	56	4.29
-2	54.31	18	20.54	38	8.64	58	3.99

Resistance Table of Tube Temperature Sensors for Indoor and Outdoor (20K)

Temp(°C)	Resistance(kΩ)	Temp(°C)	Resistance(kΩ)	Temp(°C)	Resistance(kΩ)	Temp(°C)	Resistance(kΩ)
-19	181.40	20	25.01	60	4.95	100	1.35
-15	145.00	25	20.00	65	4.14	105	1.16
-10	110.30	30	16.10	70	3.48	110	1.01
-5	84.61	35	13.04	75	2.94	115	0.88
0	65.37	40	10.62	80	2.50	120	0.77
5	50.87	45	8.71	85	2.13	125	0.67
10	39.87	50	7.17	90	1.82	130	0.59
15	31.47	55	5.94	95	1.56	135	0.52

Resistance Table of Discharge Temperature Sensor for Outdoor (50K)

Temp(°C)	Resistance(kΩ)	Temp(°C)	Resistance(kΩ)	Temp(°C)	Resistance(kΩ)	Temp(°C)	Resistance(kΩ)
-30	911.400	10	98	50	17.65	90	4.469
-25	660.8	15	77.35	55	14.62	95	3.841
-20	486.5	20	61.48	60	12.17	100	3.315
-15	362.9	25	49.19	65	10.18	105	2.872
-10	274	30	39.61	70	8.555	110	2.498
-5	209	35	32.09	75	7.224	115	2.182
0	161	40	26.15	80	6.129	120	1.912
5	125.1	45	21.43	85	5.222	125	1.682



JF00305022

GREE ELECTRIC APPLIANCES, INC. OF ZHUHAI

Add: West Jinji Rd, Qianshan, Zhuhai, Guangdong, China, 519070
Tel: (+86-756) 8522219
Fax: (+86-756) 8669426
E-mail: global@cn.gree.com www.gree.com

For product improvement, specifications and appearance in this manual are subject to change without prior notice.